



UPLOADING A GEO_REPORT FILE

SUCCESS

Your GEO_REPORT file has been successfully submitted!

<u>Submittal Type:</u>	GEO_REPORT
<u>Report Title:</u>	DFSP Norwalk Remediation Status Report Quarter 1, 2021
<u>Report Type:</u>	Remedial Progress Report
<u>Report Date:</u>	5/10/2021
<u>Facility Global ID:</u>	SLT43185183
<u>Facility Name:</u>	Norwalk, Fuel Terminal DFSP - DOD - NORWALK DFSP
<u>File Name:</u>	DFSP Norwalk Remediation Status Report Quarter 1, 2021.pdf
<u>Organization Name:</u>	The Source Group, Inc.(Subsidiary of Apex Companies, LLC)
<u>Username:</u>	SIGNAL HILL
<u>IP Address:</u>	75.83.154.208
<u>Submittal Date/Time:</u>	5/11/2021 11:34:01 AM
<u>Confirmation Number:</u>	1042458295

Copyright © 2021 State of California



DEFENSE LOGISTICS AGENCY
DLA Energy –Engineering, Environmental, Property Division
8725 JOHN J. KINGMAN ROAD
FORT BELVOIR VIRGINIA 22060-6221

May 10, 2021

Mr. Paul Cho, P.G.
Engineering Geologist, Site Cleanup V
California Environmental Protection Agency
Los Angeles Regional Water Quality Control Board
320 West 4th Street, Suite 200
Los Angeles, California 90013

Dear Mr. Cho:

Enclosed is one electronic copy of the *Remediation Status Report – First Quarter 2021, Defense Fuel Support Point Norwalk* (SCP NO. 0286A, SITE ID No. 16638) located at 15306 Norwalk Boulevard, Norwalk, California

If you have any questions or need additional information concerning this document, please contact Ms. Carol Devier-Heeny at (571) 767-9813 or carol.devier-heeny@dla.mil.

Sincerely,

POTTER.WILLIA
M.Y.1394566272

Digitally signed by
POTTER.WILLIAM.Y.139456627
2
Date: 2021.05.11 08:04:43
-04'00'

William Y. Potter
Acting Chief, Restoration Section

Enclosure
As stated

cc: Neil Irish, P.G., Principal Geologist, SGI/Apex

REMEDIATION STATUS REPORT - FIRST QUARTER 2021
DEFENSE FUEL SUPPORT POINT NORWALK
15306 Norwalk Boulevard
Norwalk, California

SGI Project No. 091-NDLA-018
DLA Contract No. SPO600-14-D-5410, Task Order 0018

Prepared For:



Defense Logistics Agency - Energy
Environmental Division Restoration Branch
8725 John J. Kingman Drive
Fort Belvoir, VA 22060-6222

For Submittal To:

Mr. Paul Cho, P.G.
Engineering Geologist, Site Cleanup V
California Environmental Protection Agency
California Regional Water Quality Control Board, Los Angeles
320 West Fourth Street, Suite 200
Los Angeles, California 90013

Prepared By:



1962 Freeman Avenue
Signal Hill, California 90755

May 10, 2021

Prepared By:

A handwritten signature in black ink, appearing to read "Imelda Morales".

Imelda Morales
Senior Remediation Engineer

Reviewed By:

A handwritten signature in blue ink, appearing to read "Neil F. Irish".

Neil F. Irish, P.G. 5484
Principal Geologist

	PAGE
LIST OF FIGURES	ii
LIST OF TABLES	ii
LIST OF APPENDICES	iii
LIST OF ACRONYMS	iv
1.0 INTRODUCTION	1-1
1.1 Contaminants of Concern	1-1
1.2 Remediation Technologies.....	1-1
1.2.1 Groundwater Extraction and Treatment System	1-2
1.2.2 Biosparge System.....	1-2
1.2.3 Soil Vapor Extraction Systems	1-2
1.2.3.1 Carbon Vapor Extraction System	1-3
1.2.3.2 Thermal Oxidizer Vapor Extraction System	1-3
1.2.4 LNAPL Removal	1-4
1.2.5 Above Ground Soil Treatment.....	1-4
1.2.6 Soil Management.....	1-5
2.0 OPERATIONS, MAINTENANCE AND MONITORING	2-1
2.1 Groundwater Extraction and Treatment System	2-1
2.2 Soil Vapor Extraction Systems.....	2-1
2.3 Biosparge System	2-2
2.4 LNAPL Removal Via Bailing, Skimming and Absorbent Socks.....	2-3
2.5 LNAPL Removal Via Product Recovery System.....	2-3
3.0 SUMMARY OF REMEDIATION PROGRESS	3-1
3.1 Groundwater Extraction and Treatment System	3-1
3.2 Soil Vapor Extraction Systems.....	3-1
3.3 Biosparge System	3-1
3.4 LNAPL Gauging and Removal.....	3-2
3.4.1 LNAPL Removal Via Bailing, Skimming and Absorbent Socks	3-2
3.4.2 LNAPL Removal Via Product Recovery System	3-2
4.0 REMEDIATION SYSTEMS EVALUATION AND OPTIMIZATION	4-1
5.0 PLANNED SECOND QUARTER 2021 ACTIVITIES	5-1
6.0 LIMITATIONS	6-1

LIST OF FIGURES

Figure 1	Site Location Map
Figure 2	Site Map Showing All Well and Piping Locations
Figure 3	Distribution of Floating Product on Groundwater Second Semiannual 2020 Monitoring Event

LIST OF TABLES

Table 1	Remediation Well Summary
Table 2A	Groundwater Extraction and Treatment System Operations Summary – January
Table 2B	Groundwater Extraction and Treatment System Operations Summary – February
Table 2C	Groundwater Extraction and Treatment System Operations Summary – March
Table 3A	Carbon Vapor Extraction System Operations Summary – January
Table 3B	Carbon Vapor Extraction System Operations Summary – February
Table 3C	Carbon Vapor Extraction System Operations Summary – March
Table 4	Historical Summary of Analytical Vapor Sampling Results - Influent Carbon VES
Table 5A	Thermal Oxidizer Vapor Extraction System Operations Summary – January
Table 5B	Thermal Oxidizer Vapor Extraction System Operations Summary – February
Table 5C	Thermal Oxidizer Vapor Extraction System Operations Summary – March
Table 6	Historical Summary of Analytical Vapor Sampling Results - Influent Thermal Oxidizer VES
Table 7A	Summary of LNAPL Removal in Well GMW-62 – First Quarter 2021
Table 7B	Summary of LNAPL Removal in Well GMW-68 - First Quarter 2021
Table 7C	Summary of LNAPL Removal in Well GMW-7 - First Quarter 2021
Table 7D	Summary of LNAPL Removal in Well TF-19 - First Quarter 2021
Table 7E	Summary of LNAPL Removal in Well TFR-9 - First Quarter 2021
Table 7F	Summary of LNAPL Removal in Well GMW-18 - First Quarter 2021
Table 7G	Summary of LNAPL Removal in Well TFR-12 - First Quarter 2021
Table 7H	Summary of LNAPL Removal in Well TFR-14 - First Quarter 2021
Table 7I	Summary of LNAPL Removal in Well TF-15 - First Quarter 2021
Table 7J	Summary of LNAPL Removal in Well TFR-15 - First Quarter 2021
Table 7K	Summary of LNAPL Removal in Well TF-16 - First Quarter 2021
Table 7L	Summary of LNAPL Removal in Well GW-14R - First Quarter 2021
Table 7M	Summary of LNAPL Removal in Well TFR-18 - First Quarter 2021
Table 7N	Summary of LNAPL Removal in Well TFR-22- First Quarter 2021
Table 7O	Summary of LNAPL Removal in Well TFR-24 - First Quarter 2021

Table 7P	Summary of LNAPL Removal in Well TFR-29- First Quarter 2021
Table 7Q	Summary of LNAPL Removal in Well TFR-33 - First Quarter 2021
Table 7R	Summary of LNAPL Removal in Well RTF-18-E - First Quarter 2021
Table 7S	Summary of LNAPL Removal in Well RTF-18-NW - First Quarter 2021
Table 7T	Summary of LNAPL Removal in Well RTF-18-N - First Quarter 2021
Table 7U	Summary of LNAPL Removal in Well TF-18 - First Quarter 2021
Table 7V	Summary of LNAPL Removal in Well RTF-18-NNW - First Quarter 2021
Table 7W	Summary of LNAPL Removal in Well RTF-18-W – First Quarter 2021
Table 8	Historical Summary of Analytical Groundwater Sampling Results - Influent GWETS
Table 9A	Historical Summary of Field Vapor Readings – Former Tank Farm Horizontal Wells
Table 9B	Historical Summary of Field Vapor Readings – Central Area Vertical Wells
Table 9C	Historical Summary of Field Vapor Readings – Eastern Area Vertical Wells
Table 9D	Historical Summary of Field Vapor Readings – Southern Area Vertical Wells
Table 10	Historical Summary of Analytical Vapor Sampling Results - Individual Wells
Table 11A	Biosparge System Operations Summary – January
Table 11B	Biosparge System Operations Summary – February
Table 11C	Biosparge System Operations Summary – March

LIST OF APPENDICES

Appendix A	Laboratory Analytical Reports and Chain-of-Custody Documents
Appendix B	LNAPL Hazardous Waste Manifest

LIST OF ACRONYMS

AST	above ground storage tank
BTEX	Benzene, toluene, ethylbenzene, and total xylenes
COD	Chemical Oxygen Demand
°F	degrees Fahrenheit
DFSP	Defense Fuel Support Point
DLA	Defense Logistics Agency - Energy Environmental Division Restoration Branch
DTP	Depth to product
DTW	Depth to groundwater
ELAP	Environmental Laboratory Accreditation Program
EPA	United States Environmental Protection Agency
GAC	Granular activated carbon
GRO	Gasoline range organic
GWE	Groundwater extraction
GWETS	Groundwater extraction and treatment system
JP-5	Jet propellant number 5
LARWQCB	California Regional Water Quality Control Board, Los Angeles Region
LNAPL	Light non-aqueous phase liquid
µg/L	micrograms per liter
MTBE	Methyl tertiary-butyl ether
ND	Non-detect
NFA	No Further Action
NPDES	National Pollutant Discharge Elimination System
OM&M	Operations, maintenance, and monitoring
OVA	Organic vapor analyzer
ppm	Parts per million
PID	Photoionization detector
SCAQMD	South Coast Air Quality Management District
SFPP	Santa Fe Pacific Pipelines Partners, L.P.
SGI	The Source Group, Inc.
SVE	Soil vapor extraction
SS	Suspended Solids
TBA	Tertiary-butyl alcohol
TOC	Top of casing

TPHd	Total petroleum hydrocarbons quantified as diesel
TPHg	Total petroleum hydrocarbons quantified as gasoline
VES	Vapor extraction system
VOCs	Volatile organic Compounds

1.0 INTRODUCTION

On behalf of our client, Defense Logistics Agency - Energy (DLA), The Source Group, Inc., a subsidiary of Apex Companies, LLC (SGI-Apex) presents this report to summarize remediation system operations during this reporting period (First Quarter 2021 – January 1, 2021 through March 31, 2021) for the Defense Fuel Support Point (DFSP) Norwalk facility, located at 15306 Norwalk Boulevard, Norwalk, California (Site; Figures 1 and 2).

This report is submitted pursuant to a request from the California Regional Water Quality Control Board, Los Angeles Region (LARWQCB) in a letter dated May 3, 2013.

1.1 Contaminants of Concern

Soil and groundwater at the areas of concern are impacted with hydrocarbons consisting primarily of benzene, toluene, ethylbenzene, and total xylenes (collectively, BTEX), jet propellant number 5 (JP-5), diesel, methyl tertiary-butyl ether (MTBE), and tertiary-butyl alcohol (TBA). MTBE and TBA are interpreted to have resulted from Santa Fe Pacific Pipelines Partners, L.P. (SFPP) operations, and remediation of these impacts is being addressed by SFPP.

The impacted areas consist of the northwestern corner of the Site, the north-central portion of the former tank farm (central area), the northeastern property boundary (eastern area), off-site Holifield Park area, and the southern former water tank and truck fueling areas (southern area).

1.2 Remediation Technologies

Various remediation technologies have been implemented at the Site to treat the hydrocarbon impacts in soil and groundwater. The purposes of these technologies are to reduce hydrocarbon concentrations to cleanup goals, prevent off-site migration, contain contaminant mass, and ultimately achieve Site closure within a reasonable timeframe.

Remediation technologies utilized at the Site include soil vapor extraction (SVE), groundwater extraction (GWE), biosparging, and light non-aqueous phase liquid (LNAPL) removal via manual bailing, vacuum truck, passive skimming, active pumping using a portable skimming pump and absorbent socks. The above ground treatment of contaminated vadose zone soils excavated at the Site was conducted from April 2015 until March 2017 (see SGI-Apex's January 2018 *Shallow Soil Closure Report*). An automated product recovery system was brought online during August 2016 and SVE and/or biosparge wells were installed during November 2016, June/July 2017 and November/December 2017 as part of ongoing remedial expansion activities.

A summary of Site remediation wells, including well identification, well construction information, well function, and operational status, is presented in Table 1. The soil and groundwater remediation system layout (well and piping locations) is presented in Figure 2.

1.2.1 Groundwater Extraction and Treatment System

The GWE wells pumping to the groundwater extraction and treatment system (GWETS) for hydrocarbon extraction of dissolved-phase subsurface impacts, historically included wells installed in the northwest corner of the Site (GW-2 and GW-13), the central area (GW-14R, which was not connected to the GWETS due to the presence of LNAPL at the time), and the eastern area (GW-15, GW-16, and GMW-58, which was not connected to the GWETS when SGI-Apex took over the project).

The GWETS utilizes electric pumps in each of the GWE wells to extract groundwater into a shared surge tank. Groundwater is then pumped from the surge tank through three particulate-removal bag filter vessels in series (BF1, BF2, and BF3), two MYCELX vessels in series (MX-7 and MX-21) for the removal of residual free product and/or oils/grease, and three granular activated carbon (GAC) vessels in series (2,000-pound GAC-1, 2,000-pound GAC-2, and 1,500-pound GAC-3). The groundwater is then pumped through various media canisters and drums for additional treatment prior to being discharged to the storm drain.

Operation of the GWETS was conducted in accordance with CI No. 7585 and South Coast Air Quality Management District (SCAQMD) Permit to Operate G6962, A/N 501180. Discharge of the treated groundwater was conducted in accordance with National Pollutant Discharge Elimination System (NPDES) permit CAG994004 until February 27, 2019 when the system was shut down pending approval of the sewer discharge permit application. The GWETS was restarted on October 10, 2019 and is operating in accordance with Sanitation Districts of Los Angeles County Industrial Wastewater Discharge Permit number 22453. Active GWE wells are identified in Section 3.1 and Tables 2A through 2C.

1.2.2 Biosparge System

The biosparge wells for hydrocarbon removal from dissolved-phase subsurface impacts are located throughout the Site. The biosparge system was off-line pending completion of soil cleanup activities per SGI-Apex's January 2018 *Shallow Soil Closure Report*. System recommissioning work was completed during Fourth Quarter 2018 in accordance with SGI-Apex's June 30, 2017 *Remediation Well Installation Update Report*, and July 11, 2018 *Well Installation Completion Report*. The recommissioned biosparge system includes 109 biosparge wells (Table 1) connected to the system via 11 total air supply trunklines. Injection air is supplied to the wells by a rotary claw compressor and cooled by a heat exchanger before delivery to the wells via the active air supply trunkline. The trunklines are connected to a common manifold and injection air is controlled by solenoids on each trunkline. The injection cycle duration and frequency are controlled by timers and total injection duration is recorded by hour meters for each trunkline. Biosparge system shakedown testing was conducted in late December 2018, and system operation resumed in early 2019.

1.2.3 Soil Vapor Extraction Systems

As illustrated on Figure 2, the SVE well network for hydrocarbon extraction from vadose zone subsurface impacts historically included wells installed in the following areas: former above ground

storage tank (AST) basin 80001 (VEW-23), former AST basins 80006 and 80007 (VEW-22, HW-1 and HW-3), former AST basin 80008 (HW-5, and HW-7), former AST basin 55004 (VEW-28, VEW-29, and VEW-30), northeastern boundary area (VEW-32, VEW-33, VEW-34, VEW-35, VEW-36, and VEW-37), and southern former truck fueling and water tank area (VEW-31, VEW-38, VEW-39, VEW-40, VW-07, VW-09, VW-10, VW-11, VW-12, VW-13, VW-14, VW-15, and VW-16).

Several new SVE wells were installed within the eastern area and southern area of the Site during November 2016 and June/July 2017, as summarized in SGI-Apex's June 30, 2017 *Remediation Well Installation Update Report*. Wells VEW-38, VEW-39 and VEW-40 were brought online to the carbon vapor extraction system (VES) in June 2017, and wells RW-1, RW-2, RW-7, RW-9, RW-12, RW-13, RW-18, RW-20 through RW-24, RW-26, and RW-28 through RW-33 were brought online in August 2017. The new SVE wells were brought online following the completion of tie-in work to the carbon VES. Most of these wells were subsequently tied into the temporary thermal oxidizer VES during late December 2017/early January 2018 prior to the January 8, 2018 startup of this system, with the carbon VES being utilized to exclusively extract from three horizontal wells (HW-1, HW-5 and HW-7) that span through the entire former tank farm since 2018. Additionally, tie-in of wells RW-2 through RW-8, RW-10 through RW-12, and RW-14 through RW-17 to the temporary thermal oxidizer VES was completed on February 14, 2018, and wells RW-34 through RW-50 were tied in and brought online on June 27, 2018. The permanent full-scale thermal oxidizer VES (hereafter referred to as thermal oxidizer VES) was installed and tested and system startup began on March 13, 2019.

Each VES utilizes a blower to remove soil vapors from the subsurface. The extracted vapors are conveyed through a knockout tank that separates entrained moisture from the soil vapors. For both systems, accumulated moisture within the knockout tank is treated by the GWETS, as described in the preceding section. Following is a brief summary of each VES.

1.2.3.1 Carbon Vapor Extraction System

Soil vapors from the carbon VES knockout tank are treated via four GAC vessels where volatile organic compounds (VOCs) are adsorbed onto the GAC within the vessels. The primary and secondary GAC vessels, each 5,000 pounds, are installed in series, and are followed by a pair of tertiary vessels, each 2,000 pounds, installed in parallel.

Operation of the carbon VES is currently conducted in accordance with SCAQMD Permit to Operate G12863, A/N 518989 issued on April 15, 2011. This permit was modified under A/N 568793 and a Permit to Construct was issued on March 6, 2015 to additionally allow for above ground soil treatment activities at the Site which were completed in March 2017 (see Section 1.2.5 for further details). System operational data is summarized in Tables 3A through 3C. Active SVE wells associated with the system are identified in Section 3.2 and Table 4.

1.2.3.2 Thermal Oxidizer Vapor Extraction System

A temporary thermal oxidizer VES began operation on January 8, 2018. The temporary thermal oxidizer VES was intended to treat vapors associated with the relatively high concentration SVE wells that were originally tied into the carbon VES, as discussed in SGI-Apex's May 15, 2018

Remediation Status Report - First Quarter 2018. These high concentration SVE wells were connected to the carbon VES in late June and early August 2017. Additional wells in the southern area of the Site (RW-34 through RW-50) were brought online to the temporary thermal oxidizer VES in June 2018. The system was shut down on January 8, 2019 to comply with the SCAQMD Various Locations Permit F97121 which limited the operational period to one calendar year.

The permanent full-scale thermal oxidizer VES was installed and tested shortly after the temporary VES was shut down in March 2019. The gas meter was installed in mid-February 2019, and the natural gas line was activated on February 26, 2019. The system manufacturer's service technicians (Baker Furnace) conducted the initial system equipment testing on March 4, 2019 and system startup began on March 13, 2019.

The thermal oxidizer VES operated through most of this quarter in thermal mode. Soil vapors from the thermal oxidizer VES knockout tank were heated to a minimum temperature of 1,400 degrees Fahrenheit (°F) prior to atmospheric discharge from a 25-foot tall stack. Upon installation of a new catalytic cell on March 26, 2021, soil vapors from the thermal oxidizer VES knockout tank are heated to a minimum temperature of 750°F prior to atmospheric discharge. Operation of the thermal oxidizer VES is conducted in accordance with SCAQMD Permit to Construct/Operate G52288, A/N 602424. The SCAQMD Rule 1166 notification form for SVE system startup was provided to SCAQMD on March 13, 2019. System operational data is summarized in Tables 5A through 5C. Active SVE wells associated with the thermal oxidizer systems are identified in Section 3.2 and Table 6.

1.2.4 LNAPL Removal

LNAPL removal at the Site is accomplished via both physical and automated processes. Select wells are gauged for floating product approximately once every two weeks, and product removal is conducted via manually bailing, active pumping using a portable product skimmer and/or by utilizing absorbent socks installed based on the measured LNAPL thickness in each target well.

An automated product recovery system connected to wells located in the central area of the Site has also operated since August 2016. LNAPL removal wells are identified in Sections 3.3 and 3.4 and Tables 7A through 7W. A map showing the distribution of floating product on groundwater as recorded during the second semiannual 2020 monitoring event is presented in Figure 3.

1.2.5 Above Ground Soil Treatment

Per SGI-Apex's May 1, 2015 *Remediation Status Report - First Quarter 2015*, the excavation of impacted vadose zone soils at the Site began during January 2015. Treatment was achieved via the construction of soil biopiles that were connected to the carbon VES for SCAQMD permit compliance purposes. Biopile operations, maintenance and monitoring (OM&M) continued until March 20, 2017 after a final phase of limited additional cross-trenching and excavation work with the remaining treatment cells being subsequently disconnected and brought online April 24, 2015 following the completion of above ground treatment cell construction activities.

From January 2015 through March 2017, a total estimated volume of 67,574 cubic yards of petroleum hydrocarbon contaminated soil was excavated at the Site to depths up to 35 feet below

ground surface. The goal of this remediation was to clean up source area soils that contributed to the degradation of groundwater and ready the real property of the Site for eventual conveyance. Details associated with the OM&M of the biopiles are provided in prior remediation status reports. Further details regarding treatment cell construction and excavated soil cleanup activities are provided in SGI-Apex's January 2018 *Shallow Soil Closure Report* and September 2018 *Addendum to the Shallow Soil Closure Report – Western Portion*. The LARWQCB granted a no further action (NFA) determination for the shallow soil in the upper 10 feet of the Site's eastern 15-acre parcel on April 19, 2018. The NFA determination was contingent upon declaration of covenant and environmental restriction, which was recorded on September 27, 2018. Regulatory closure of shallow soil in the western part of the Site is pending.

1.2.6 Soil Management

The LARWQCB previously approved the March 8, 2012 *Onsite Soil Management Plan* prepared and amended by Parsons Corporation (May 2012 *Response to April 10, 2012 RWQCB Comments on Onsite Soil Management Plan*). Both documents and the LARWQCB approval (February 26, 2014) specified the number of samples and analytical requirements. Soil generated from trenching and drilling operations at the Site was tested according to that approved soil management plan protocol.

2.0 OPERATIONS, MAINTENANCE AND MONITORING

OM&M of the remediation systems included the following tasks:

- Performed minimum weekly maintenance and monitoring of the GWETS, carbon VES, thermal oxidizer VES, LNAPL Recovery, and the biosparge system.
- Collected and analyzed influent and effluent vapor samples from the carbon VES and thermal oxidizer VES.
- Collected and analyzed influent and effluent groundwater samples from the GWETS.
- Performed weekly LNAPL removal from applicable wells via bailing, skimming and/or absorbent socks.
- Performed periodic gauging of wells connected to the product recovery system, along with adjusting associated pump cycle durations and frequencies to optimize LNAPL removal.
- Continued extraction efforts from wells with LNAPL and monitored for thicknesses of LNAPL sufficient to resume pumping in off-line wells.

Remediation system inspections were performed on a regular basis during operation. For these inspections, vapor flow rate, vacuum, volumes of extracted product, hours of operation, and other system parameters were recorded.

2.1 Groundwater Extraction and Treatment System

The GWETS was restarted on October 10, 2019. GWE wells pumping to the GWETS this quarter were GW-14R, GWM-31 and GW-16. System OM&M details and monthly performance results are summarized in Tables 2A, 2B and 2C.

A historical summary of influent water analytical sample results is provided in Table 8. Per the new sewer discharge permit, sampling will be conducted semiannually and quarterly (chemical oxygen demand [COD] and suspended solids [SS] only) beginning January 1, 2020.

Wells GMW-31 and GW-14R, which has had no measurable LNAPL since December 2019, were connected to the GWETS on March 11, 2020 and began operation on May 14, 2020 and May 18, 2020, respectively.

2.2 Soil Vapor Extraction Systems

The carbon VES system was restarted on November 21, 2019 upon installation of a new blower. System OM&M details and performance results are summarized in Tables 3A, 3B and 3C. Historical field photoionization detector (PID) readings from individual wells are summarized in Tables 9A through 9D; historical analytical vapor sampling results from individual wells are summarized in Table 10.

A temporary thermal oxidizer VES operated from January 8, 2018. The system was shut down on January 8, 2019 to comply with the SCAQMD Various Locations Permit which limited the operational period to one calendar year.

A permanent thermal oxidizer VES was installed and startup was conducted on March 13, 2019. System operational hours were limited to daytime hours from July to mid-August due to ongoing noise concerns from nearby residents. Sound blankets were installed in August and the thermal oxidizer began unrestricted operation (24/7) on August 26, 2019. The thermal oxidizer is intended to treat vapors associated with the relatively high concentration SVE wells that were originally tied into the carbon VES, as discussed in SGI-Apex's May 15, 2018 *Remediation Status Report - First Quarter 2018*. All such wells that have since been installed and connected as part of ongoing remediation expansion activities at the Site have been tied into the thermal oxidizer to cost-effectively accelerate the overall remediation project. Compliance and/or performance soil vapor samples from the carbon and thermal oxidizer VESs were collected in Tedlar bags during the reporting period as summarized in Tables 4 and 6. All vapor samples were delivered to Environmental Laboratory Accreditation Program (ELAP) accredited American Analytics for analysis.

The vapor samples were analyzed for the following:

- Total petroleum hydrocarbons quantified as gasoline (TPHg) using United States Environmental Protection Agency (EPA) Method 8015 Modified; and
- BTEX and MTBE using EPA Method 8260B.

Historical summaries of influent vapor analytical sampling results for the carbon VES and thermal oxidizer VES are provided in Tables 4 and 6, respectively. The laboratory analytical reports and chain-of-custody documents for the thermal oxidizer and carbon VES samples are included in Appendix A. As the Table 6 results indicate, thermal oxidizer VES concentrations have decreased allowing for the installation of the catalytic cell on March 26, 2021. Maximum gasoline range organic (GRO), benzene and MTBE concentrations this period are 5,600 micrograms per liter ($\mu\text{g/L}$), 5.8 $\mu\text{g/L}$ and non-detect (ND) $<2.0 \mu\text{g/L}$, respectively. Maximum historic levels for these constituents were previously 14,000 $\mu\text{g/L}$ for GRO (October 2019) and 21 $\mu\text{g/L}$ for benzene (August 2019). MTBE has never been detected.

2.3 Biosparge System

The biosparge wells associated with the original system are located throughout the central and eastern areas of the Site. As summarized on Table 1, several of these wells were abandoned to allow for the excavation of impacted soil from the area at or surrounding each respective well (see Sections 1.2.5 and 1.2.6) or were confirmed to be missing/destroyed during September 2016 field reconnaissance work.

Dual-nested SVE and biosparge wells RW-1 through RW-34 were installed during late June and early July 2017 with additional wells, RW-35 through RW-50 and TFB-1 through TFB-38, installed during November and December 2017 (Table 1). All of these wells were installed as part of ongoing remedial expansion activities to target impacts in the eastern area, central area, and southern area

of the Site (Figure 2) in accordance with SGI-Apex's March 14, 2017 *Well Replacement Report and Work Plan*, June 30, 2017 *Remediation Well Installation Update Report*, and July 11, 2018 *Well Installation Completion Report*.

Conveyance piping installation activities concluded in October 2018, and the system equipment assembly was completed in early December 2018. System equipment shakedown testing was conducted in mid-December 2018, and preliminary system startup occurred during the week of December 24, 2018. System operation resumed in early 2019. Biosparge operations conducted during this quarter continued in the central area, the eastern area, and the southern area wells. Biosparge system OM&M details during this quarter are provided in Tables 11A through 11C.

2.4 LNAPL Removal Via Bailing, Skimming and Absorbent Socks

Depth to product (DTP) and depth to groundwater (DTW) were measured to the nearest 0.01 foot from the top of the well casing (TOC) using an interface probe in select monitoring wells approximately every two weeks during the reporting period. LNAPL was removed from select wells via manual bailing, active pumping using a portable product skimmer and by utilizing absorbent socks. Mass and volume removal estimates using these techniques are summarized in Tables 7A and 7B along with associated LNAPL gauging results. All product is placed in an AST located within the existing treatment compound.

2.5 LNAPL Removal Via Product Recovery System

The permitting and installation of the product recovery system was completed on August 8, 2016 at which time full-scale operations commenced. At this time, the system consists of six pneumatically activated product removal pumps deployed in key wells located in the central area of the Site. Two additional pumps were procured during October 2017 in response to increasing LNAPL thickness trends from the prior quarter. In early October 2018, an additional eight product removal pumps were brought online, expanding the system capacity to allow operation of up to 16 product removal pumps simultaneously.

All pumped product is routed to an AST located within the existing treatment compound via double contained conveyance piping. The product stored in the AST is subsequently removed off-site by a licensed transport, recycling and disposal company (Appendix B). LNAPL removal is determined individually for active wells with product removal pumps based on interpolating the total volume of product collected in the AST during a given quarter and periodically measuring the volume of LNAPL recovered per cycle for each pump. A portion of the total AST product volume is assigned to each active pump based on well-specific cycle duration and frequency values which are programmed on the basis of current gauging and yield data. Product recovery system OM&M continued through the current quarter with limited operation due to the decrease in LNAPL in wells. OM&M details for all wells connected to the product recovery system during this quarter are provided in Tables 7E through 7W.

3.0 SUMMARY OF REMEDIATION PROGRESS

The following sections describe remedial progress at the Site.

3.1 Groundwater Extraction and Treatment System

The GWETS was restarted on October 10, 2019. Based on the total petroleum hydrocarbons quantified as diesel (TPHd) results for influent water samples and total groundwater extracted, an estimated 9,950 pounds of TPHd have been removed since April 1996 (Table 2C).

3.2 Soil Vapor Extraction Systems

The carbon VES system was restarted on November 21, 2019 upon installation of a new blower. Wells HW-1, HW-5, HW-7 and newly installed HW-8 and HW-9 are connected to the carbon VES system. Well HW-3 remained off-line after it was first determined to be yielding minimal flow during July 2017, and subsequently scoped and confirmed to be collapsed in two separate locations during November 2017. Flow and mass extraction testing were conducted on well HW-3 in December 2018, and results indicated very low vapor concentrations and minimal flow rate. The well was abandoned on June 7, 2019 and replaced with two new horizontal wells, HW-8 and HW-9. These two new wells were connected to the carbon VES in July 2019 (Table 9A).

Based on field photoionization detector (PID) readings (Tables 9B through 9D) and previous quarters laboratory concentrations (Table 10), the catalytic cell for the thermal oxidizer VES was installed on March 26, 2021. In preparation for installation of the catalytic cell, wells in the southern area were connected to the carbon VES system on March 19, 2021.

The total mass of VOCs removed via the carbon and the thermal oxidizer extraction systems during this period was approximately 18,235 pounds (95 pounds via the carbon VES and 18,140 pounds via the thermal oxidizer VES). An estimated 2,985,147 pounds have been removed since April 1996 (Table 3C) via the carbon VES and approximately 298,806 pounds removed via the temporary and permanent thermal oxidizer VESs since January 2018 (Table 5C). Note that the total estimated mass of VOCs removed via SVE does not account for any mass removed *in-situ* via biodegradation.

3.3 Biosparge System

Recommissioning of the biosparge system was completed during Fourth Quarter 2018, and system startup operations began in late December in the central area wells BSP-21 through BSP-24, BSP-27, BSP-25, BSP-26, BSP-28 through BSP-30; operations began in mid-April 2019 in the eastern area wells BSP-10 thru BSP-14, RW-4, RW-5, RW-9, RW-10, RW-11, RW-14, RW-18. On August 23, 2019, sparging operations were phased into the southern area wells BSP-19, BSP-20, RW-21, RW-23, RW-26, BSP-17, BSP-18, RW-30, RW-31, RW-32, RW-34, BSP-15, BSP-16, RW-19, RW-20, RW-25, and RW-28. Additional southern area wells RW-22, RW-24, RW-27, RW-29, RW-33, RW-43, RW-35, RW-38, RW-39, RW-45, RW-36, RW-37, RW-41, RW-42, RW-46, RW-47, RW-48, RW-49, and RW-50 were brought online on September 20, 2019. Additional eastern area

wells RW-1, RW-3, RW-12, and RW-13 were brought online on November 15, 2019. Additional central area wells TFB-7, TFB-9, TFB-10, TFB-11, TFB-12, TFB-13, TFB-14, TFB-1, TFB-2, TFB-4, TFB-5, TFB-6, and TFB-8 were brought online on November 18, 2019.

Central area wells TFB-21, TFB-26, TFB-27, TFB-28, TFB-31, TFB-34, TFB-16, TFB-17, TFB-20, TFB-32, TFB-36, TFB-37, and TFB-38 continue to target areas where the LNAPL plume has receded. Startup of additional inactive biosparge wells will be evaluated based on LNAPL plume trends and monitoring data collected as part of ongoing system optimization efforts.

3.4 LNAPL Gauging and Removal

During the reporting period, DTW and DTP were measured in Hollifield Park wells GMW-62, GMW-68, and on-site wells TFR-22, TFR-24, TFR-29, and RTF-18-E (Tables 7A through 7W). Overall, LNAPL thickness and removal rates decreased in First Quarter 2021.

A total of approximately 60 gallons (410 pounds) of LNAPL was removed from the Site during this quarter, and an estimated 10,357 gallons (69,961 pounds) of LNAPL has been removed since January 2014.

3.4.1 LNAPL Removal Via Bailing, Skimming and Absorbent Socks

Approximately 4 gallons (27 pounds) of LNAPL was removed via manual bailing, active pumping using a portable product skimmer and/or by utilizing absorbent socks from wells GMW-62 and GMW-68 during this reporting period (Tables 7A and 7B, respectively).

3.4.2 LNAPL Removal Via Product Recovery System

Wells TFR-9, GMW-18, TFR-12, TFR-14, TF-15, TFR-15, TF-16, GW-14R, TFR-22, TFR-24, TFR-29, and TFR-33, RTF-18-E, RTF-18-NW, RTF-18-N, TF-18, RTF-18-NNW and RTF-18-W were connected to an automated product recovery system which included 16 total active recovery pumps. Pumping resumed in well RTF-18-E in early January 2019 and was taken back off-line in late February 2019 due to insufficient yield. Pumping resumed in September 2019 and shut down again in mid-February 2020 due to insufficient yield. Well RTF-18-NNW has remained off-line due to insufficient yield since March 2018. Based on low LNAPL yields during initial testing from wells TFR-27, and GMW-45 conducted in early October 2018, skimmers have remained off-line since mid-October 2018. If LNAPL thicknesses increase, pumping may resume from these wells during the next reporting period.

Approximately 56 gallons (383 pounds) of LNAPL was pumped from wells TFR-22 and TFR-29 during this reporting period (Tables 7N and 7P).

LNAPL gauging results along with cumulative mass and volume removal estimates are summarized in Tables 7E through 7W. As the tables indicate, product thicknesses generally decreased during the current reporting period.

4.0 REMEDIATION SYSTEMS EVALUATION AND OPTIMIZATION

Remedial system optimization activities are ongoing at the Site to help ensure effective cleanup operations. For the carbon VES, vapor-phase VOC concentrations from the horizontal wells will be monitored and sampled. Continuous thermal oxidizer VES operation began on August 26, 2019 after the installation of sound blankets.

Reconfiguration of the respective vapor extraction systems will be conducted regularly to allow for cost-effective site-wide cleanup. Thus, as concentration levels in one or more currently high concentration wells decline to the point where carbon treatment becomes feasible, the well(s) will be progressively disconnected from the thermal oxidizer VES and tied into the carbon VES.

SGI-Apex will continue to monitor individual well influent vapor concentrations associated with each existing VES and modify which extraction wells are online along with adjusting respective valve positions, as necessary.

Per the non-detect, stable, or declining dissolved groundwater analytical data from off-site wells (as illustrated in previous semiannual groundwater monitoring reports) and from the previous aquifer pump testing and groundwater capture zone analysis, the current GWETS with wells in the eastern area, along with natural attenuation, has been successful in preventing further impacted groundwater from flowing off-site, and has captured and treated a significant portion of impacted groundwater under Holifield Park.

GWE in the central area from wells GMW-31 and GW-14R and in the eastern area from well GW-16 will continue to assist with containment until further evaluation of natural attenuation is conducted. Additionally, absorbent sock installation and LNAPL recovery via pumping and/or manual bailing will continue along with full-scale OM&M of the product recovery system. Currently, wells TFR-22 and TFR-29 are the only active pumping wells.

Up-to-date gauging data will continue to be collected during the next reporting period with rotating recovery operations being implemented on the basis of ongoing performance data. If warranted by the data, pumping will also resume in any locations where it was previously conducted.

For all active pumping wells, adjustments will continue to be made to the associated extraction frequency and duration of each pump cycle to help maximize LNAPL yields without isolating the well from the product plume. Future adjustments to all such wells may also be made on the basis of periodic bail down testing conducted to establish current transmissivity values for correlating apparent to actual product thicknesses.

Biosparging operations will be optimized to enhance volatilization and biodegradation in impacted areas and will expand to target areas where the LNAPL plume has receded. Periodic collection of pressure response and field parameters data from monitoring wells within the treatment zone will be used to optimize operations and confirm the biosparging zone of influence. Additionally, the LNAPL gauging data will be used to evaluate whether scaling back biosparging operations in some areas is necessary to minimize the risk of mobilizing the LNAPL plume via groundwater mounding.

5.0 PLANNED SECOND QUARTER 2021 ACTIVITIES

During the next reporting period, DLA plans to continue to focus in-situ remedial efforts on the central area, eastern area, and southern area of the Site. Following is a summary of planned Second Quarter 2021 OM&M activities:

- Continue minimum weekly maintenance and monitoring of the thermal oxidizer VES. Tasks include measuring individual well vapor concentrations with an organic vapor analyzer (OVA) and collecting/analyzing monthly influent and effluent vapor samples.
- Collect individual extraction well vapor samples for laboratory analysis as needed. Vapor samples will be collected from horizontal wells and extraction wells.
- Continue regular LNAPL gauging and removal activities (as applicable), including wells GWM-62 and GMW-68 (both located off-site in Holifield Park), GMW-7, TF-19, and product recovery system wells TFR-9, GMW-18, TFR-12, TF-15, TFR-14, TFR-15, TF-16, GW-14R, TFR-18, TFR-22, TFR-24, TFR-29, TFR-33, RTF-18-E, RTF-18-NW, RTF-18-N, RTF-18-NNW, RTF-18-W, TF-18, TFR-27, and GMW-45.
- Gauge wells TFR-17, TFR-19, TFR-32, TFR-30, TFR-5, TFR-7, TFR-21, and TFR-26 periodically as SVE is applied (via the thermal oxidizer VES) in order to evaluate any appearance and/or increase in LNAPL thicknesses and the potential for active/passive product recovery.
- Continue controlled product recovery system OM&M from wells TFR-22 and TFR-29, located in the central area of the Site.
- Continue to utilize the carbon VES for focused extraction from the relatively low concentration SVE wells to allow for reasonable carbon usage rates while achieving comprehensive site-wide vadose zone cleanup in conjunction with the new permanent thermal oxidizer VES (i.e., treatment of both relatively high and low concentration wells via the simultaneous use of both vapor abatement technologies).
- Continue the permanent thermal oxidizer VES operations to cost-effectively process moderate vapor concentration (catalytic mode from approximately 500 ppm to 3,000 ppm) well flows, with any remaining low concentration (less than approximately 500 ppm) well flows being more cost-effectively treated via the existing carbon VES .
- Continue to evaluate influent vapor concentrations to the thermal oxidizer VES after installation of the catalytic cell.
- Continue minimum weekly maintenance and monitoring of the GWETS operations and collect groundwater samples for laboratory analysis as required by the sewer discharge permit.
- Continue to evaluate GWE flow rates and confirm contaminant containment.

Ongoing remediation activities and progress will be described in the *Second Quarter 2021 Remediation Progress Report* to be submitted by August 15, 2021.


6.0 LIMITATIONS

This document was prepared for the exclusive use of the DLA and the LARWQCB for the express purpose of complying with a client or regulatory directive for environmental investigation or restoration. SGI-Apex and DLA must approve any re-use of this work product in whole or in part for a different purpose or by others in writing. If any such unauthorized use occurs, it shall be at the user's sole risk without liability to SGI-Apex or DLA.

To the extent that this report is based on information provided to SGI-Apex by third parties, including DLA, their direct contractors, previous personnel, and other stakeholders, SGI-Apex cannot guarantee the completeness or accuracy of this information, even where efforts were made to verify third-party information. SGI-Apex has exercised professional judgment to collect and present findings and opinions of a scientific and technical nature. The opinions expressed are based on the conditions of the Site existing at the time of the field investigation, current regulatory requirements, and any specified assumptions.

The presented findings and recommendations in this report are intended to be taken in their entirety to assist DLA and LARWQCB personnel in applying their own professional judgment in making decisions related to the property. SGI-Apex cannot provide conclusions on environmental conditions outside the completed scope of work. SGI-Apex cannot guarantee that future conditions will not change and affect the validity of the presented conclusions and recommended work. No warranty or guarantee, whether expressed or implied, is made with respect to the data or the reported findings, observations, conclusions, and recommendations.

FIGURES

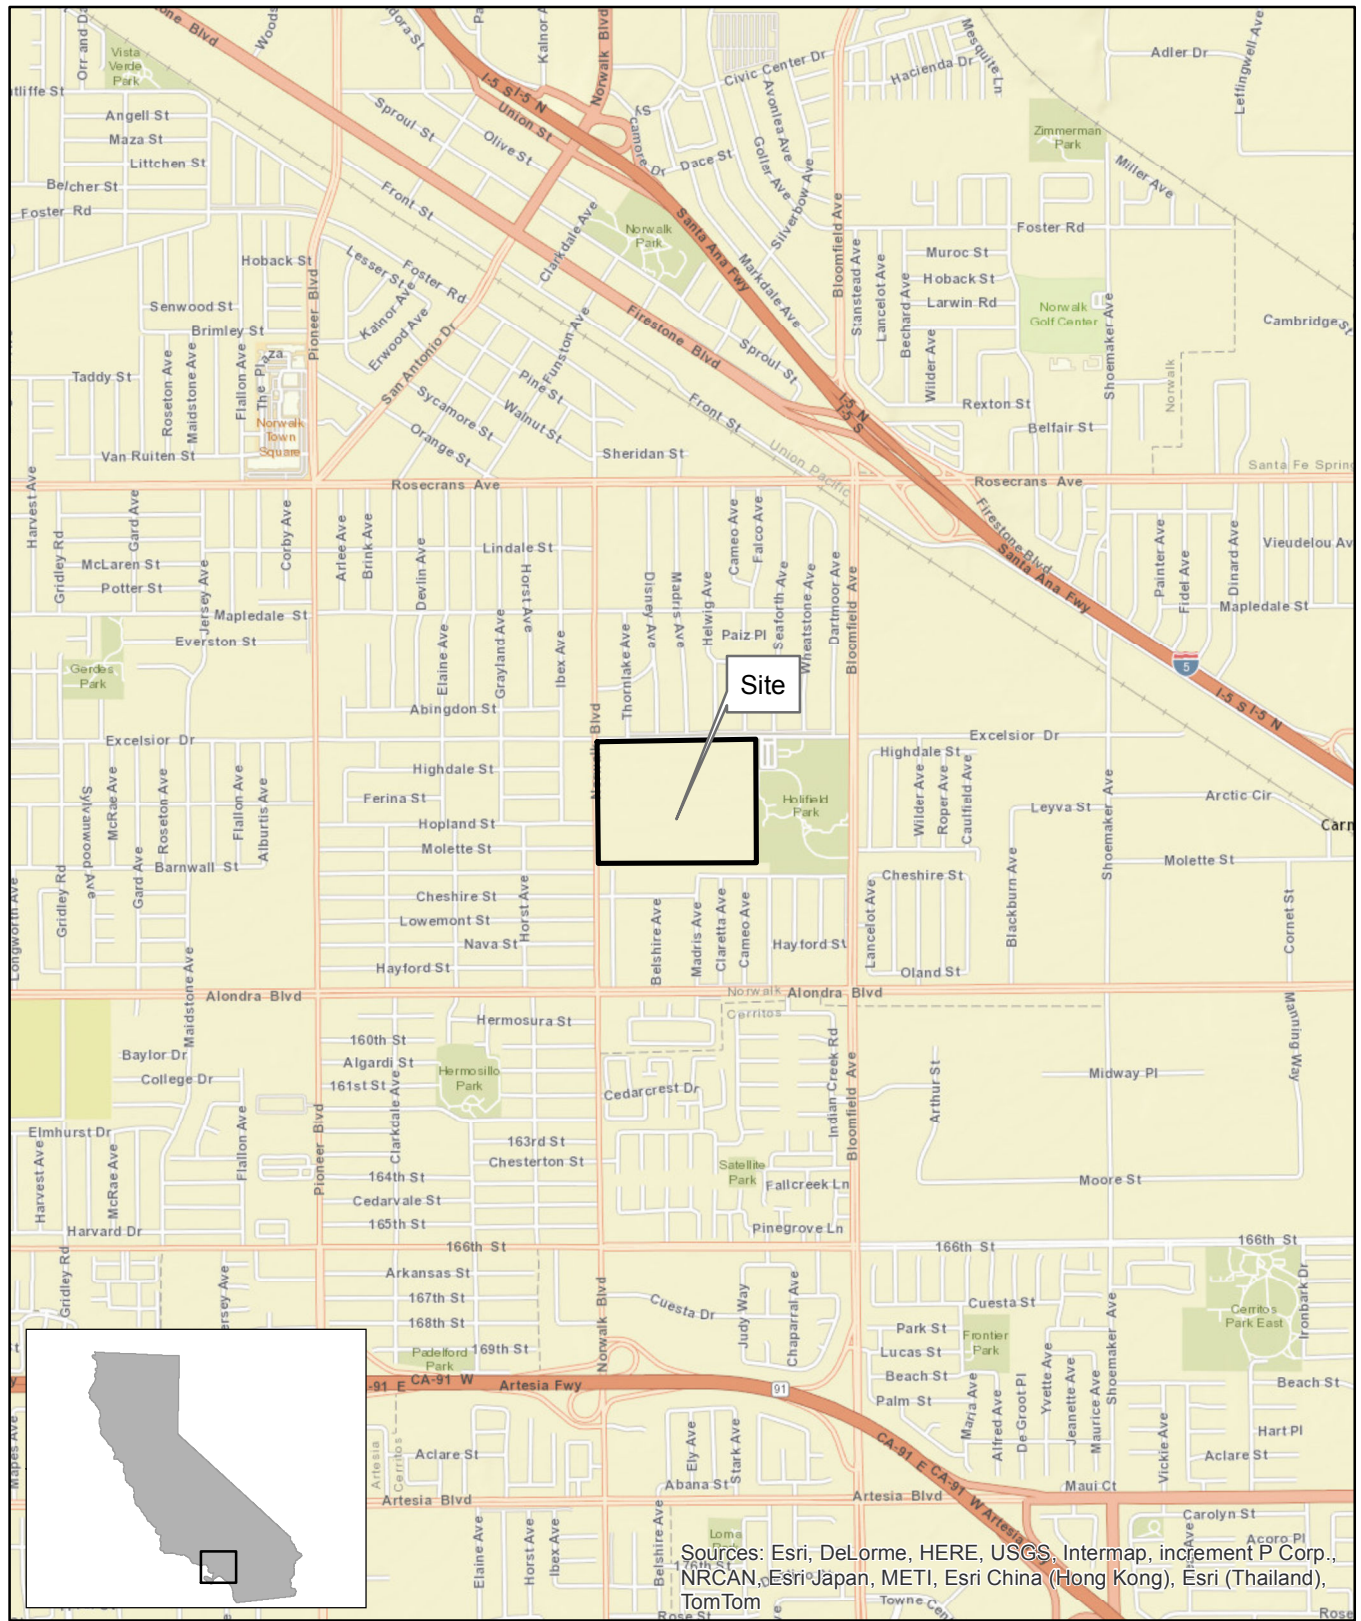

Sources: Esri, DeLorme, HERE, USGS, Intermap, increment P Corp., NRCAN, Esri Japan, METI, Esri China (Hong Kong), Esri (Thailand), TomTom

SOURCE:
 ESRI 7.5 MINUTE TOPOGRAPHIC MAP.
<http://resources.esri.com/arcgisonline/services>

PROJECT NO.:	DATE:	DR. BY:	APP. BY:
04-NDLA-003	5/28/2014	JK	PP

SCALE= 1:24,000



1962 FREEMAN AVENUE SIGNAL HILL, CA 90755
 (562) 597-1055

**DEFENSE FUEL SUPPORT POINT
 NORWALK**
 15306 NORWALK BOULEVARD
 NORWALK, CALIFORNIA


SITE LOCATION MAP

FIGURE
1








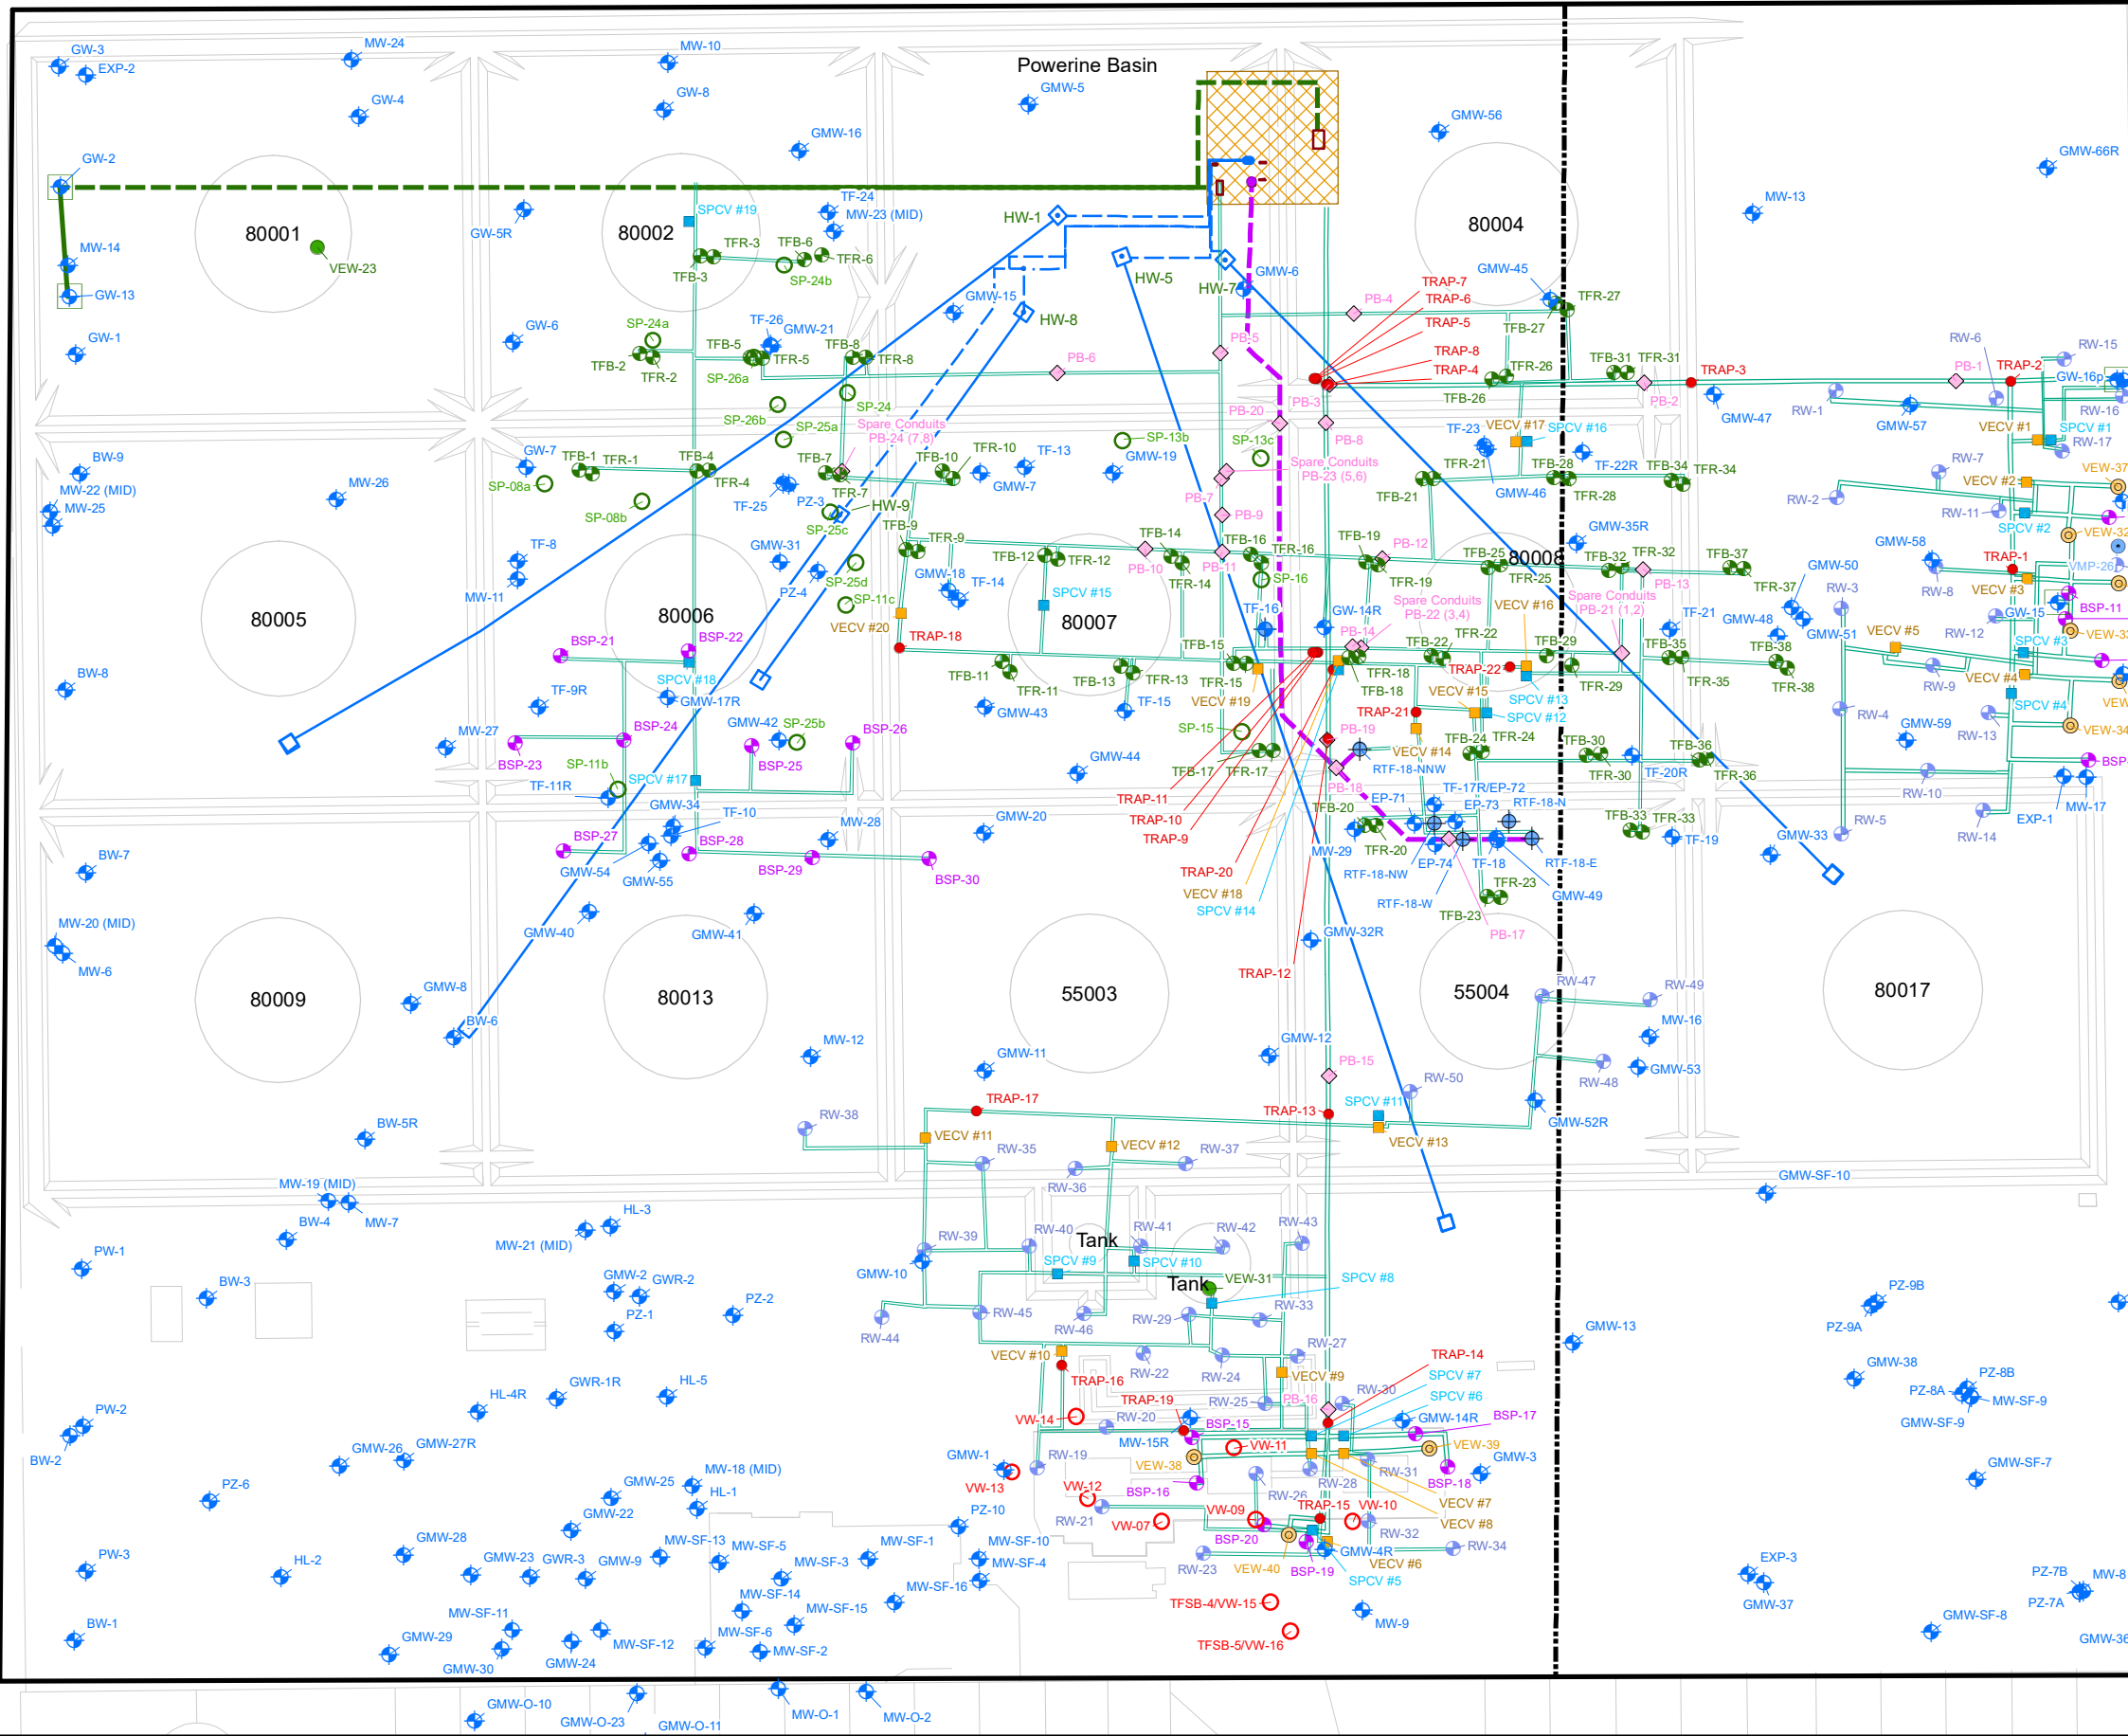

















Excelsior Dr

Powerline Basin

Norwalk Blvd



Legend


-  Former Above Ground Storage Tanks
-  DFSP Norwalk Border
-  Fence
-  Berm
-  Treatment System Enclosure
-  Below Grade Trenching and Piping to Remediation Wells
-  Existing Horizontal Vapor Extraction Wells
-  Below Grade Groundwater Extraction System Piping
-  Above Grade Groundwater Extraction System Piping
-  Product Recovery System Piping
-  Horizontal Vapor Extraction System Piping
-  Western Boundary of Eastern 15-Acre Parcel
-  System Manifold within Treatment Enclosure
-  Total Fluid and Groundwater Monitoring Wells
-  TF-18 Area LNAPL Recovery Wells
-  Biosparging Wells
-  Vapor Extraction Wells (November 2016)
-  Biosparging and Vapor Extraction Wells
-  Co-Located Total Fluid and Biosparge Wells
-  Vapor Extraction Wells (2004)
-  Sparging Points (August 2004)
-  Pull Box (for Wire or Tubing)
-  PVC Condensate Trap for Vapor Extraction Piping
-  Vapor Extraction System Control Vaults
-  Biosparge System Control Vaults



DFSP Norwalk

15306 Norwalk Boulevard
Norwalk, California

Project Number:	Date:	Drawn By:	Approved By:
091-NDLA-026	01/15/2019	PW / SM	BT




Site Map Showing All Well and Piping Locations



1962 Freeman Avenue Signal Hill, CA 90755
(562) 597-1055

Figure
2

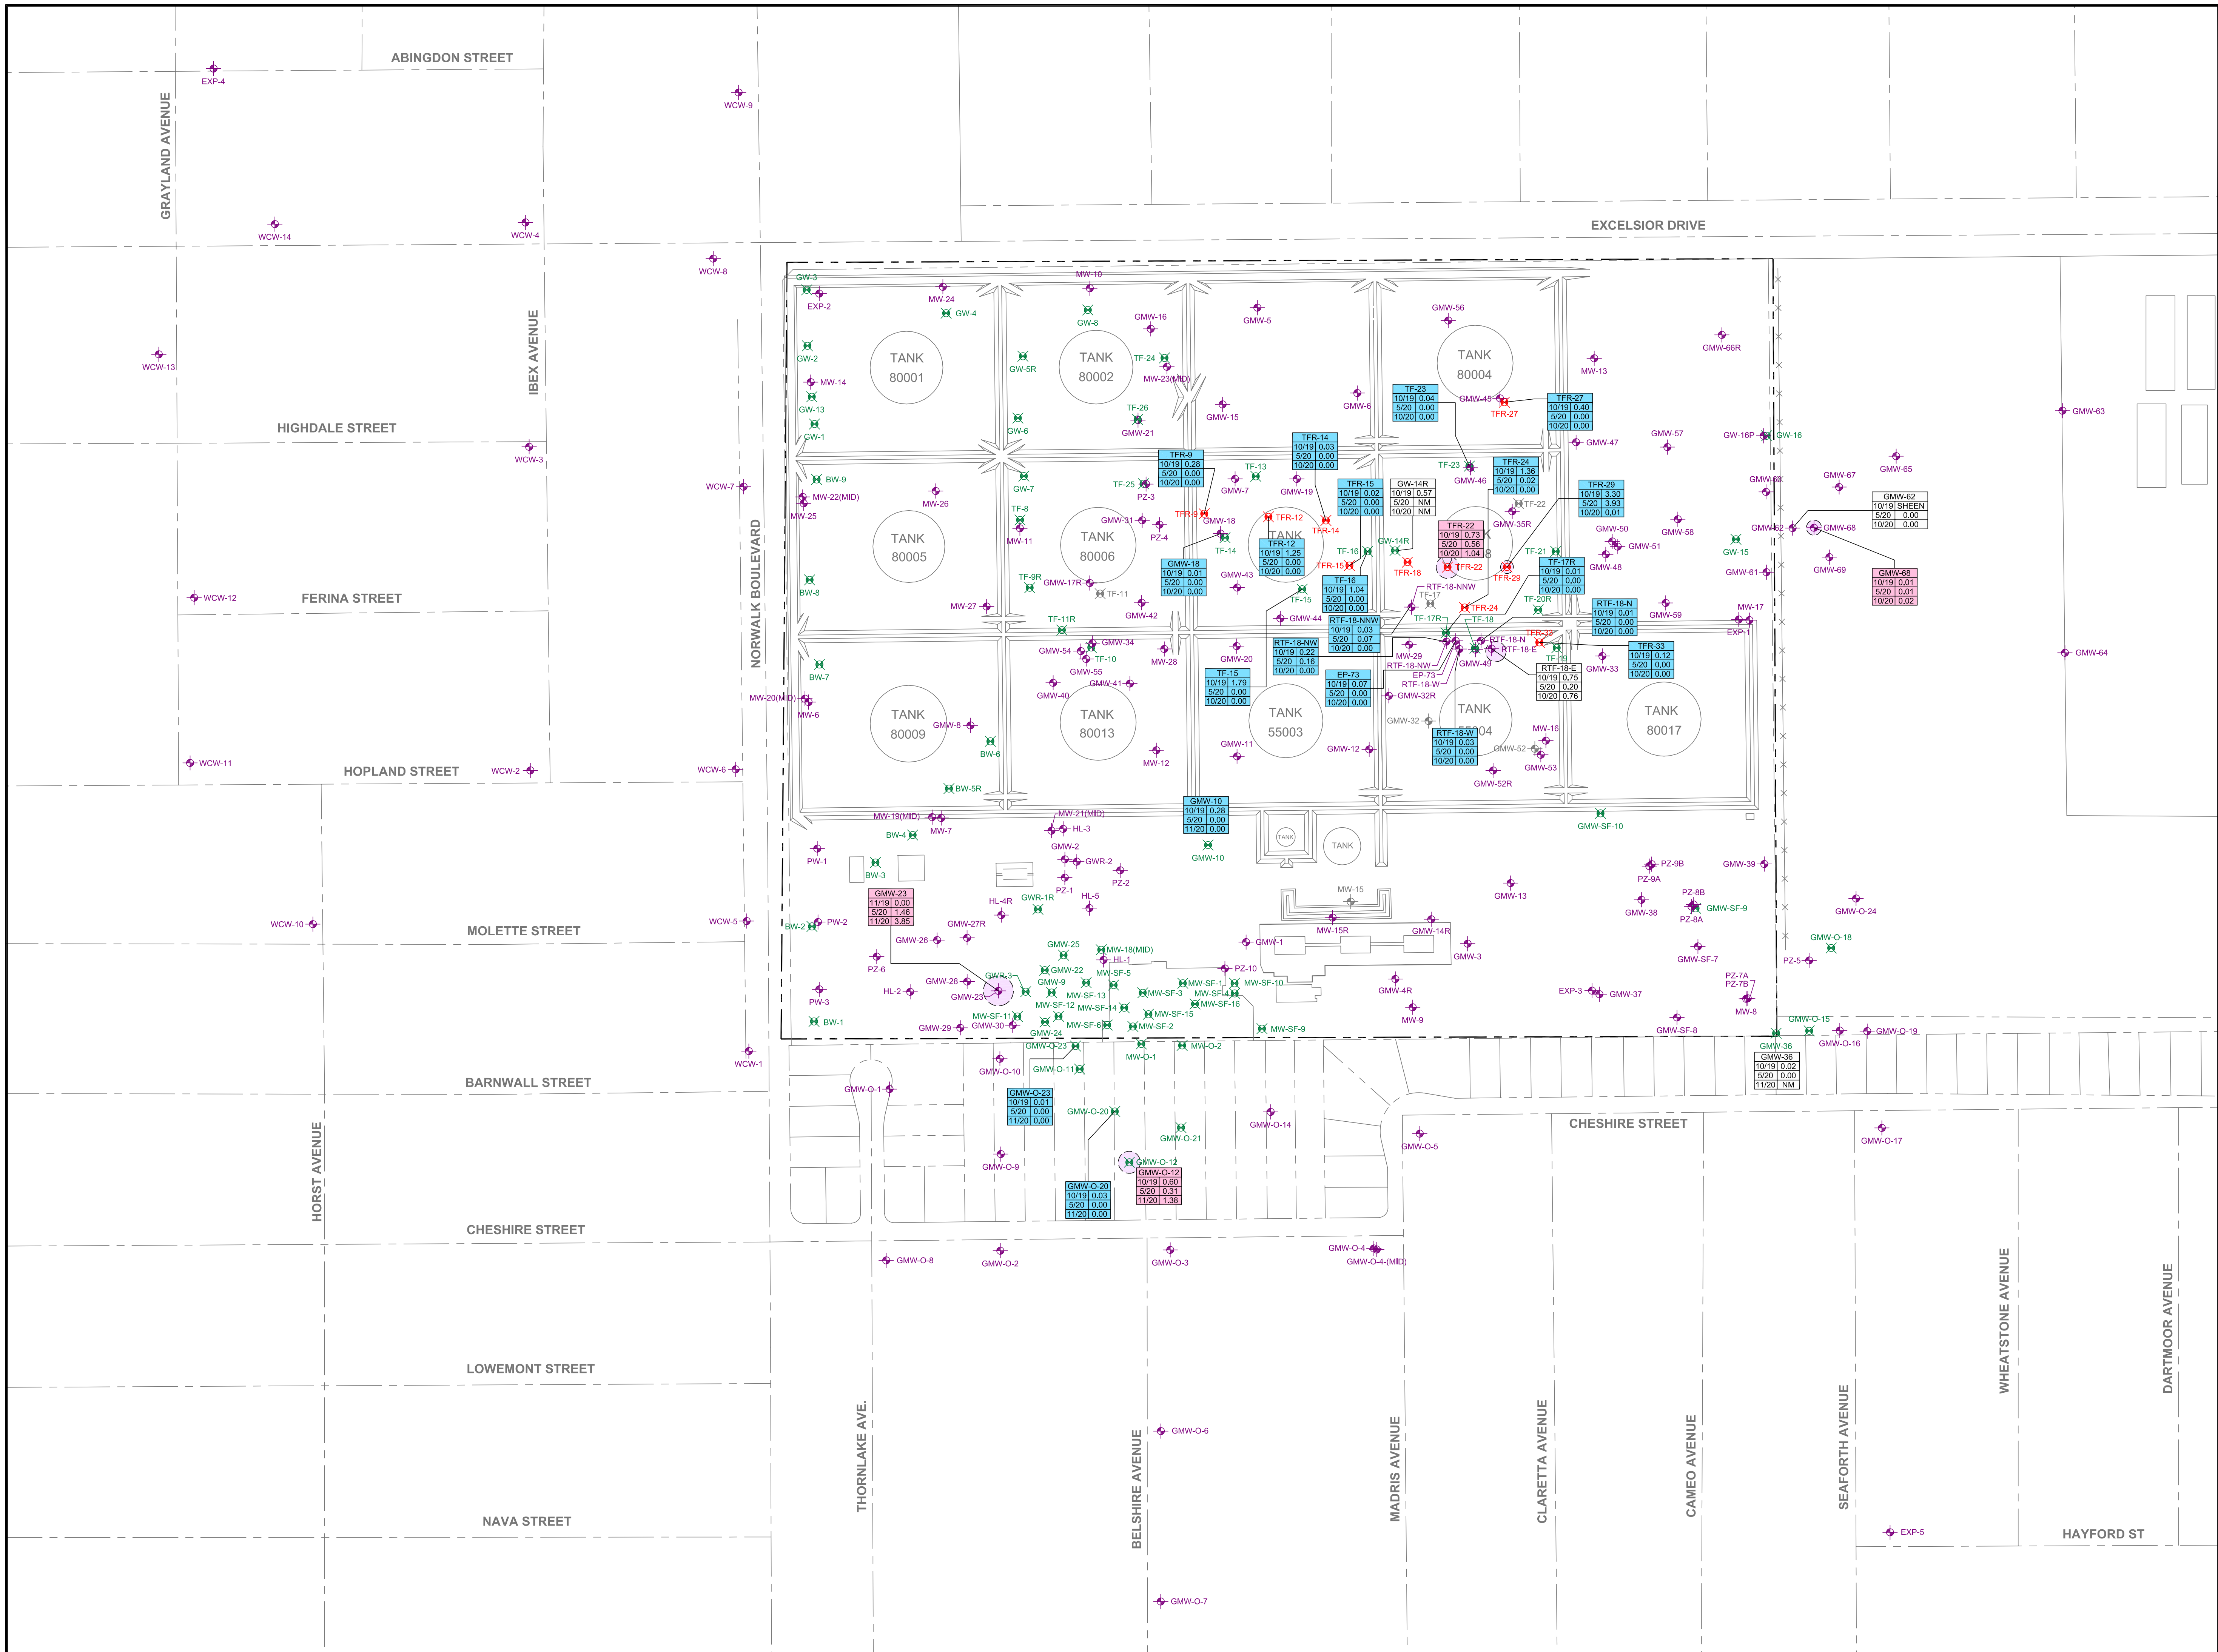


EXPLANATION:

- FORMER ABOVEGROUND STORAGE TANKS
 - DFSP NORWALK BORDER
 - GROUNDWATER MONITORING WELL
 - TOTAL FLUIDS RECOVERY WELL
 - WELLS SHOWN IN GREY WERE DECOMMISSIONED BY DLA ENERGY PRIOR TO REMEDIAL EXCAVATION
 - EXTRACTION WELL USED FOR VAPOR, GROUNDWATER, TOTAL FLUIDS, OR FLOATING PRODUCT EXTRACTION
- MEASURED PRODUCT THICKNESS IN FEET FOR THE THREE MOST RECENT SEMI-ANNUAL EVENTS; WHERE THE DATASET IS SHOWN IN WHITE, THE MEASURED THICKNESS HAS REMAINED SIMILAR (CHANGE IS LESS THAN 10%) AT THAT LOCATION SINCE THE FALL 2019 SEMI-ANNUAL MONITORING EVENT, OR THE DATASET SHOWN DOES NOT PROVIDE A BASIS FOR COMPARISON
- WHERE THE DATASET IS SHOWN IN RED, THE MEASURED PRODUCT THICKNESS HAS INCREASED BY 10% OR MORE AT THAT LOCATION SINCE THE FALL 2019 SEMI-ANNUAL MONITORING EVENT
- WHERE THE DATASET IS SHOWN IN BLUE, THE MEASURED PRODUCT THICKNESS HAS DECREASED BY 10% OR MORE AT THAT LOCATION SINCE THE FALL 2019 SEMI-ANNUAL MONITORING EVENT
- NM NOT MEASURED
- ESTIMATED EXTENT OF MEASURABLE LIGHT NONAQUEOUS PHASE LIQUID (LNAPL, FLOATING PRODUCT) ON GROUNDWATER

SURVEY NOTES:

1. BASE MAP PREPARED FROM DATA PROVIDED BY FLUOR DANIEL GTI, DULIN & BOYNTON, GEOMATRIX, AND PARSONS
2. EXCEPT AS NOTED BELOW, WELL LOCATIONS SURVEYED BY DULIN & BOYNTON
3. LOCATIONS OF WELLS HL-1, HL-3, AND HL-4 BASED ON FIELD MEASUREMENTS BY FLUOR DANIEL GTI AND WOODWARD-CLYDE

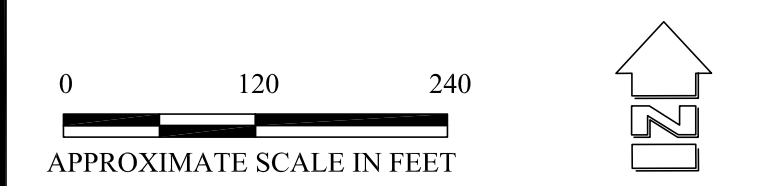

DATE: 01/2021	FILE NAME: DFSP-Norwalk-SE2-20.dwg
PROJECT No.: 091-NOR-001	CONTRACT: SPO-600-14-D-5410

DISTRIBUTION OF FLOATING PRODUCT ON GROUNDWATER SECOND SEMI-ANNUAL 2020 MONITORING EVENT

DFSP NORWALK
15306 NORWALK BOULEVARD
NORWALK, CALIFORNIA

TABLES

TABLE 1
Remediation Well Summary
 DFSP Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Remediation Area	Location	Well	Notes	Installation Date	Casing Elevation (ft msl)	Total Depth (ft bgs)	Screen Interval (ft bgs)	Remediation Well Function
Central Area	Northwest Corner (AST 80001)	GW-1		06/12/95	75.97	63	25 - 60	GWE
		GW-2		06/12/95	75.78	63	25 - 60	GWE
		GW-3		06/13/95	75.79	63	25 - 60	GWE
		GW-4		06/12/95	75.78	63	25 - 60	GWE
		GW-13		04/26/07	76.85	67	25 - 65	GWE
		VEW-23		08/03/04	76.20	25	15 - 25	SVE
Central Area	North (AST 80002, AST 80004, AST 80006, AST 80007, AST 80008, AST 80001, AST 55004)	VEW-22	16	--	--	25	15 - 25	SVE
		HW-1	14	--	--	25	Continuous	SVE
		HW-3	14, 17, 18	--	--	25	Continuous	SVE
		HW-5	14	--	--	25	Continuous	SVE
		HW-7	14	--	--	25	Continuous	SVE
		HW-8	19	06/07/19	--	30	60	SVE
		HW-9	19	06/07/19	--	29	220	SVE
		GMW-21	1	08/02/91	76.23	50	25 - 50	TFE/GWE
		GMW-31		06/02/93	76.50	65	25 - 50	GWE
		GW-14R	2	11/08/16	78.77	50	25 - 50	GWE
		SP8a	15	--	--	50	48 - 50	Biosparge
		SP-8b	15	--	--	50	48 - 50	Biosparge
		SP-11b	15	--	--	50	48 - 50	Biosparge
		SP-11c	15	--	--	50	48 - 50	Biosparge
		SP-13b	3, 15	--	--	50	48 - 50	Biosparge
		SP-13c	15	--	--	50	48 - 50	Biosparge
		SP-15	4, 15	--	--	50	48 - 50	Biosparge
		SP-16	15	--	--	50	48 - 50	Biosparge
		SP-24	15	--	--	50	48 - 50	Biosparge
		SP-24a	15	--	--	50	48 - 50	Biosparge
		SP-24b	15	--	--	50	48 - 50	Biosparge
		SP-25a	15	--	--	50	48 - 50	Biosparge
		SP-25b	15	--	--	50	48 - 50	Biosparge
		SP-25c	15	--	--	50	48 - 50	Biosparge
		SP-25d	15	--	--	50	48 - 50	Biosparge
		SP-26	15	--	--	50	48 - 50	Biosparge
		SP-26a	15	--	--	50	48 - 50	Biosparge
		TF-8		09/22/95	74.86	63	25 - 60	TFE, GWE
		TF-9	5	09/22/95	74.47	63	25 - 60	TFE, GWE
		TF-10		09/25/95	73.61	63	25 - 60	TFE, GWE
TF-11	5	09/25/95	74.40	63	25 - 60	TFE, GWE		
TF-13		09/26/95	75.47	63	25 - 60	TFE, GWE		

TABLE 1
Remediation Well Summary
DFSP Norwalk
15306 Norwalk Blvd., Norwalk, CA

Remediation Area	Location	Well	Notes	Installation Date	Casing Elevation (ft msl)	Total Depth (ft bgs)	Screen Interval (ft bgs)	Remediation Well Function
Central Area	North (AST 80002, AST 80004, AST 80006, AST 80007, AST 80008, AST 80001, AST 55004)	TF-14		09/27/95	74.35	63	25 - 60	TFE, GWE
		TF-15		09/28/95	74.78	63	25 - 60	TFE, GWE
		TF-16		09/28/95	75.89	63	25 - 60	TFE, GWE
		TF-17	6	09/29/95	74.88	63	25 - 60	TFE, GWE
		TF-18		07/06/94	73.75	50.5	20 - 50	TFE, GWE
		TF-19		10/03/95	75.07	63	25 - 60	TFE, GWE
		TF-20	7	10/03/95	75.08	63	25 - 60	TFE, GWE
		TF-21		09/29/95	74.96	63	25 - 60	TFE, GWE
		TF-22	8	10/02/95	74.76	63	25 - 60	TFE, GWE
Central Area	North (AST 80002, AST 80006, AST 80008, AST 55004)	TF-23		07/05/94	75.31	50.5	20 - 50	TFE, GWE
		TF-24	9	09/26/95	76.43	63	25 - 60	TFE, GWE
		TF-25		04/04/01	74.85	47	26 - 36	TFE, GWE
		TF-26		04/03/01	75.85	47	26 - 36	TFE, GWE
		RTF-18-N		12/28/15	75.17	40	25 - 40	TFE, GWE
		RTF-18-E		12/28/15	75.19	40	25 - 40	TFE, GWE
		RTF-18-W		12/28/15	74.86	40	25 - 40	TFE, GWE
		RTF-18-NW		12/29/15	76.22	40	25 - 40	TFE, GWE
		RTF-18-NNW		12/29/15	76.77	40	25 - 40	TFE, GWE
Central Area	North (AST 80002, AST 80004, AST 80006, AST 80007, AST 80008, AST 80013, AST 55003, AST 55004)	BSP-21	10	12/07/17	--	46	43 - 45	Biosparge
		BSP-22	10	12/07/17	--	46	43 - 45	Biosparge
		BSP-23	10	12/08/17	--	46	43 - 45	Biosparge
		BSP-24	10	12/07/17	--	46	43 - 45	Biosparge
		BSP-25	10	12/08/17	--	46	43 - 45	Biosparge
		BSP-26	10	12/08/17	--	46	43 - 45	Biosparge
		BSP-27	10	12/07/17	--	46	43 - 45	Biosparge
		BSP-28	10	12/07/17	--	46	43 - 45	Biosparge
		BSP-29	10	12/08/17	--	46	43 - 45	Biosparge
		BSP-30	10	12/11/17	--	46	43 - 45	Biosparge
		TFR-1	10	12/13/17	--	40	20 - 40	TFE, SVE
		TFR-2	10	12/12/17	--	40	20 - 40	TFE, SVE
		TFR-3	10	12/12/17	--	40	20 - 40	TFE, SVE
		TFR-4	10	12/13/17	--	40	20 - 40	TFE, SVE
		TFR-5	10	12/12/17	--	40	20 - 40	TFE, SVE
		TFR-6	10	12/12/17	--	40	20 - 40	TFE, SVE
		TFR-7	10	12/13/17	--	40	20 - 40	TFE, SVE
		TFR-8	10	12/12/17	--	40	20 - 40	TFE, SVE
TFR-9	10	12/13/17	--	40	20 - 40	TFE, SVE		
TFR-10	10	12/11/17	--	40	20 - 40	TFE, SVE		

TABLE 1
Remediation Well Summary
 DFSP Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Remediation Area	Location	Well	Notes	Installation Date	Casing Elevation (ft msl)	Total Depth (ft bgs)	Screen Interval (ft bgs)	Remediation Well Function
Central Area	North (AST 80002, AST 80004, AST 80006, AST 80007, AST 80008, AST 80013, AST 55003, AST 55004)	TFR-11	10	12/11/17	--	40	20 - 40	TFE, SVE
		TFR-12	10	12/11/17	--	40	20 - 40	TFE, SVE
		TFR-13	10	12/15/17	--	40	20 - 40	TFE, SVE
		TFR-14	10	12/13/17	--	40	20 - 40	TFE, SVE
		TFR-15	10	12/14/17	--	40	20 - 40	TFE, SVE
		TFR-16	10	12/14/17	--	40	20 - 40	TFE, SVE
		TFR-17	10	12/14/17	--	40	20 - 40	TFE, SVE
		TFR-18	10	12/14/17	--	40	20 - 40	TFE, SVE
		TFR-19	10	12/12/17	--	40	20 - 40	TFE, SVE
		TFR-20	10	12/15/17	--	40	20 - 40	TFE, SVE
		TFR-21	10	12/11/17	--	40	20 - 40	TFE, SVE
		TFR-22	10	11/30/17	--	40	20 - 40	TFE, SVE
		TFR-23	10	11/29/17	--	40	20 - 40	TFE, SVE
		TFR-24	10	11/30/17	--	40	20 - 40	TFE, SVE
		TFR-25	10	11/30/17	--	40	20 - 40	TFE, SVE
		TFR-26	10	11/29/17	--	40	20 - 40	TFE, SVE
		TFR-27	10	11/29/17	--	40	20 - 40	TFE, SVE
		TFR-28	10	11/29/17	--	40	20 - 40	TFE, SVE
		TFR-29	10	11/29/17	--	40	20 - 40	TFE, SVE
		TFR-30	10	11/29/17	--	40	20 - 40	TFE, SVE
		TFR-31	10	11/29/17	--	40	20 - 40	TFE, SVE
		TFR-32	10	11/30/17	--	40	20 - 40	TFE, SVE
		TFR-33	10	11/28/17	--	40	20 - 40	TFE, SVE
		TFR-34	10	11/28/17	--	40	20 - 40	TFE, SVE
		TFR-35	10	11/29/17	--	40	20 - 40	TFE, SVE
		TFB-1	10	12/06/17	--	46	43 - 45	Biosparge
		TFB-2	10	12/05/17	--	46	43 - 45	Biosparge
		TFB-3	10	12/05/17	--	46	43 - 45	Biosparge
		TFB-4	10	12/06/17	--	46	43 - 45	Biosparge
		TFB-5	10	12/06/17	--	46	43 - 45	Biosparge
		TFB-6	10	12/05/17	--	46	43 - 45	Biosparge
		TFB-7	10	12/06/17	--	46	43 - 45	Biosparge
		TFB-8	10	12/05/17	--	46	43 - 45	Biosparge
		TFB-9	10	12/04/17	--	46	43 - 45	Biosparge
		TFB-10	10	12/04/17	--	46	43 - 45	Biosparge
TFB-11	10	12/04/17	--	50	48 - 50	Biosparge		
TFB-12	10	12/01/17	--	46	43 - 45	Biosparge		
TFB-13	10	12/01/17	--	46	43 - 45	Biosparge		

TABLE 1
Remediation Well Summary
 DFSP Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Remediation Area	Location	Well	Notes	Installation Date	Casing Elevation (ft msl)	Total Depth (ft bgs)	Screen Interval (ft bgs)	Remediation Well Function		
Central Area	North (AST 80002, AST 80004, AST 80006, AST 80007, AST 80008, AST 80013, AST 55003, AST 55004)	TFB-14	10	11/30/17	--	46	43 - 45	Biosparge		
		TFB-15	10	11/27/17	--	46	43 - 45	Biosparge		
		TFB-16	10	11/28/17	--	46	43 - 45	Biosparge		
		TFB-17	10	11/28/17	--	46	43 - 45	Biosparge		
		TFB-18	10	11/27/17	--	46	43 - 45	Biosparge		
		TFB-19	10	11/28/17	--	46	43 - 45	Biosparge		
		TFB-20	10	11/30/17	--	46	43 - 45	Biosparge		
		TFB-21	10	11/27/17	--	46	43 - 45	Biosparge		
		TFB-22	10	11/27/17	--	46	43 - 45	Biosparge		
		TFB-23	10	11/28/17	--	46	43 - 45	Biosparge		
		TFB-24	10	11/27/17	--	46	43 - 45	Biosparge		
		TFB-25	10	11/27/17	--	46	43 - 45	Biosparge		
		TFB-26	10	11/22/17	--	46	43 - 45	Biosparge		
		TFB-27	10	11/21/17	--	46	43 - 45	Biosparge		
		TFB-28	10	11/22/17	--	46	43 - 45	Biosparge		
		TFB-29	10	11/27/17	--	46	43 - 45	Biosparge		
		TFB-30	10	11/27/17	--	46	43 - 45	Biosparge		
		TFB-31	10	11/21/17	--	46	43 - 45	Biosparge		
		TFB-32	10	11/22/17	--	46	43 - 45	Biosparge		
		TFB-33	10	11/27/17	--	46	43 - 45	Biosparge		
		TFB-34	10	11/21/17	--	46	43 - 45	Biosparge		
		TFB-35	10	11/27/17	--	46	43 - 45	Biosparge		
				RW-35	10	11/15/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
				RW-36	10	11/15/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
				RW-37	10	11/16/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
				RW-38	10	11/16/17	--	33 / 47	13 - 33 / 44 - 46	SVE / Biosparge
		RW-47	10	11/17/17	--	33 / 47	13 - 33 / 44 - 46	SVE / Biosparge		
		RW-48	10	11/17/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge		
		RW-49	10	11/16/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge		
		RW-50	10	11/20/17	--	33 / 47	13 - 33 / 44 - 46	SVE / Biosparge		
Eastern Area	North	BSP-1	11	04/18/07	--	50	47 - 49	Biosparge		
		BSP-2	11	04/18/07	--	50	48 - 50	Biosparge		
		BSP-3	11	04/17/07	--	48	46 - 48	Biosparge		
		BSP-4	11	04/17/07	--	49	47 - 49	Biosparge		
		BSP-5	11	04/17/07	--	49.5	47 - 49	Biosparge		
		BSP-6	11	04/18/07	--	49	47 - 49	Biosparge		
		BSP-7	11	04/19/07	--	48	46 - 48	Biosparge		
		BSP-8	11	04/19/07	--	48	46 - 48	Biosparge		

TABLE 1
Remediation Well Summary
 DFSP Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Remediation Area	Location	Well	Notes	Installation Date	Casing Elevation (ft msl)	Total Depth (ft bgs)	Screen Interval (ft bgs)	Remediation Well Function
Eastern Area	North	BSP-9	11	04/19/07	--	48	46 - 48	Biosparge
		BSP-10	12	11/04/16	--	46.5	44 - 46	Biosparge
		BSP-11	12	11/04/16	--	40	38 - 40	Biosparge
		BSP-12	12	11/04/16	--	46.5	44 - 46	Biosparge
		BSP-13	12	11/07/16	--	46.5	44 - 46	Biosparge
		BSP-14	12	11/07/16	--	46.5	44 - 46	Biosparge
		GMW-58		08/14/98	75.48	55	20 - 55	GWE
		GW-15		04/26/07	74.94	60.5	20.5 - 60.6	GWE
		GW-16		07/07/09	76.33	63	20.5 - 60.5	GWE
		RW-1	13	06/21/17	-- / --	35 / 46	15 - 35 / 43 - 45	SVE / Biosparge
		RW-2	13	06/21/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-3	13	06/21/17	--	37 / 46	17 - 37 / 43 - 45	SVE / Biosparge
		RW-4	13	06/22/17	--	34 / 46	14 - 34 / 43 - 45	SVE / Biosparge
		RW-5	13	06/22/17	--	34 / 46	14 - 34 / 43 - 45	SVE / Biosparge
		RW-6	13	06/27/17	--	37 / 46	17 - 37 / 43 - 45	SVE / Biosparge
		RW-7	13	06/26/17	--	37 / 46	17 - 37 / 43 - 45	SVE / Biosparge
		RW-8	13	06/28/17	--	38.5 / 46	18.5 - 38.5 / 43 - 45	SVE / Biosparge
		RW-9	13	06/26/17	--	35 / 46	15 - 35 / 43 - 45	SVE / Biosparge
		RW-10	13	06/22/17	--	34 / 46	14 - 34 / 43 - 45	SVE / Biosparge
		RW-11	13	06/26/17	--	36 / 46	16 - 36 / 43 - 45	SVE / Biosparge
		RW-12	13	06/23/17	--	34 / 46	14 - 34 / 43 - 45	SVE / Biosparge
		RW-13	13	06/23/17	--	35 / 46	15 - 35 / 43 - 45	SVE / Biosparge
		RW-14	13	06/23/17	--	34 / 46	14 - 34 / 43 - 45	SVE / Biosparge
		RW-15	13	06/20/17	--	38 / 46	18 - 38 / 43 - 45	SVE / Biosparge
		RW-16	13	06/20/17	--	34 / 46	14 - 34 / 43 - 45	SVE / Biosparge
		RW-17	13	06/27/17	--	39 / 46	19 - 39 / 43 - 45	SVE / Biosparge
		RW-18	13	06/20/17	--	38 / 46	18 - 38 / 43 - 45	SVE / Biosparge
		SP-21a	3, 15	--	--	50	48 - 50	Biosparge
		SP-21b	3, 15	--	--	50	48 - 50	Biosparge
		VEW-32		04/11/07	--	25	10 - 25	SVE
		VEW-33		04/11/07	--	25	10 - 25	SVE
		VEW-34		04/11/07	--	25	10 - 25	SVE
		VEW-35		04/10/07	--	25	10 - 25	SVE
		VEW-36		04/10/07	--	25	10 - 25	SVE
		VEW-37		40/10/07	--	25	10 - 25	SVE
		TFR-36	10	11/30/17	--	40	20 - 40	TFE, SVE
		TFR-37	10	11/28/17	--	40	20 - 40	TFE, SVE
		TFR-38	10	11/28/17	--	40	20 - 40	TFE, SVE

TABLE 1
Remediation Well Summary
 DFSP Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Remediation Area	Location	Well	Notes	Installation Date	Casing Elevation (ft msl)	Total Depth (ft bgs)	Screen Interval (ft bgs)	Remediation Well Function
Eastern Area	North	TFB-36	10	11/20/17	--	46	43 - 45	Biosparge
		TFB-37	10	11/21/17	--	46	43 - 45	Biosparge
		TFB-38	10	11/20/17	--	46	43 - 45	Biosparge
Southern Area	Former Truck Fueling Area and Adjacent Water Tank Area	BSP-15	12	11/02/16	--	50.5	48 - 50	Biosparge
		BSP-16	12	11/03/16	--	50.5	48 - 50	Biosparge
		BSP-17	12	11/03/16	--	50.5	48 - 50	Biosparge
		BSP-18	12	11/03/16	--	50.5	48 - 50	Biosparge
		BSP-19	12	11/02/16	--	50.5	48 - 50	Biosparge
		BSP-20	12	11/01/16	--	50.5	48 - 50	Biosparge
		RW-19	13	06/30/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-20	13	06/29/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-21	13	06/30/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-22	13	06/28/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-23	13	06/30/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-24	13	06/28/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-25	13	06/28/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-26	13	07/03/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-27	13	06/28/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-28	13	07/03/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-29	13	06/29/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-30	13	06/27/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-31	13	07/03/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-32	13	07/03/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-33	13	06/29/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-34	13	07/03/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-39	10	11/15/17	--	33 / 47	13 - 33 / 44 - 46	SVE / Biosparge
		RW-40	10	11/15/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-41	10	11/14/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-42	10	11/14/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-43	10	11/14/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-44	10	11/13/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-45	10	11/13/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		RW-46	10	11/13/17	--	33 / 46	13 - 33 / 43 - 45	SVE / Biosparge
		VEW-31				08/03/04	75.10	15
VEW-38	12			11/02/16	--	30.5	20 - 30	SVE
VEW-39	12			11/03/16	--	30.5	20 - 30	SVE
VEW-40	12			11/02/16	--	30.5	20 - 30	SVE
VW-07	16			--	75.64	--	--	SVE

TABLE 1
Remediation Well Summary
 DFSP Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Remediation Area	Location	Well	Notes	Installation Date	Casing Elevation (ft msl)	Total Depth (ft bgs)	Screen Interval (ft bgs)	Remediation Well Function
Southern Area	Former Truck Fueling Area and Adjacent Water Tank Area	VW-09	16	--	75.77	--	--	SVE
		VW-10		03/23/04	75.78	30.5	20 - 30	SVE
		VW-11		03/23/04	75.55	25	20 - 25	SVE
		VW-12		03/23/04	75.79	30.5	15 - 30	SVE
		VW-13		03/23/04	75.42	29	25 - 29	SVE
		VW-14		03/23/04	75.89	28	15 - 28	SVE
		VW-15		04/14/04	75.45	30	20 - 30	SVE
		VW-16		04/14/04	75.29	30	20 - 30	SVE

Legend/Notes :

ft msl = Feet above mean sea level
 ft bgs = Feet below ground surface
 AST = Aboveground storage tank
 BSP = Biosparge
 BS = Biosparge
 HW = Horizontal Well
 GW/GWE = Groundwater extraction
 RTF = Recovery Total Fluids
 RW = Recovery Well
 SP = Sparge
 SVE = Soil vapor extraction
 TF = Total fluid
 TFE = Total fluid extraction
 TFB = Total fluids biosparge
 TFR = Total fluids recovery
 VW/VEW = Vapor extraction well
 -- = Information not available

- 1 = Also referred to as TF-24.
 2 = Replaced abandoned well GW-14 per SGI's March 14, 2017 *Well Replacement Report and Work Plan*.
 3 = Located during field reconnaissance work conducted on September 21, 2016 but determined to likely have silt at the bottom of the casing since the measured total depth was several feet higher than the construction well depth.
 4 = Located during field reconnaissance work conducted on September 21, 2016 but determined to be inaccessible.
 5 = Abandoned on December 29, 2014 (replacement pending per SGI's March 14, 2017 *Well Replacement Report and Work Plan*).
 6 = Abandoned on December 30, 2014 (replacement pending per SGI's March 14, 2017 *Well Replacement Report and Work Plan*).
 7 = Abandoned on January 5, 2015 (replacement pending per SGI's March 14, 2017 *Well Replacement Report and Work Plan*).
 8 = Abandoned on December 31, 2014 (replacement pending per SGI's March 14, 2017 *Well Replacement Report and Work Plan*).
 9 = Also referred to as "old TF-24" or "former TF-24".
 10 = Recently installed per SGI's July 11, 2018 *Well Installation Completion Report* .
 11 = Abandoned on November 16, 2017.
 12 = Recently installed per SGI's March 14, 2017 *Well Replacement Report and Work Plan*.
 13 = Recently installed per SGI's June 30, 2017 *Remediation Well Installation Update Report*.
 14 = Well installed by Government Technology Services in September 1992; exact date unknown.
 15 = Well installed by Parsons in October 1999; exact date unknown.
 16 = Well installation date unknown.
 17 = Confirmed to be inoperable in October 2017 (well plugged)..
 18 = Well abandoned in-place on 6/7/19 and 6/10/19 and replaced with new horizontal wells HW-8 and HW-9
 19 = Total well length is 340-feet for horizontal well HW-8 and 500-feet for HW-9.

TABLE 2A
Groundwater Extraction and Treatment System Operations Summary - January
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Data Source	Notes	GW-14R Totalizer Reading (gallons)	GMW-31 Totalizer Reading (gallons)	GW-16 Totalizer Reading (gallons)	Groundwater Extracted from Eastern Area (gallons)	Groundwater Extracted from Central Area (gallons)	Discharge Totalizer Reading (gallons)	Groundwater Extracted and Treated (gallons)	Influent DRO (ug/L)	Cumulative DRO Removed ^{A,B} (lb)
1/1/21	Off line		--	--	--	--	--	--	--	--	9,947.77
1/2/21	Off line		--	--	--	--	--	--	--	--	9,947.77
1/3/21	Off line		--	--	--	--	--	--	--	--	9,947.77
1/4/21	Off line		--	--	--	--	--	--	--	--	9,947.77
1/5/21	Technician	1	256,700	375,331	1,328,350	1,328,350	632,031	1,835,820	1,070	--	9,947.77
1/6/21	*		--	--	--	--	--	--	--	--	9,947.79
1/7/21	*		--	--	--	--	--	--	--	--	9,947.82
1/8/21	Technician		266,378	379,450	1,329,953	1,329,953	645,828	1,854,160	18,340	--	9,947.84
1/9/21	*		--	--	--	--	--	--	--	--	9,947.85
1/10/21	*		--	--	--	--	--	--	--	--	9,947.87
1/11/21	*		--	--	--	--	--	--	--	--	9,947.88
1/12/21	*		--	--	--	--	--	--	--	--	9,947.90
1/13/21	*		--	--	--	--	--	--	--	--	9,947.91
1/14/21	*		--	--	--	--	--	--	--	--	9,947.93
1/15/21	Technician	2	288,959	389,061	1,330,306	1,330,306	678,020	1,882,677	28,517	--	9,947.94
1/16/21	Off line		--	--	--	--	--	--	--	--	9,947.94
1/17/21	Off line		--	--	--	--	--	--	--	--	9,947.94
1/18/21	Off line		--	--	--	--	--	--	--	--	9,947.94
1/19/21	Off line		--	--	--	--	--	--	--	--	9,947.94
1/20/21	Off line		--	--	--	--	--	--	--	--	9,947.94
1/21/21	Off line		--	--	--	--	--	--	--	--	9,947.94
1/22/21	Technician	3	289,696	389,067	1,330,364	1,330,364	678,763	1,882,883	206	--	9,947.94
1/23/21	*		--	--	--	--	--	--	--	--	9,947.96
1/24/21	*		--	--	--	--	--	--	--	--	9,947.97
1/25/21	*		--	--	--	--	--	--	--	--	9,947.98
1/26/21	*		--	--	--	--	--	--	--	--	9,947.99
1/27/21	*		--	--	--	--	--	--	--	--	9,948.01
1/28/21	Technician	4	305,050	393,885	1,332,842	1,332,842	698,935	1,905,533	22,650	860	9,948.04
1/29/21	*		--	--	--	--	--	--	--	--	9,948.07
1/30/21	*		--	--	--	--	--	--	--	--	9,948.09
1/31/21	*		--	--	--	--	--	--	--	--	9,948.12

Cumulative Groundwater Discharged by the GWETS to Date (gallons)

Period	January	Quarter 1, 2021	Quarter 2, 2021	Quarter 3, 2021	Quarter 4, 2021	2021 to Date	April 1996 to Date
Volume	81,970	81,970	--	--	--	81,970	80,329,427

Cumulative Mass DRO Removed by the GWETS ^A (lb)

Period	January	Quarter 1 to Date	April 1996 to Date
Mass	0.35	0.35	9,948.1

$$Liquid\text{-Phase DRO Mass [lb]} = \left(Conc. \left[\frac{\mu g}{L} \right] \right) \cdot \left(\frac{3.785 L}{gal} \right) \cdot \left(\frac{1 g}{1,000,000 \mu g} \right) \cdot \left(\frac{1 lb}{453.59 g} \right) \cdot (Volume [gal])$$

Legend / Notes:

- 1 = GWETS restarted (offline since 11/24/20).
 - 2 = GWETS offline due to faulty sensor.
 - 3 = GWETS restarted.
 - 4 = Collected monthly influent and effluent water samples for laboratory analysis.
- Groundwater extraction wells on line this month: GW-14R, GMW-31, GW-16.
 * = Operational values interpolated from chart recorder data or previous monitoring event.

GWETS = Groundwater extraction and treatment system

µg/L - Micrograms per liter

A = Hydrocarbon removal is calculated using analytical laboratory result for DRO (if not detected, half the detection limit used) from sample collected this month.

B = Values presented to two decimal places in order to show incremental growth.

-- = Not applicable

lb = Pounds

DRO = Diesel range organics



TABLE 2B
Groundwater Extraction and Treatment System Operations Summary - February
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Data Source	Notes	GW-14R Totalizer Reading (gallons)	GMW-31 Totalizer Reading (gallons)	GW-16 Totalizer Reading (gallons)	Groundwater Extracted from Eastern Area (gallons)	Groundwater Extracted from Central Area (gallons)	Discharge Totalizer Reading (gallons)	Groundwater Extracted and Treated (gallons)	Influent DRO (ug/L)	Cumulative DRO Removed ^{A,B} (lb)
2/1/21	*		--	--	--	--	--	--	--	--	9,948.15
2/2/21	*		--	--	--	--	--	--	--	--	9,948.17
2/3/21	*		--	--	--	--	--	--	--	--	9,948.20
2/4/21	*		--	--	--	--	--	--	--	--	9,948.23
2/5/21	Technician		332,138	396,937	1,335,595	1,335,595	729,075	1,935,468	29,935	--	9,948.25
2/6/21	*		--	--	--	--	--	--	--	--	9,948.29
2/7/21	*		--	--	--	--	--	--	--	--	9,948.32
2/8/21	*		--	--	--	--	--	--	--	--	9,948.35
2/9/21	*		--	--	--	--	--	--	--	--	9,948.38
2/10/21	Technician	1	348,898	397,856	1,338,139	1,338,139	746,753	1,956,850	21,382	1,500	9,948.43
2/11/21	Technician		352,495	398,416	1,340,284	1,340,284	750,911	1,960,540	3,690	--	9,948.47
2/12/21	*		--	--	--	--	--	--	--	--	9,948.52
2/13/21	*		--	--	--	--	--	--	--	--	9,948.57
2/14/21	*		--	--	--	--	--	--	--	--	9,948.61
2/15/21	*		--	--	--	--	--	--	--	--	9,948.66
2/16/21	*		--	--	--	--	--	--	--	--	9,948.70
2/17/21	*		--	--	--	--	--	--	--	--	9,948.75
2/18/21	Technician		377,677	398,416	1,340,284	1,340,284	776,093	1,986,369	25,829	--	9,948.80
2/19/21	Technician	2	381,770	398,416	1,340,999	1,340,999	780,186	1,990,085	3,716	--	9,948.84
2/20/21	Off line		--	--	--	--	--	--	--	--	9,948.84
2/21/21	Off line		--	--	--	--	--	--	--	--	9,948.84
2/22/21	Technician	3	381,770	398,416	1,340,999	1,340,999	780,186	1,990,085	0	--	9,948.84
2/23/21	*		--	--	--	--	--	--	--	--	9,948.91
2/24/21	*		--	--	--	--	--	--	--	--	9,948.99
2/25/21	*		--	--	--	--	--	--	--	--	9,949.06
2/26/21	*		--	--	--	--	--	--	--	--	9,949.13
2/27/21	*		--	--	--	--	--	--	--	--	9,949.20
2/28/21	*		--	--	--	--	--	--	--	--	9,949.27

Cumulative Groundwater Discharged by the GWETS (gallons)							
Period	February	Quarter 1, 2021	Quarter 2, 2021	Quarter 3, 2021	Quarter 4, 2021	2021 to Date	April 1996 to Date
Volume	107,828	189,798	--	--	--	189,798	80,437,255

Cumulative Mass DRO Removed by the GWETS ^A (lb)			
Period	February	Quarter 1 to Date	April 1996 to Date
Mass	1.15	1.50	9,949.3

$$Liquid-Phase\ DRO\ Mass\ [lb] = \left(Conc. \left[\frac{\mu g}{L} \right] \right) \cdot \left(\frac{3.785\ L}{gal} \right) \cdot \left(\frac{1\ g}{1,000,000\ \mu g} \right) \cdot \left(\frac{1\ lb}{453.59\ g} \right) \cdot (Volume\ [gal])$$

Legend / Notes:

- 1 = Collected monthly water samples for laboratory analysis.
- 2 = GWETS manually shut down for scheduled SCE power outage.
- 3 = GWETS restarted.
- Groundwater extraction wells on line this month: NoneGW-14R, GWM-31, GW-16.
- * = Operational values interpolated from chart recorder data or previous monitoring event.

GWETS = Groundwater extraction and treatment system

µg/L - Micrograms per liter

A = Hydrocarbon removal is calculated using analytical laboratory result for DRO (if not detected, half the detection limit used) from sample collected on January 30, 2020.

B = Values presented to two decimal places in order to show incremental growth.

-- = Not applicable

lb = Pounds

DRO = Diesel range organics



TABLE 2C
Groundwater Extraction and Treatment System Operations Summary - March
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Data Source	Notes	GW-14R Totalizer Reading (gallons)	GMW-31 Totalizer Reading (gallons)	GW-16 Totalizer Reading (gallons)	Groundwater Extracted from Eastern Area (gallons)	Groundwater Extracted from Central Area (gallons)	Discharge Totalizer Reading (gallons)	Groundwater Extracted and Treated (gallons)	Influent DRO (ug/L)	Cumulative DRO Removed ^{A,B} (lb)
3/1/21	*		--	--	--	--	--	--	--	--	9,949.35
3/2/21	*		--	--	--	--	--	--	--	--	9,949.42
3/3/21	*		--	--	--	--	--	--	--	--	9,949.49
3/4/21	Technician		416,176	415,642	1,347,659	1,347,659	831,818	2,047,424	57,339	--	9,949.56
3/5/21	Technician	1	420,087	417,451	1,347,900	1,347,900	837,538	2,052,148	4,724	--	9,949.62
3/6/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/7/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/8/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/9/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/10/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/11/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/12/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/13/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/14/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/15/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/16/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/17/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/18/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/19/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/20/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/21/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/22/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/23/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/24/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/25/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/26/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/27/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/28/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/29/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/30/21	Off line		--	--	--	--	--	--	--	--	9,949.62
3/31/21	Off line		--	--	--	--	--	--	--	--	9,949.62

Cumulative Groundwater Discharged by the GWETS (gallons)							
Period	March	Quarter 1, 2021	Quarter 2, 2021	Quarter 3, 2021	Quarter 4, 2021	2021 to Date	April 1996 to Date
Volume	27,600	217,398	--	--	--	217,398	80,464,855

Cumulative Mass DRO Removed by the GWETS ^A (lb)			
Period	March	Quarter 1 to Date	April 1996 to Date
Mass	0.35	1.85	9,949.6

$$Liquid-Phase\ DRO\ Mass\ [lb] = \left(Conc. \left[\frac{\mu g}{L} \right] \right) \cdot \left(\frac{3.785\ L}{gal} \right) \cdot \left(\frac{1\ g}{1,000,000\ \mu g} \right) \cdot \left(\frac{1\ lb}{453.59\ g} \right) \cdot (Volume\ [gal])$$

Legend / Notes:

1 = GWETS manually shut down.
 Groundwater extraction wells on line this month: GW-14R, GWM-31, GW-16.
 * = Operational values interpolated from chart recorder data or previous monitoring event.

GWETS = Groundwater extraction and treatment system
 ug/L - Micrograms per liter
 A = Hydrocarbon removal is calculated using analytical laboratory result for DRO (if not detected, half the detection limit used) from sample collected this month.
 B = Values presented to two decimal places in order to show incremental growth.
 -- = Not applicable
 lb = Pounds
 DRO = Diesel range organics



TABLE 3A
Carbon Vapor Extraction System Operations Summary - January
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Data Source	Notes	VES Hour Meter Reading (hours)	VES Process Flow ^A (scfm)	VES Manifold Vacuum (in. Hg)	Carbon Inlet Temperature (°F)	Laboratory Process Concentration (ppmv)	Field Process Concentration ^{B,C} (ppmv)	Field Effluent Concentration ^{B,C} (ppmv)	Cumulative Vapor-Phase GRO Removed ^D (lb)
01/01/21	Offline		65,074	--	--	--	--	--	--	2,985,051
01/02/21	Offline		65,074	--	--	--	--	--	--	2,985,051
01/03/21	Offline		65,074	--	--	--	--	--	--	2,985,051
01/04/21	Offline		65,074	--	--	--	--	--	--	2,985,051
01/05/21	Offline		65,074	--	--	--	--	--	--	2,985,051
01/06/21	Offline		65,074	--	--	--	--	--	--	2,985,051
01/07/21	Offline		65,074	--	--	--	--	--	--	2,985,051
01/08/21	Offline		65,074	--	--	--	--	--	--	2,985,051
01/09/21	Offline		65,074	--	--	--	--	--	--	2,985,051
01/10/21	Offline		65,074	--	--	--	--	--	--	2,985,051
01/11/21	Offline		65,074	--	--	--	--	--	--	2,985,051
01/12/21	Offline		65,074	--	--	--	--	--	--	2,985,051
01/13/21	Offline		65,074	--	--	--	--	--	--	2,985,051
01/14/21	Technician	1	65,081	550	--	--	--	--	--	2,985,051
01/15/21	Technician		65,100	550	4.4	90.0	--	21.4	0.0	2,985,056
01/16/21	*		65,124	550	--	--	--	--	--	2,985,062
01/17/21	*		65,148	550	--	--	--	--	--	2,985,068
01/18/21	*		65,172	550	--	--	--	--	--	2,985,074
01/19/21	*		65,197	550	--	--	--	--	--	2,985,080
01/20/21	*		65,221	550	--	--	--	--	--	2,985,086
01/21/21	Technician	2,3	65,245	--	--	--	--	--	--	2,985,092
01/22/21	Offline		65,245	--	--	--	--	--	--	2,985,092
01/23/21	Offline		65,245	--	--	--	--	--	--	2,985,092
01/24/21	Offline		65,245	--	--	--	--	--	--	2,985,092
01/25/21	Offline		65,245	--	--	--	--	--	--	2,985,092
01/26/21	Offline		65,245	--	--	--	--	--	--	2,985,092
01/27/21	Offline		65,245	--	--	--	--	--	--	2,985,092
01/28/21	Offline		65,245	--	--	--	--	--	--	2,985,092
01/29/21	Offline		65,245	--	--	--	--	--	--	2,985,092
01/30/21	Offline		65,245	--	--	--	--	--	--	2,985,092
01/31/21	Offline		65,245	--	--	--	--	--	--	2,985,092

Cumulative Mass TPHg Removed by the VES ^D (lb)			
Period	January	Quarter 1 to Date	April 1996 to Date
Mass	41	41	2,985,092

$$Vapor-Phase\ TPHg\ Mass\ [lb] = \left(Conc. \left[\frac{\mu g}{L}\right]\right) \cdot \left(\frac{28.32\ L}{ft^3}\right) \cdot \left(\frac{1\ g}{1,000,000\ \mu g}\right) \cdot \left(\frac{1\ lb}{453.59\ g}\right) \cdot (Flow\ [scfm]) \cdot \left(\frac{60\ min}{hr}\right) \cdot (OpTime\ [hrs])$$

Legend / Notes:

- 1 = VES restarted following completion of carbon change out work.
- 2 = VES manually shut down.
- 3 = Trunkline 2 diverted to Thermax VES.

* = Operational values interpolated from chart recorder data or previous monitoring event.

- VES = Soil vapor extraction system
- in. Hg = Inches of mercury
- ppmv = Parts per million by volume
- scfm = Standard cubic feet per minute
- °F = Degrees Fahrenheit
- lb = Pounds
- A = Reading from chart recorder.
- B = Concentrations obtained with a calibrated organic vapor analyzer.
- C = Concentrations correlated to laboratory data and expressed as hexane.
- D = Hydrocarbon removal is calculated using analytical laboratory result for GRO (if not detected, half the detection limit is used).



TABLE 3B
Carbon Vapor Extraction System Operations Summary - February
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Data Source	Notes	VES Hour Meter Reading (hours)	VES Process Flow ^A (scfm)	VES Manifold Vacuum (in. Hg)	Carbon Inlet Temperature (°F)	Laboratory Process Concentration (ppmv)	Field Process Concentration ^{B,C} (ppmv)	Field Effluent Concentration ^{B,C} (ppmv)	Cumulative Vapor-Phase GRO Removed ^D (lb)
02/01/21	Offline		65,245	--	--	--	--	--	--	2,985,092
02/02/21	Offline		65,245	--	--	--	--	--	--	2,985,092
02/03/21	Offline		65,245	--	--	--	--	--	--	2,985,092
02/04/21	Technician	1	65,247	314	3.4	111.0	--	47.5	0.0	2,985,092
02/05/21	*		65,271	314	--	--	--	--	--	2,985,092
02/06/21	*		65,296	314	--	--	--	--	--	2,985,092
02/07/21	*		65,320	314	--	--	--	--	--	2,985,093
02/08/21	Technician	2	65,345	222	3.8	98.0	--	32.8	0.0	2,985,093
02/09/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/10/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/11/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/12/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/13/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/14/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/15/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/16/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/17/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/18/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/19/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/20/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/21/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/22/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/23/21	Offline		65,345	--	--	--	--	--	--	2,985,093
02/24/21	Technician	1,3,4	65,396	1405	3.4	110.0	<4.9	38.4	0.0	2,985,096
02/25/21	*		65,420	1405	--	--	--	--	--	2,985,097
02/26/21	*		65,445	1405	--	--	--	--	--	2,985,098
02/27/21	*		65,469	1405	--	--	--	--	--	2,985,099
02/28/21	*		65,493	1405	--	--	--	--	--	2,985,101

Cumulative Mass TPHg Removed by the VES ^A (lb)			
Period	February	Quarter 1 to Date	April 1996 to Date
Mass	9	49	2,985,101

Legend / Notes:

- 1 = VES restarted.
- 2 = VES offline pending maintenance.
- 3 = Collected monthly influent, after GAC-1, after GAC-2, and Effluent samples for laboratory analysis.
- 4 = Collected individual well vapor samples for laboratory analysis from HWs.
- = Not applicable or not measured
- * = Operational values interpolated from chart recorder data or previous monitoring event.

$$Vapor-Phase\ TPHg\ Mass\ [lb] = \left(Conc. \left[\frac{\mu g}{L} \right] \right) \cdot \left(\frac{28.32\ L}{ft^3} \right) \cdot \left(\frac{1\ g}{1,000,000\ \mu g} \right) \cdot \left(\frac{1\ lb}{453.59\ g} \right) \cdot (Flow\ [scfm]) \cdot \left(\frac{60\ min}{hr} \right) \cdot (OpTime\ [hrs])$$

- VES = Soil vapor extraction system
- in. Hg = Inches of mercury
- ppmv = Parts per million by volume
- scfm = Standard cubic feet per minute
- °F = Degrees Fahrenheit
- lb = Pounds
- A = Reading from chart recorder.
- B = Concentrations obtained with a calibrated organic vapor analyzer.
- C = Concentrations correlated to laboratory data and expressed as hexane.
- D = Hydrocarbon removal is calculated using analytical laboratory results for GRO (if not detected, half the detection limit is used).



TABLE 3C
Carbon Vapor Extraction System Operations Summary - March
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Data Source	Notes	VES Hour Meter Reading (hours)	VES Process Flow ^A (scfm)	VES Manifold Vacuum (in. Hg)	Carbon Inlet Temperature (°F)	Laboratory Process Concentration (ppmv)	Field Process Concentration ^{B,C} (ppmv)	Field Effluent Concentration ^{B,C} (ppmv)	Cumulative Vapor-Phase GRO Removed ^D (lb)
03/01/21	*		65,517	1405	--	--	--	--	--	2,985,104
03/02/21	*		65,541	1405	--	--	--	--	--	2,985,108
03/03/21	*		65,566	1405	--	--	--	--	--	2,985,111
03/04/21	Technician		65,590	573	4.1	116.0	--	85.2	0.0	2,985,113
03/05/21	*		65,614	573	--	--	--	--	--	2,985,114
03/06/21	*		65,638	573	--	--	--	--	--	2,985,116
03/07/21	*		65,661	573	--	--	--	--	--	2,985,117
03/08/21	Technician	1	65,684	513	4.0	112.0	5.1	52.9	0.0	2,985,118
03/09/21	Technician		65,710	513	--	--	--	--	--	2,985,120
03/10/21	*		65,734	513	--	--	--	--	--	2,985,121
03/11/21	*		65,758	513	--	--	--	--	--	2,985,122
03/12/21	*		65,782	513	--	--	--	--	--	2,985,124
03/13/21	*		65,806	513	--	--	--	--	--	2,985,125
03/14/21	*		65,830	513	--	--	--	--	--	2,985,126
03/15/21	Technician		65,854	462	4.6	100.0	--	40.3	--	2,985,127
03/16/21	*		65,877	462	--	--	--	--	--	2,985,128
03/17/21	*		65,899	462	--	--	--	--	--	2,985,130
03/18/21	*		65,922	462	--	--	--	--	--	2,985,131
03/19/21	Technician	2	65,945	505	--	110.0	--	--	--	2,985,132
03/20/21	*		65,972	505	--	--	--	--	--	2,985,133
03/21/21	*		65,998	505	--	--	--	--	--	2,985,135
03/22/21	Technician	3	66,025	512	--	114.0	--	--	--	2,985,136
03/23/21	Offline		66,025	--	--	--	--	--	--	2,985,136
03/24/21	Technician	4, 3	66,067	516	3.7	108.0	--	382.4	0.3	2,985,138
03/25/21	Technician	4	66,073	516	--	--	--	--	--	2,985,139
03/26/21	*		66,097	516	--	--	--	--	--	2,985,140
03/27/21	*		66,122	516	--	--	--	--	--	2,985,141
03/28/21	*		66,147	516	--	--	--	--	--	2,985,143
03/29/21	*		66,171	516	--	--	--	--	--	2,985,144
03/30/21	Technician		66,196	505	3.9	120.0	--	395.0	0.0	2,985,145
03/31/21	Technician	5	66,220	505	--	--	--	--	--	2,985,147

Cumulative Mass TPHg Removed by the VES ^A (lb)			
Period	March	Quarter 1 to Date	April 1996 to Date
Mass	46	95	2,985,147

$$Vapor-Phase\ TPHg\ Mass\ [lb] = \left(Conc. \left[\frac{\mu g}{L} \right] \right) \left(\frac{28.32\ L}{ft^3} \right) \left(\frac{1\ g}{1,000,000\ \mu g} \right) \left(\frac{1\ lb}{453.59\ g} \right) \cdot (Flow\ [scfm]) \cdot \left(\frac{60\ min}{hr} \right) \cdot (OpTime\ [hrs])$$

Legend / Notes :

- 1 = Collected monthly influent, after GAC-1, after GAC-2, and Effluent samples for laboratory analysis.
- 2 = Trunklines 1 & 2 brought into system
- 3 = VES temporarily shut down for maintenance.
- 4 = VES restarted.
- 5 = Trunkline 1 diverted to Thermax VES.

-- = Not applicable or not measured

* = Operational values interpolated from chart recorder data or previous monitoring event.

VES = Soil vapor extraction system

scfm = Standard cubic feet per minute

A = Reading from chart recorder.

B = Concentrations obtained with a calibrated organic vapor analyzer.

C = Concentrations correlated to laboratory data and expressed as hexane.

D = Hydrocarbon removal is calculated using analytical laboratory results for GRO (if not detected, half the detection limit is used)

in. Hg = Inches of mercury

°F = Degrees Fahrenheit

ppmv = Parts per million by volume

lb = Pounds



TABLE 4
Historical Summary of Analytical Vapor Sampling Results - Influent Carbon VES
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Sample Date	Notes	Vapor Extraction System Wells On Line	Laboratory Analysis Methods	GRO Field OVA Reading	GRO		VOCs as Hexane ^A		Benzene		Toluene		Ethylbenzene		o-Xylene		m,p-Xylenes		Total Xylenes		MTBE	
				(ppmv)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)
04/29/11		--	TO-3 & 8260B	--	--	--	17	60	0.021	0.067	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
05/27/11		--	TO-3 & 8260B	--	--	--	13	46	0.021	0.067	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
06/30/11		--	TO-3 & 8260B	--	--	--	11	39	0.018	0.057	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
07/27/11		--	TO-3 & 8260B	--	--	--	8.6	31	0.013	0.042	<0.0050	<0.019	0.012	0.052	--	--	--	--	0.013	0.056	<0.010	<0.036
08/26/11		--	TO-3 & 8260B	--	--	--	7.8	28	0.012	0.038	<0.0050	<0.019	0.020	0.087	--	--	--	--	0.0264	0.115	<0.010	<0.036
09/30/11		--	TO-3 & 8260B	--	--	--	6.9	25	0.012	0.038	<0.0050	<0.019	0.011	0.048	--	--	--	--	0.011	0.048	<0.010	<0.036
10/28/11		--	TO-3 & 8260B	--	--	--	5.4	19	0.011	0.035	<0.0050	<0.019	0.015	0.065	--	--	--	--	0.028	0.12	<0.010	<0.036
11/30/11		--	TO-3 & 8260B	--	--	--	8.5	30	0.012	0.038	<0.0050	<0.019	0.0067	0.029	--	--	--	--	0.010	0.043	<0.010	<0.036
12/28/11		--	TO-3 & 8260B	--	--	--	8.6	31	0.024	0.077	0.0075	0.028	0.0096	0.042	--	--	--	--	0.022	0.095	<0.010	<0.036
01/26/12		--	TO-3 & 8260B	--	--	--	3.7	13	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
02/24/12		--	TO-3 & 8260B	--	--	--	4.6	16	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
03/28/12		--	TO-3 & 8260B	--	--	--	4.1	15	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
04/27/12		--	TO-3 & 8260B	--	--	--	3.6	13	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
05/31/12		--	TO-3 & 8260B	--	--	--	6.5	23	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
06/28/12		--	TO-3 & 8260B	--	--	--	5.3	19	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
07/26/12		--	TO-3 & 8260B	4.1	--	--	4.1	15	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
08/31/12		--	TO-3 & 8260B	1.5	--	--	<3.0	<11	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
09/27/12		--	TO-3 & 8260B	1.5	--	--	<3.0	<11	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
10/30/12		--	TO-3 & 8260B	1.5	--	--	6.1	22	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
11/26/12		--	TO-3 & 8260B	4.2	--	--	4.2	15	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
12/19/12		--	TO-3 & 8260B	3.2	--	--	3.2	11	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
01/31/13		--	TO-3 & 8260B	4.6	--	--	4.6	16	--	--	--	--	--	--	--	--	--	--	--	--	--	--
02/27/13		--	TO-3 & 8260B	4.5	--	--	4.5	16	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
03/28/13		--	TO-3 & 8260B	6.7	--	--	6.7	24	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
04/22/13		--	TO-3 & 8260B	5.4	--	--	5.4	19	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
07/29/13		--	TO-3 & 8260B	1.5	--	--	<3.0	<11	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
08/12/13		--	TO-3 & 8260B	--	--	--	<3.0	<11	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
10/30/13		--	TO-3 & 8260B	3.0	--	--	3.0	11	0.014	0.045	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
11/27/13		--	TO-3 & 8260B	1.5	--	--	<3.0	<11	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	0.015	0.065	<0.010	<0.036
12/19/13		--	TO-3 & 8260B	1.5	--	--	<3.0	<11	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	--	--	--	--	<0.015	<0.065	<0.010	<0.036
03/21/14		--	TO-3 & 8260B	1.5	--	--	<3.0	<11	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	<0.0050	<0.022	<0.010	<0.043	<0.015	<0.065	<0.010	<0.036
04/23/14		VEW-32, VEW-33, VEW-34, VEW-35, VEW-36 VEW-37, HW-1, HW-3, HW-5, HW-7	TO-3 & 8260B	1.9	--	--	<3.0	<11	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	<0.0050	<0.022	<0.010	<0.043	<0.015	<0.065	<0.010	<0.036
05/16/14	1	VEW-32, VEW-33, VEW-34, VEW-35, VEW-36 VEW-37, HW-1, HW-3, HW-5, HW-7	TO-3 & 8260B	1.1	--	--	<3.0	<11	<0.0050	<0.016	<0.0050	<0.019	<0.0050	<0.022	<0.0050	<0.022	<0.010	<0.043	<0.015	<0.065	<0.010	<0.036
07/09/14	2	VEW-32, VEW-33, VEW-34, VEW-35, VEW-36 VEW-37, HW-1, HW-3, HW-5, HW-7	8015M & 8260M	24	6.1	25	7.0	25	<0.16	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.3	<1.5	<0.6	<2.0
08/13/14		VEW-32, VEW-33, VEW-34, VEW-35, VEW-36 VEW-37, HW-1, HW-3, HW-5, HW-7	8015M & 8260M	27	7.3	30	8.4	30	<0.16	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.3	<1.5	<0.6	<2.0



TABLE 4
Historical Summary of Analytical Vapor Sampling Results - Influent Carbon VES
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Sample Date	Notes	Vapor Extraction System Wells On Line	Laboratory Analysis Methods	GRO	GRO		VOCs as Hexane ^A		Benzene		Toluene		Ethylbenzene		o-Xylene		m,p-Xylenes		Total Xylenes		MTBE	
				Field OVA Reading (ppmv)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)
09/17/14	3	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	8015M & 8260M	5.6	<4.9	<20	<5.6	<20	<0.16	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.3	<1.5	<0.6	<2.0
10/23/14	4	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	8015M & 8260M	1.2	<4.9	<20	<5.6	<20	<0.16	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.3	<1.5	<0.6	<2.0
11/17/14	5	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	8015M & 8260M	1.3	<4.9	<20	<5.6	<20	<0.16	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.3	<1.5	<0.6	<2.0
12/17/14		VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	8015M & 8260M	0.5	<4.9	<20	<5.6	<20	<0.16	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.3	<1.5	<0.6	<2.0
01/14/15		VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	8015M & 8260M	1.5	<4.9	<20	<5.6	<20	<0.16	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.3	<1.5	<0.6	<2.0
02/20/15		VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	8015M & 8260M	1.5	<4.9	<20	<5.6	<20	<0.16	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.3	<1.5	<0.6	<2.0
03/27/15		VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	8015M & 8260M	3.4	<4.9	<20	<5.6	<20	<0.16	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.3	<1.5	<0.6	<2.0
04/27/15	6	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	8015M & 8260M	132	140	580	160	580	0.63	2.0	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	0.23	1.0	0.23	1.0	<0.6	<2.0
05/29/15	6,7	--	8015M & 8260M	103	83	340	97	340	<0.16	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.3	<1.5	<0.6	<2.0
06/03/15	6,8	VEW-32, VEW-33, VEW-34	8015M & 8260M	47	32	130	37	130	<0.16	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.3	<1.5	<0.6	<2.0
07/09/15	6	VEW-32, VEW-33, VEW-34	8015M & 8260M	162	150	600	170	600	<0.16	<0.50	0.15	0.58	<0.12	<0.50	0.67	2.9	0.71	3.1	1.38	6.0	<0.55	<2.0
07/15/15	6,9	VEW-32, VEW-33, VEW-34	8015M & 8260M	147	170	700	200	700	<0.16	<0.50	0.53	2.0	0.18	0.78	0.99	4.3	1.5	6.3	2.49	10.6	<0.55	<2.0
07/21/15	6,9	VEW-32, VEW-33, VEW-34	8015M & 8260M	259	160	640	180	640	<0.16	<0.50	0.25	0.94	<0.12	<0.50	0.71	3.1	0.62	2.7	1.33	5.8	<0.55	<2.0
07/29/15	6,9	VEW-32, VEW-33, VEW-34	8015M & 8260M	129	170	710	200	710	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	0.32	1.4	0.25	1.1	0.57	2.5	<0.55	<2.0
08/17/15	6,10	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5	8015M & 8260M	135	130	550	160	550	0.75	2.4	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	0.28	1.2	0.28	1.2	<0.55	<2.0
09/09/15	6,11	VEW-32, VEW-33, HW-1, HW-3, HW-5	8015M & 8260M	202	190	760	220	760	0.30	0.95	0.74	2.8	0.76	3.3	0.69	3.0	2.5	11	3.19	14	<0.55	<2.0
09/22/15	6,9	VEW-32, VEW-33, HW-1, HW-3, HW-5	8015M & 8260M	225	150	600	170	600	0.27	0.85	0.37	1.4	<0.12	<0.50	0.71	3.1	0.58	2.5	1.29	5.6	<0.55	<2.0
09/25/15	6,9	VEW-32, VEW-33, HW-1, HW-3, HW-5	8015M & 8260M	258	220	890	250	890	0.41	1.3	0.64	2.4	0.17	0.75	0.74	3.2	0.85	3.7	1.59	6.9	<0.55	<2.0
10/07/15	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	8015M & 8260M	256	230	940	270	940	0.69	2.2	0.82	3.1	0.22	0.97	0.41	1.8	1.1	4.6	1.51	6.4	<0.55	<2.0
11/04/15	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	8015M & 8260M	380	290	1,200	340	1,200	0.88	2.8	1.6	5.9	0.25	1.1	1.4	6.2	2.1	9.0	3.5	15	<0.55	<2.0
12/07/15	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	8015M & 8260M	346	320	1,300	370	1,300	0.69	2.2	1.9	7.0	0.15	0.64	0.76	3.3	0.94	4.1	1.7	7.4	<0.55	<2.0
01/13/16	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	8015M & 8260M	141	110	470	130	470	0.16	0.52	0.29	1.1	<0.12	<0.50	0.22	0.95	0.30	1.3	0.52	2.3	<0.55	<2.0
02/10/16	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	8015M & 8260M	124	98	400	110	400	0.59	1.9	0.66	2.5	0.23	1.0	0.39	1.7	0.6	2.6	0.99	4.3	<0.55	<2.0
03/02/16	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	8015M & 8260M	92	54	220	63	220	<0.16	<0.50	0.25	0.93	<0.12	<0.50	0.14	0.62	<0.23	<1.0	0.14	0.62	<0.55	<2.0
04/06/16	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	8015M & 8260M	124	120	490	140	490	0.38	1.2	0.29	1.1	<0.12	<0.50	0.17	0.72	<0.23	<1.0	0.17	0.72	<0.55	<2.0
05/04/16	6,7	VEW-32, VEW-33, HW-1, HW-3, HW-5	8015M & 8260M	107	100	410	120	410	0.31	1.0	0.20	0.77	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
06/06/16	6,12	VEW-32, VEW-33, HW-1, HW-3, HW-5	8015M & 8260M	73	59	240	68	240	0.59	1.9	0.50	1.9	<0.12	<0.50	0.41	1.8	0.51	2.2	0.92	4.0	<0.55	<2.0
07/06/16	6,13	HW-1, HW-3, HW-5	8015M & 8260M	49	37	150	43	150	0.41	1.3	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
09/01/16	6,13	HW-1, HW-3, HW-5	8015M & 8260M	46	18	75	21	75	0.41	1.3	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
10/12/16	6,13,14	HW-1, HW-3, HW-5	8015M & 8260M	43	19	79	22	79	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
11/01/16	6,13	HW-1, HW-3, HW-5, HW-7	8015M & 8260M	114	81	330	94	330	0.53	1.7	0.23	0.86	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
12/05/16	6,13	HW-1, HW-3, HW-5, HW-7	8015M & 8260M	96	86	350	100	350	0.31	1.0	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
01/09/17	6,13	HW-1, HW-3, HW-5, HW-7	8015M & 8260M	86	68	280	80	280	0.63	2.0	0.24	0.89	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
02/06/17	6,13	HW-1, HW-3, HW-5, HW-7	8015M & 8260M	93	66	270	77	270	0.44	1.4	0.19	0.72	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
03/15/17	6,13	HW-1, HW-3, HW-5, HW-7	8015M & 8260M	96	76	310	88	310	0.53	1.7	0.24	0.9	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0



TABLE 4
Historical Summary of Analytical Vapor Sampling Results - Influent Carbon VES
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Sample Date	Notes	Vapor Extraction System Wells On Line	Laboratory Analysis Methods	GRO	GRO		VOCs as Hexane ^A		Benzene		Toluene		Ethylbenzene		o-Xylene		m,p-Xylenes		Total Xylenes		MTBE	
				Field OVA Reading (ppmv)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)
03/27/17	15,16	HW-1, HW-3, HW-5, HW-7	8015M & 8260M	193	150	600	170	600	0.91	2.9	0.42	1.6	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
04/17/17	15	HW-1, HW-3, HW-5, HW-7	8015M & 8260M	138	150	610	170	610	1.1	3.5	0.53	2.0	<0.12	<0.50	<0.12	<0.50	0.23	1.0	0.23	1.0	<0.55	<2.0
05/03/17	15	HW-1, HW-3, HW-5, HW-7	8015M & 8260M	141	120	510	140	510	0.69	2.2	0.58	2.2	0.12	0.51	<0.12	<0.50	0.35	1.5	0.35	1.5	<0.55	<2.0
06/05/17	15	HW-1, HW-3, HW-5	8015M & 8260M	136	110	430	120	430	0.81	2.6	0.40	1.5	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
06/27/17	15,17	HW-1, HW-3, HW-5, VEW-38, VEW-39, VEW-40	8015M & 8260M	--	140	560	160	560	0.38	1.2	0.20	0.75	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
07/19/17		HW-5, HW-7 and VEW-39	8015M & 8260M	199	120	500	140	500	0.75	2.4	0.45	1.7	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
08/09/17	18,19	HW-1, HW-5, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	8015M & 8260M	695	560	2,300	650	2,300	0.69	2.2	0.29	1.1	0.53	2.3	<0.12	<0.50	0.44	1.9	0.44	1.9	<0.55	<2.0
09/07/17	19	HW-1, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	8015M & 8260M	767	610	2,500	710	2,500	1.2	3.9	0.48	1.8	0.46	2.0	<0.12	<0.50	0.51	2.2	0.51	2.2	<0.55	<2.0
10/12/17	19,20	HW-1, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	8015M & 8260M	536	370	1,500	430	1,500	1.0	3.2	0.32	1.2	0.41	1.8	0.20	0.88	0.83	3.6	1.0	4.5	<0.55	<2.0
11/02/17	19	HW-1, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	8015M & 8260M	300	240	970	270	970	0.78	2.5	0.24	0.89	0.28	1.2	<0.12	<0.50	0.51	2.2	0.51	2.2	<0.55	<2.0
12/11/17	19	HW-1, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	8015M & 8260M	335	270	1,100	300	1,100	0.85	2.7	0.27	1.0	0.21	0.9	<0.12	<0.50	0.37	1.6	0.37	1.6	<0.55	<2.0
01/11/18	21	HW-1, HW-5, HW-7	8015M & 8260M	269	240	970	270	970	1.1	3.4	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
02/12/18	21	HW-1, HW-5, HW-7	8015M & 8260M	148	86	350	88	350	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
03/28/18	21	HW-1, HW-5, HW-7	8015M & 8260M	201	160	670	170	670	0.59	1.9	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
04/02/18	21	HW-1, HW-5, HW-7	8015M & 8260M	191	150	620	160	620	0.25	0.79	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
05/02/18	21	HW-1, HW-5, HW-7	8015M & 8260M	149	110	470	150	470	0.16	0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
06/06/18	21	HW-1, HW-5, HW-7	8015M & 8260M	95	49	200	50	200	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
07/02/18	21	HW-1, HW-5, HW-7	8015M & 8260M	135	120	490	120	490	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
08/06/18	21	HW-1, HW-5, HW-7	8015M & 8260M	134	49	200	48	200	0.3	0.95	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
09/13/18	21	HW-1, HW-5, HW-7	8015M & 8260M	109	49	200	50	200	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
10/29/18	21	HW-1, HW-5, HW-7	8015M & 8260M	118	66	270	59	270	0.44	1.4	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
11/14/18	21	HW-1, HW-5, HW-7	8015M & 8260M	202	200	800	170	800	1.3	4.2	0.69	2.6	<0.12	<0.5	<0.12	<0.5	0.35	1.5	<0.35	<1.5	<0.55	<2.0
12/12/18	21	HW-1, HW-5, HW-7	8015M & 8260M	130	98	400	87	400	0.59	1.9	0.21	0.79	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
01/28/19	21	HW-1, HW-5, HW-7	8015M & 8260M	228	220	880	190	880	1.3	4.0	0.27	1.0	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
02/12/19	21, 22	HW-1, HW-5, HW-7	8015M & 8260M	258	240	1,000	220	1,000	1.0	3.3	0.23	0.88	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
04/03/19	21, 22	HW-1, HW-5, HW-7	8015M & 8260M	394	73	300	65	300	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
11/25/19	23	HW-1, HW-5, HW-7, HW-8, HW-9	8015M & 8260M	164	42	170	38	170	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.1	<0.35	<1.6	<0.55	<2.0
12/30/19		HW-1, HW-5, HW-7, HW-8, HW-9	8015M & 8260M	39	7.1	29	6.3	29	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
01/15/20		HW-1, HW-5, HW-7, HW-8, HW-9	8015M & 8260M	15	5.4	22	<5.7	22	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
02/18/20		HW-1, HW-5, HW-7, HW-8, HW-9	8015M & 8260M	12	<4.9	<20	<5.7	<20	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
02/27/20		HW-1, HW-5, HW-7, HW-8, HW-9	8015 & 8260B	16	<4.9	<20	<5.7	<20	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
03/16/20	24	HW-1, HW-5, HW-7	8015 & 8260B	105	18.09	74	16	74	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
04/01/20	25	HW-1, HW-5, HW-7, HW-8, HW-9	8015 & 8260B	47	8.31	34	7.5	34	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
04/15/20		HW-1, HW-5, HW-7, HW-8, HW-9	8015 & 8260B	87	9.5	39	8.6	39	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
05/15/20		HW-1, HW-5, HW-7, HW-8, HW-9	8015 & 8260B	119	17	68	15	68	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0



TABLE 4
Historical Summary of Analytical Vapor Sampling Results - Influent Carbon VES
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Sample Date	Notes	Vapor Extraction System Wells On Line	Laboratory Analysis Methods	GRO Field OVA Reading	GRO		VOCs as Hexane ^A		Benzene		Toluene		Ethylbenzene		o-Xylene		m,p-Xylenes		Total Xylenes		MTBE	
				(ppmv)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)
06/22/20		HW-1, HW-5, HW-7, HW-8, HW-9	8015 & 8260B	151	24	98	21	98	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
07/20/20		HW-1, HW-9, HW-7, Trunkline #1, Trunkline #2	8015 & 8260B	572	98	400	79	400	0.19	0.6	0.16	0.59	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
08/24/20		HW-1, HW-9, HW-7, Trunkline #1, Trunkline #2	8015 & 8260B	797	93	380	69	380	0.17	0.53	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
09/14/20		HW-1, HW-9, HW-7, Trunkline #2	8015 & 8260B	397	44	180	33	180	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
10/05/20		HW-1, HW-9, HW-7	8015 & 8260B	80	13	54	9.8	54	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
11/05/20		HW-1, HW-9, HW-7, Trunkline #2	8015 & 8260B	392	34	140	25	140	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
11/30/20		HW-1, HW-9, HW-5, HW-7, Trunkline #2	8015 & 8260B	398	29	120	22	120	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
02/24/21		HW-1, HW-9, HW-5, HW-7	8015 & 8260B	38	<4.9	<20	<4.9	<20	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0
03/08/21		HW-1, HW-8, HW-9, HW-5, HW-7	8015 & 8260B	53	6.8	28	5.1	28	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5	<0.55	<2.0

Legend / Notes:

Data collected prior to April 2014 not verified for completeness nor accuracy.

Influent vapor sample inadvertently not collected during August 2016.

VES = Vapor extraction system
 ppmv = Parts per million by volume

GRO = Gasoline range organics
 µg/L = Micrograms per liter

- Reported concentrations are shown in bold.

MTBE = Methyl tertiary-butyl ether
 -- = Not available or not analyzed

OVA = Organic Vapor Analyzer (calibrated or correlated to Hexane)
 <0.1 = Not detected at or above the Method Reporting Limit (MRL) shown

A = Laboratory reporting Gasoline Range Organics (GRO) as Hexane prior to 11-05-20.

1 = VES manually shut down on 05/29/14.

2 = VES restarted.

3 = Closed vapor extraction wells VEW-35, VEW-36, and VEW-37 on 08/27/14 based on field readings (see Table 9A for details).

4 = VES manually shut down.

5 = VES restarted on 11/03/14.

6 = Select soil biopiles also on line.

7 = Closed all vapor extraction wells from 05/07/15 to 06/03/15, and 05/25/16 to 06/17/16, respectively, to focus extraction efforts on soil biopiles.

8 = Opened vapor extraction wells VEW-32, VEW-33 and VEW-34.

9 = Additional sample collected for laboratory analysis as part of field instrument correlation study.

10 = Opened vapor extraction wells HW-1, HW-3 and HW-5 on 08/10/15 based on field PID readings (see Table 9A for details).

11 = Closed vapor extraction well VEW-34 on 08/19/15 based on low to non-detectable lab results (see Table 10 for details).

12 = Opened vapor extraction wells HW-1, HW-3 and HW-5 on 06/17/16.

13 = Valves associated with vapor extraction wells HW-1, HW-3, HW-5 and/or HW-7 each set to a partially open position while leaving all other wells closed to focus extraction efforts on soil biopiles.

14 = Resumed vapor extraction from well HW-7 based on field PID readings (see Table 9A for details).

15 = Valves associated with vapor extraction wells HW-1, HW-3, HW-5 and/or HW-7 each set to optimize system in accordance with recent field readings and/or lab data since completion of ex-situ remediation project on 03/20/17.

16 = Additional sample collected for laboratory analysis after disconnecting all soil biopiles and optimizing system on 03/20/17 (i.e., with extraction efforts again focused on in-situ remediation following completion of ex-situ remediation project).

17 = Wells VEW-38, VEW-39 and VEW-40 tied into system during late June 2017 following installation per SGI's March 14, 2017 *Well Replacement Report and Work Plan*.

18 = Wells RW-1, RW-2, RW-7, RW-9, RW-12, RW-13, RW-18, RW-20 through RW-24, RW-26, and RW-28 through RW-33 tied into system during early August 2017 following installation per SGI's June 30, 2017 *Remediation Well Installation Update Report*.

19 = For full list of wells online, see SGI's November 15, 2017 *Remediation Status Report - Third Quarter 2017* and February 15, 2018 *Remediation Status Report - Fourth Quarter 2017*, respectively.

20 = Opened dilution valve approximately 10% to reduce carbon usage rate.

21 = Closed dilution valve and focused extraction efforts on relatively low concentration horizontal wells to reduce carbon usage with all other higher concentration vertical wells being connected to the thermal oxidizer (see Table 8 for details).

22 = No sample collected for analysis during March 2019 due to site condition and system operation status.

23 = System restart on 10/30/19 after installation of new blower.

24 = System shut down 3/31/20 due to high effluent value permit exceedence on 3/16/20.

25 = Resampled and restarted system on 4/3/20 upon return to permit compliance.

TABLE 5A
Thermal Oxidizer Vapor Extraction System Operations Summary - January
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Data Source	Notes	VES Hour Meter Reading (hours)	VES Process Flow ^A (scfm)	VES Manifold Vacuum (in. WC)	Oxidizer Inlet Temperature TE1 Excess Controller (°F)	Laboratory Process GRO Concentration (ppmv)	Field Inlet Process Oxidizer Concentration ^{B,C} (ppmv)	Field Effluent Concentration ^{B,C} (ppmv)	Cumulative Vapor-Phase GRO Removed ^D (lb)
01/01/21	Offline		10,563	--	--	--	--	--	--	272,824
01/02/21	Offline		10,563	--	--	--	--	--	--	272,824
01/03/21	Offline		10,563	--	--	--	--	--	--	272,824
01/04/21	Offline		10,563	--	--	--	--	--	--	272,824
01/05/21	Offline		10,563	--	--	--	--	--	--	272,824
01/06/21	Technician	1	10,563	727	--	--	--	--	--	272,824
01/07/21	Technician	2	10,585	727	--	--	--	--	--	273,160
01/08/21	Offline		10,585	--	--	--	--	--	--	273,160
01/09/21	Offline		10,585	--	--	--	--	--	--	273,160
01/10/21	Offline		10,585	--	--	--	--	--	--	273,160
01/11/21	Offline		10,585	--	--	--	--	--	--	273,160
01/12/21	Technician	1	10,585	727	--	1,461	--	--	--	273,160
01/13/21	*		10,609	727	--	--	--	--	--	273,526
01/14/21	Technician		10,633	727	64	1,454	--	912	30	273,892
01/15/21	*		10,657	727	--	--	--	--	--	274,256
01/16/21	*		10,681	727	--	--	--	--	--	274,620
01/17/21	*		10,705	727	--	--	--	--	--	274,984
01/18/21	*		10,729	727	--	--	--	--	--	275,348
01/19/21	*		10,752	727	--	--	--	--	--	275,712
01/20/21	*		10,776	727	--	--	--	--	--	276,077
01/21/21	Technician	3	10,800	727	--	--	--	--	--	276,441
01/22/21	Technician	2	10,824	727	--	1,461	--	--	--	276,805
01/23/21	Offline		10,824	--	--	--	--	--	--	276,805
01/24/21	Offline		10,824	--	--	--	--	--	--	276,805
01/25/21	Offline		10,824	--	--	--	--	--	--	276,805
01/26/21	Offline		10,824	--	--	--	--	--	--	276,805
01/27/21	Technician	1	10,824	727	--	--	--	--	--	276,805
01/28/21	Technician	4	10,845	920	61	1,454	1000	782	25	277,210
01/29/21	*		10,869	920	--	--	--	--	--	277,679
01/30/21	*		10,894	920	--	--	--	--	--	278,148
01/31/21	*		10,918	920	--	--	--	--	--	278,616

Cumulative Mass TPHg Removed by the VES ^D (lb)			
Period	January	Quarter 1 to Date	January 2018 to Date
Mass	5,792.0	5,792.0	286,457.3

$$Vapor-Phase\ TPHg\ Mass\ [lb] = \left(Conc. \left[\frac{\mu g}{L} \right] \right) \left(\frac{28.32\ L}{ft^3} \right) \left(\frac{1\ g}{1,000,000\ \mu g} \right) \left(\frac{1\ lb}{453.59\ g} \right) \left(Flow\ [scfm] \right) \left(\frac{60\ min}{hr} \right) \left(OpTime\ [hrs] \right)$$

Legend / Notes:

- 1 = VES restarted.
- 2 = VES manually shut down.
- 3 = Trunkline 2 brought into system.
- 4 = Collected monthly influent and effluent samples for laboratory analysis.

System operating under SCAQMD Permit #G52288

Vapor extraction wells on line this month (grouped by location):

Central Area - (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34), (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-20, TFR-23, TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, TFR-19, TFR-22, TFR-25), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12); Eastern Area - (RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10); Southern Area - (RW-30), (VEW-40, RW-26, RW-28), (RW-29), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49).

- VES = Soil vapor extraction system
- scfm = Standard cubic feet per minute
- ppmv = Parts per million by volume
- in. Hg = Inches of mercury
- °F = Degrees Fahrenheit
- lb = Pounds

- A = Reading measured using Dwyer DS-300 flow sensor.
- B = Concentrations obtained with a calibrated organic vapor analyzer.
- C = Concentrations correlated to laboratory data and expressed as hexane.
- D = Hydrocarbon removal is calculated using analytical laboratory result for GRO (if not detected, half the detection limit is used) from samples collected this month (laboratory report attached).

- NA = Not available
- = Not applicable or not measured
- * = Operational values interpolated from chart recorder data or previous monitoring event.



TABLE 5B
Thermal Oxidizer Vapor Extraction System Operations Summary - February
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Data Source	Notes	VES Hour Meter Reading (hours)	VES Process Flow ^A (scfm)	VES Manifold Vacuum (in. WC)	Oxidizer Inlet Temperature TE1 Excess Controller (°F)	Laboratory Process GRO Concentration (ppmv)	Field Inlet Process Oxidizer Concentration ^{B,C} (ppmv)	Field Effluent Concentration ^{B,C} (ppmv)	Cumulative Vapor-Phase GRO Removed ^D (lb)
02/01/21	*		10,942	920	--	--	--	--	--	278,951
02/02/21	*		10,966	920	--	--	--	--	--	279,286
02/03/21	*		10,991	920	--	--	--	--	--	279,621
02/04/21	Technician		11,015	907	62	1,451	--	736	30	279,951
02/05/21	*		11,039	907	--	--	--	--	--	280,279
02/06/21	*		11,063	907	--	--	--	--	--	280,608
02/07/21	*		11,088	907	--	--	--	--	--	280,936
02/08/21	*		11,112	907	--	--	--	--	--	281,265
02/09/21	*		11,136	907	--	--	--	--	--	281,593
02/10/21	Technician		11,160	862	62	1,454	--	644	25	281,905
02/11/21	*		11,184	862	--	--	--	--	--	282,215
02/12/21	*		11,208	862	--	--	--	--	--	282,525
02/13/21	*		11,232	862	--	--	--	--	--	282,835
02/14/21	*		11,256	862	--	--	--	--	--	283,145
02/15/21	*		11,280	862	--	--	--	--	--	283,455
02/16/21	*		11,304	862	--	--	--	--	--	283,765
02/17/21	*		11,328	862	--	--	--	--	--	284,075
02/18/21	*		11,352	862	--	--	--	--	--	284,385
02/19/21	Technician	1	11,376	788	--	1,452	--	--	--	284,669
02/20/21	Offline		11,376	--	--	--	--	--	--	284,669
02/21/21	Offline		11,376	--	--	--	--	--	--	284,669
02/22/21	Technician	2	11,376	788	--	--	--	--	--	284,669
02/23/21	*		11,401	788	--	--	--	--	--	284,958
02/24/21	Technician	3	11,425	822	62	1,456	740	826	27	285,260
02/25/21	Technician		11,450	822	--	--	--	--	--	285,568
02/26/21	*		11,473	822	--	--	--	--	--	285,854
02/27/21	*		11,497	822	--	--	--	--	--	286,141
02/28/21	*		11,520	822	--	--	--	--	--	286,427

Cumulative Mass TPHg Removed by the VES ^D (lb)			
Period	February	Quarter 1 to Date	January 2018 to Date
Mass	7,811.2	13,603.2	294,268.5

$$Vapor-Phase\ TPHg\ Mass\ [lb] = \left(Conc. \left[\frac{\mu g}{L} \right] \right) \cdot \left(\frac{28.32\ L}{ft^3} \right) \cdot \left(\frac{1\ g}{1,000,000\ \mu g} \right) \cdot \left(\frac{1\ lb}{453.59\ g} \right) \cdot \left(Flow\ [scfm] \right) \cdot \left(\frac{60\ min}{hr} \right) \cdot \left(OpTime\ [hrs] \right)$$

Legend / Notes:

- 1 = VES manually shut down.
- 2 = VES restarted.
- 3 = Collected monthly influent and effluent samples for laboratory analysis.

System operating under SCAQMD Permit #G52288

Vapor extraction wells on line this month (grouped by location):

Central Area - (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34), (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-20, TFR-23, TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, TFR-19, TFR-22, TFR-25), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12); Eastern Area - (RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10); Southern Area - (RW-30), (VEW-40, RW-26, RW-28), (RW-29), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49).

- VES = Soil vapor extraction system
- scfm = Standard cubic feet per minute
- ppmv = Parts per million by volume
- in. Hg = Inches of mercury
- °F = Degrees Fahrenheit
- lb = Pounds

- A = Reading measured using Dwyer DS-300 flow sensor.
- B = Concentrations obtained with a calibrated organic vapor analyzer.
- C = Concentrations correlated to laboratory data and expressed as hexane.
- D = Hydrocarbon removal is calculated using analytical laboratory result for GRO (if not detected, half the detection limit is used) from samples collected this month (laboratory report attached).

- NA = Not available
- = Not applicable or not measured
- * = Operational values interpolated from chart recorder data or previous monitoring event.



TABLE 5C
Thermal Oxidizer Vapor Extraction System Operations Summary - March
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Data Source	Notes	VES Hour Meter Reading (hours)	VES Process Flow ^A (scfm)	VES Manifold Vacuum (in. WC)	Oxidizer Inlet Temperature TE1 Excess Controller (°F)	Laboratory Process GRO Concentration (ppmv)	Field Inlet Process Oxidizer Concentration ^{B,C} (ppmv)	Field Effluent Concentration ^{B,C} (ppmv)	Cumulative Vapor-Phase GRO Removed ^D (lb)
03/01/21	*		11,543	822	--	--	--	--	--	286,585
03/02/21	*		11,566	822	--	--	--	--	--	286,743
03/03/21	*		11,588	822	--	--	--	--	--	286,891
03/04/21	Technician		11,611	912	62	1,455	--	618	28	287,062
03/05/21	*		11,635	912	--	--	--	--	--	287,241
03/06/21	*		11,659	912	--	--	--	--	--	287,419
03/07/21	*		11,682	912	--	--	--	--	--	287,598
03/08/21	Technician	1	11,706	870	62	1,453	400	696	27	287,768
03/09/21	*		11,730	870	--	--	--	--	--	287,942
03/10/21	*		11,755	870	--	--	--	--	--	288,116
03/11/21	*		11,779	870	--	--	--	--	--	288,290
03/12/21	*		11,803	870	--	--	--	--	--	288,464
03/13/21	*		11,827	870	--	--	--	--	--	288,639
03/14/21	*		11,852	870	--	--	--	--	--	288,813
03/15/21	Technician		11,876	794	64	1,455	--	620	25	288,972
03/16/21	*		11,899	794	--	--	--	--	--	289,122
03/17/21	*		11,922	794	--	--	--	--	--	289,273
03/18/21	*		11,945	794	--	--	--	--	--	289,423
03/19/21	Technician	2	11,968	757	65	1,454	--	--	--	289,567
03/20/21	*		11,992	757	--	--	--	--	--	289,718
03/21/21	*		12,016	757	--	--	--	--	--	289,869
03/22/21	*		12,041	757	--	--	--	--	--	290,020
03/23/21	*		12,065	757	--	--	--	--	--	290,171
03/24/21	Technician		12,089	684	72	1,454	--	767	27	290,307
03/25/21	Technician	3	12,118	684	--	--	--	--	--	290,470
03/26/21	Offline	4	12,118	--	--	--	--	--	--	290,470
03/27/21	Offline		12,118	--	--	--	--	--	--	290,470
03/28/21	Offline		12,118	--	--	--	--	--	--	290,470
03/29/21	Technician	5	12,128	1,074	40	876	--	--	--	290,559
03/30/21	Technician		12,149	1,078	43	899	--	387	7	290,746
03/31/21	Technician	6	12,174	1,078	--	--	--	--	--	290,965

Cumulative Mass TPHg Removed by the VES ^A (lb)			
Period	March	Quarter 1 to Date	January 2018 to Date
Mass	4,537.2	18,140.4	298,805.7

$$\text{Vapor-Phase TPHg Mass [lb]} = \left(\text{Conc.} \left[\frac{\mu\text{g}}{\text{L}} \right] \right) \left(\frac{28.32 \text{ L}}{\text{ft}^3} \right) \left(\frac{1 \text{ g}}{1,000,000 \mu\text{g}} \right) \left(\frac{1 \text{ lb}}{453.59 \text{ g}} \right) \left(\text{Flow [scfm]} \right) \left(\frac{60 \text{ min}}{\text{hr}} \right) \left(\text{OpTime [hrs]} \right)$$

Legend / Notes:

- 1 = Collected monthly influent and effluent samples for laboratory analysis.
 - 2 = Trunklines 1 & 2 diverted to Carbon VES.
 - 3 = VES manually shut down.
 - 4 = Catalytic cell installed.
 - 5 = System restart.
 - 6 = Trunkline 1 brought into system.
- System operating under SCAQMD Permit #G52288

Vapor extraction wells on line this month (grouped by location):

Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-20, TFR-23, TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, TFR-19, TFR-22, TFR-25), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12), (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34); Eastern Area - (RW-1), (RW-7), (RW-8), (RW-13), (RW-3, RW-4, RW-9, RW-10); Southern Area - (RW-21, RW-23), (RW-30), (VEW-38, VEW-40, RW-26, RW-28), (RW-24, RW-25, RW-27, RW-33, RW-43), (RW-22, RW-29), (RW-35, RW-40), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50).

- VES = Soil vapor extraction system
- scfm = Standard cubic feet per minute
- ppmv = Parts per million by volume
- in. Hg = Inches of mercury
- °F = Degrees Fahrenheit
- lb = Pounds

- A = Reading measured using Dwyer DS-300 flow sensor.
- B = Concentrations obtained with a calibrated organic vapor analyzer.
- C = Concentrations correlated to laboratory data and expressed as hexane.
- D = Hydrocarbon removal is calculated using analytical laboratory result for GRO (if not detected, half the detection limit is used) from samples collected this month (laboratory report attached).

- NA = Not available
- = Not applicable or not measured
- * = Operational values interpolated from chart recorder data or previous monitoring event.



TABLE 6
Historical Summary of Analytical Vapor Sampling Results - Influent Thermal Oxidizer VES
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Sample Date	Notes	VES Wells On Line	Laboratory Analysis Methods	GRO Field OVA Reading	GRO		VOCs as Hexane ^A		Benzene		Ethylbenzene		MTBE		Toluene		o-Xylene		m,p-Xylenes		Total Xylenes	
				(ppmv)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)
01/11/18	1,2,3	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1, RW-9, RW-13, RW-18 and RW-26	8015M & 8260M	1,942	370	1500	380	1,500	<0.16	<0.50	<0.12	<0.50	<0.55	<2.0	<0.13	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5
03/14/18	2,4,5,6	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1, -4, -5, -7, -9, -10, -11, -13, -14, -18 and -26	8015M & 8260M	2,193	370	1500	380	1,500	0.41	1.3	<0.12	<0.50	<0.55	<2.0	<0.13	<0.50	<0.12	<0.50	<0.23	<1.0	<0.35	<1.5
04/02/18	2	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1, -4, -5, -7, -9, -10, -11, -13, -14, -18 and -26	8015M & 8260M	1,370	1,700	7,100	1,800	7,100	4.1	13	0.28	1.2	<0.55	<2.0	<0.13	<0.50	<0.12	<0.50	0.76	3.3	<0.35	<1.5
05/02/18	2	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1, -4, -5, -7, -9, -10, -11, -13, -14, -18 and -26	8015M & 8260M	1,380	780	3,200	820	3,200	3.0	9.6	<0.12	<0.50	<0.55	<2.0	<0.13	<0.50	<0.12	<0.50	0.28	1.2	<0.35	<1.5
06/06/18	2,6,7	HW-1, HW-5, HW-7, VEW-39, RW-1, -4, -9, -10, -11, -13, -14 and -18	8015M & 8260M	1,531	1,000	4,100	990	4,100	4.1	13	0.17	0.72	<0.55	<2.0	<0.13	<0.50	<0.12	<0.50	0.53	2.3	<0.35	<1.5
07/02/18	2,6	RW-1, -4, -5, -9, -10, -11, -13, -18, -22, -29, -23, -24, -26, -27, -28, -30, -31, -32, -33, -36, -37, -40, -41, -42, -43, -44, -45, -47, -48, -49, -50, VEW-40	8015M & 8260M	890	560	2,300	560	2,300	2.2	7.1	<0.23	<1.0	<1.1	<4.0	<0.27	<1.0	<0.23	<1.0	0.55	2.4	<0.35	<1.5
08/06/18	2,6	RW-1, -4, -5, -9, -10, -11, -13, -18, -22, -29, -23, -24, -26, -27, -28, -30, -31, -32, -33, -36, -37, -40, -41, -42, -43, -44, -45, -47, -48, -49, -50, VEW-40	8015M & 8260M	876	710	2,900	710	2,900	0.88	2.8	0.23	1.0	<0.55	<2.0	0.58	2.2	0.25	1.1	0.92	4.0	<0.35	<1.5
09/13/18	2,6	RW-1, -4, -5, -9, -10, -11, -13, -18, -22, -29, -23, -24, -26, -27, -28, -30, -31, -32, -33, -36, -37, -40, -41, -42, -43, -44, -45, -47, -48, -49, -50, VEW-40	8015M & 8260M	935	930	3,800	930	3,800	1.9	6.0	0.41	1.8	<0.28	<1.0	0.34	1.3	0.18	0.77	0.94	4.1	<0.35	<1.5
10/29/18	2,6	RW-1, -4, -5, -9, -10, -11, -14, -18, -22, -23, -24, -26, -27, -28, -29, -30, -31, -32, -33, -35, -36, -37, -38, -40, -41, -42, -44, -45, -47, -48, -49, -50, VEW-40	8015M & 8260M	791	440	1,800	390	1,800	0.97	3.1	<0.12	<0.5	<0.55	<2.0	<0.13	<0.5	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5
11/14/18	2,6	RW-1, -4, -5, -9, -10, -11, -14, -18, -22, -23, -24, -26, -27, -28, -29, -30, -31, -32, -33, -35, -36, -37, -38, -40, -41, -42, -44, -45, -47, -48, -49, -50, VEW-40	8015M & 8260M	794	640	2,600	560	2,600	1.6	5.1	0.18	0.77	<0.55	<2.0	<0.13	<0.5	<0.12	<0.5	0.41	1.8	<0.35	<1.5
12/17/18	2,6,8	RW-1, -4, -5, -9, -10, -11, -14, -18, -22, -23, -24, -26, -27, -28, -29, -30, -31, -32, -33, -35, -36, -37, -38, -40, -41, -42, -44, -45, -47, -48, -49, -50, VEW-40	8015M & 8260M	968	220	900	200	900	0.47	1.5	<0.12	<0.5	<0.55	<2.0	<0.13	<0.5	<0.12	<0.5	<0.23	<1.0	<0.38	<1.8
03/19/19	2,6,9	RW-1, -4, -5, -9, -10, -11, -18, -22, -23, -24, -26, -27, -28, -29, -30, -31, -32, -33, -35, -37, -40, -41, -42, -43, -44, -45, -47, -48, -49, and -50; VEW-40; TFR-5, -7, -9, -10, -11, -13, -16, -19, -21, -24, -26, -28, -30, -35, -36, and -37	8015M & 8260M	766	270	1,100	240	1,100	0.72	2.3	<0.12	<0.50	<0.55	<2.0	<0.13	<0.50	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5
04/03/19	2,6,9	RW-1, -4, -5, -9, -10, -11, -18, -22, -23, -24, -26, -27, -28, -29, -30, -31, -32, -33, -35, -37, -40, -41, -42, -43, -44, -45, -47, -48, -49, and -50; VEW-40; TFR-5, -7, -9, -10, -11, -13, -16, -19, -21, -24, -26, -28, -30, -35, -36, and -37	8015M & 8260M	1,984	210	860	190	860	0.28	0.91	<0.12	<0.50	<0.55	<2.0	<0.13	<0.50	<0.12	<0.5	<0.23	<1.0	<0.35	<1.5
04/22/19	2,6,9	RW-1, -4, -5, -9, -10, -11, -18, -22, -23, -24, -26, -27, -28, -29, -30, -31, -32, -33, -35, -37, -40, -41, -42, -43, -44, -45, -47, -48, -49, and -50; VEW-40; TFR-5, -7, -9, -10, -11, -13, -16, -19, -21, -24, -26, -28, -30, -35, -36, and -37	8015M & 8260M	2,410	660	2,700	600	2,700	2.9	9.2	0.28	1.2	<0.55	<2.0	<0.13	<0.50	0.13	0.58	0.41	1.8	0.54	2.38
05/06/19	2,6,9	RW-1, -4, -5, -9, -10, -11, -18, -22, -23, -24, -26, -27, -28, -29, -30, -31, -32, -33, -35, -37, -40, -41, -42, -43, -44, -45, -47, -48, -49, and -50; VEW-40; TFR-5, -7, -9, -10, -11, -13, -16, -19, -21, -24, -26, -28, -30, -35, -36, and -37	8015M & 8260M	1,860	710	2,900	630	2,900	3.8	12	0.46	2.0	<0.55	<2.0	<0.13	<0.50	<0.12	<0.50	0.64	2.8	0.64	2.8
06/06/19	2,6,9	RW-1, -4, -5, -9, -10, -11, -18, -22, -23, -24, -26, -27, -28, -29, -30, -31, -32, -33, -35, -37, -40, -41, -42, -43, -44, -45, -47, -48, -49, and -50; VEW-40; TFR-5, -7, -9, -10, -11, -12, -13, -14, -15, -16, -18, -19, -21, -22, -24, -26, -28, -29, -30, -32, -33, TF-17, TFR-18, TFR-19, TFR-22, TFR-25, TF-18, RTF-18-E, RTF-18-NW	8015M & 8260M	5,375	950	3,900	860	3,900	5.3	17	0.25	1.1	<0.55	<2.0	0.21	0.8	<0.12	<0.5	0.46	2.0	0.46	2.0
07/10/19	2,6,9	Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, RFR-19, TFR-22), (TFR-13, TFR-14, TFR-15, TFR-16), (TRF-5, TFR-7, TFR-9, TFR-10, TFR-12); Eastern Area - (RW-1, RW-11, RW-18, RW-13, RW-4, RW-5, RW-9, RW-10, TFR-21, TFR-26, TFR-27, TFR-28, TFR-34); Southern Area - (RW-23, RW-30, RW-31, RW-32, VEW-40, RW-26, RW-28, RW-24, RW-27, RW-33, RW-43, RW-22, RW-29, RW-45, RW-35, RW-40, RW-44, RW-36, RW-37, RW-41, RW-42, RW-47, RW-48, RW-49, RW-50).	8015M & 8260M	1,962	2,100	8,500	1,900	8,500	5.3	17	0.37	1.6	<0.55	<2.0	0.58	2.2	0.25	1.1	0.78	3.4	1.03	4.5



TABLE 6
Historical Summary of Analytical Vapor Sampling Results - Influent Thermal Oxidizer VES
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Sample Date	Notes	VES Wells On Line	Laboratory Analysis Methods	GRO Field OVA Reading	GRO		VOCs as Hexane ^A		Benzene		Ethylbenzene		MTBE		Toluene		o-Xylene		m,p-Xylenes		Total Xylenes			
				(ppmv)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)
08/05/19	6	Central Area - (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34), (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, RFR-19, TFR-22), (TFR-13, TFR-14, TFR-15, TFR-16), (TFR-7, TFR-9, TFR-12); Eastern Area - (RW-1), (RW-18), (RW-13), (RW-4, RW-5, RW-9, RW-10); Southern Area - (RW-23), (RW-30, RW-31, RW-32), (VEW-40, RW-26, RW-28), (RW-24, RW-27, RW-33, RW-43), (RW-22, RW-29, RW-45), (RW-35, RW-40, RW-44), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50).	8015M & 8260M	2,620	2,700	11,000	2,500	11,000	6.6	21	0.37	1.6	<0.55	<2.0	0.77	2.9	0.25	1.1	0.94	4.1	1.19	5.2		
09/09/19	6	Central Area - (TFR-21, TFR-26, TFR-27, TFR-34), (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-23, TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, RFR-19, TFR-22), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12); Eastern Area - (RW-1), (RW-13), (RW-14), (RW-4, RW-5, RW-9, RW-10); Southern Area - (RW-23), (RW-30, RW-31, RW-32), (VEW-40, RW-26, RW-28), (RW-24, RW-27, RW-33, RW-43), (RW-22, RW-29, RW-45), (RW-35, RW-40, RW-44), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50).	8015M & 8260M	2,180	2,300	9,600	2,100	9,600	5.0	16	1.0	4.4	<0.55	<2.0	0.72	2.7	0.28	1.2	1.6	6.9	7.18	8.1		
10/31/19		Central Area - (TFR-21, TFR-26, TFR-27, TFR-34), (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-23, TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, RFR-19, TFR-22), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12); Eastern Area - (RW-1), (RW-13, RW-14), (RW-4, RW-5, RW-9, RW-10); Southern Area - (RW-30, RW-31, RW-32), (VEW-38, VEW-40, RW-26, RW-28), (RW-33), (RW-35, RW-40, RW-44), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50).	8015M & 8260M	2,176	3,400	14,000	3,100	14,000	5.6	18	0.92	4.0	<0.55	<2.0	0.61	2.3	0.46	2.0	2.2	9.7	2.66	12		
11/20/19		Central Area - (TFR-21, TFR-26, TFR-27, TFR-34), (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-23, TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, RFR-19, TFR-22), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12); Eastern Area - (RW-1), (RW-13, RW-14), (RW-4, RW-5, RW-9, RW-10); Southern Area - (RW-30, RW-31, RW-32), (VEW-38, VEW-40, RW-26, RW-28), (RW-33), (RW-35, RW-40, RW-44), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50).	8015M & 8260M	1,290	3,200	13,000	2,800	13,000	2.0	6.5	0.83	3.6	<0.55	<2.0	0.53	2.0	0.39	1.7	1.3	5.8	1.69	7.5		
12/16/19		Central Area - (TFR-21, TFR-26, TFR-27, TFR-34), (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-23, TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, RFR-19, TFR-22), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12); Eastern Area - (RW-1), (RW-13, RW-14), (RW-4, RW-5, RW-9, RW-10); Southern Area - (RW-30, RW-31, RW-32), (VEW-38, VEW-40, RW-26, RW-28), (RW-33), (RW-35, RW-40, RW-44), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50).	8015M & 8260M	1,566	2,300	9,600	2,100	9,600	5.0	16	1.0	4.4	<0.55	<2.0	0.72	2.7	0.28	1.2	1.6	6.9	1.88	8.1		
1/15/2020		Central Area - (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34), (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-23, TFR-24, TFR-30, TFR-33), (TFR-17, TFR-18, RFR-19, TFR-22), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12); Eastern Area - (RW-1), (RW-7), (RW-13, RW-14), (RW-4, RW-9, RW-10); Southern Area - (RW-30, RW-31, RW-32), (VEW-38, VEW-40, RW-26, RW-28), (RW-33), (RW-35, RW-40), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50).	8015M & 8260M	1,446	2,400	10,000	2,300	10,000	2.20	7.10	0.69	3.00	<1.1	<4	0.93	3.50	0.62	2.70	1.70	7.40	2.32	10		
2/18/2020		Central Area - (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34), (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-23, TFR-24, TFR-30, TFR-33), (TFR-17, TFR-18, RFR-19, TFR-22), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12); Eastern Area - (RW-1), (RW-7), (RW-13, RW-14), (RW-4, RW-9, RW-10); Southern Area - (RW-30, RW-31, RW-32), (VEW-38, VEW-40, RW-26, RW-28), (RW-33), (RW-35, RW-40), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50).	8015M & 8260M	996	1,900	7,800	1,700	7,800	2.10	6.80	0.55	2.40	<.55	<2	0.80	3.00	0.55	2.40	1.40	6.20	1.95	8.6		
3/16/2020		Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-20, TFR-23, TFR-24, TFR-30, TFR-33), (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34), (TFR-29, TFR-32, TFR-35, TFR-36, TFR-37), (TFR-17, TFR-18, RFR-19, TFR-22, TFR-25), (TFR-11, TFR-13, TFR-14, TFR-15), (TFR-5, TFR-7, TFR-9, TFR-12); Eastern Area - (RW-1, RW-6, RW-15, RW-16, RW-17), (VEW-32, VEW-37, RW-2, RW-7, RW-11), (VEW-33, VEW-36, RW-8, RW-12, RW-18), (VEW-34, VEW-35, RW-13, RW-14), (RW-3, RW-4, RW-5, RW-9, RW-10); Southern Area - (RW-19, RW-20, RW-22, RW-29, RW-45), (RW-35, RW-38, RW-39, RW-40 RW-44), (RW-36, RW-37, RW-41, RW-42, RW-46), (RW-47, RW-48, RW-49, RW-50).	8015M & 8260M	864	1,198	4,900	313	1,100	1.94	6.20	0.41	1.80	<.55	<2	0.74	2.80	0.48	2.10	1.22	5.30	1.7	7.4		
4/15/2020		Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-20, TFR-23, TFR-24, TFR-30, TFR-33), (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34), (TFR-29, TFR-32, TFR-35, TFR-36, TFR-37), (TFR-17, TFR-18, RFR-19, TFR-22, TFR-25), (TFR-11, TFR-13, TFR-14, TFR-15), (TFR-5, TFR-7, TFR-9, TFR-12); Eastern Area - (RW-1, RW-6, RW-15, RW-16, RW-17), (VEW-32, VEW-37, RW-2, RW-7, RW-11), (VEW-33, VEW-36, RW-8, RW-12, RW-18), (VEW-34, VEW-35, RW-13, RW-14), (RW-3, RW-4, RW-5, RW-9, RW-10); Southern Area - (RW-19, RW-20, RW-22, RW-29, RW-45), (RW-35, RW-38, RW-39, RW-40 RW-44), (RW-36, RW-37, RW-41, RW-42, RW-46), (RW-47, RW-48, RW-49, RW-50).	8015M & 8260M	606	830	3,400	740	3,400	0.94	3.00	0.18	0.80	<.55	<2	0.42	1.60	0.25	1.10	0.55	2.40	0.8	3.5		



TABLE 6
Historical Summary of Analytical Vapor Sampling Results - Influent Thermal Oxidizer VES
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Sample Date	Notes	VES Wells On Line	Laboratory Analysis Methods	GRO	GRO		VOCs as Hexane ^A		Benzene		Ethylbenzene		MTBE		Toluene		o-Xylene		m,p-Xylenes		Total Xylenes	
				Field OVA Reading	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)
5/15/2020		Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-23, TFR-24, TFR-30, TFR-33), (TFR-17, TFR-18, TFR-19, TFR-22), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12); Eastern Area - (RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10); Southern Area - (RW-30, RW-31, RW-32), (VEW-40, RW-26, RW-28), (RW-33), (RW-22, RW-29), (RW-35, RW-40), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50).	8015M & 8260M	522	1,100	4,600	960	4,600	0.78	2.50	0.28	1.20	<.55	<2	0.48	1.80	0.37	1.60	0.88	3.80	1.25	5.4
6/22/2020		Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-23, TFR-24, TFR-30, TFR-33), (TFR-17, TFR-18, TFR-19), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12); Eastern Area - (RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10); Southern Area - (RW-30, RW-31, RW-32), (VEW-40, RW-26, RW-28), (RW-33), (RW-22, RW-29), (RW-35, RW-40), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50).	8015M & 8260M	708	1,900	7,700	1,700	7,700	1.50	4.90	0.20	0.86	<.55	<2	0.32	1.20	0.30	1.30	0.60	2.60	0.9	3.9
7/20/2020		Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-23, TFR-24, TFR-30, TFR-33), (TFR-17, TFR-18, TFR-19), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12), (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34); Eastern Area - (RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10); Southern Area - (RW-30, RW-31, RW-32), (VEW-40, RW-26, RW-28), (RW-33), (RW-22, RW-29), (RW-35, RW-40), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50).	8015 & 8260B	630	950	3,900	750	3,900	1.10	3.50	0.21	0.91	<.55	<2.0	0.42	1.60	0.48	2.10	0.71	3.10	1.19	5.2
9/14/2020		Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-23, TFR-24, TFR-30, TFR-33), (TFR-17, TFR-18, TFR-19), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12), (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34); Eastern Area - (RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10); Southern Area - (RW-30, RW-31, RW-32), (VEW-40, RW-26, RW-28), (RW-33), (RW-22, RW-29), (RW-35, RW-40), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50).	8015 & 8260B	748	1,900	7,700	1,400	7,700	3.40	11.00	0.35	1.50	<.55	<2.0	0.40	1.50	0.35	1.50	0.85	3.70	1.2	5.2
10/5/2020		Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-23, TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, TFR-19, TFR-22, TFR-25), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12), (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34); Eastern Area - (RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10); Southern Area - (RW-30, RW-31, RW-32), (VEW-40, RW-26, RW-28), (RW-33), (RW-22, RW-29), (RW-35, RW-40), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50).	8015 & 8260B	582	1,300	5,300	970	5,300	1.20	3.90	0.22	0.96	<.55	<2.0	0.58	2.20	0.25	1.10	0.62	2.70	0.87	3.8
11/4/2020		Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-20, TFR-23, TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, TFR-19, TFR-22, TFR-25), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12), (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34); Eastern Area - (RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10); Southern Area - (RW-30), (VEW-40, RW-26, RW-28), (RW-29), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49).	8015 & 8260B	554	1,900	7,900	1,400	7,900	1.20	3.90	0.32	1.40	<.55	<2.0	0.85	3.20	0.35	1.50	0.81	3.50	1.16	5.0
12/7/2020		Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-20, TFR-23, TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, TFR-19, TFR-22, TFR-25), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12), (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34); Eastern Area - (RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10); Southern Area - (RW-30), (VEW-40, RW-26, RW-28), (RW-29), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49).	8015 & 8260B	512	1,300	5,500	1,000	5,500	0.94	3.00	0.35	1.50	<.55	<2.0	0.74	2.80	0.37	1.60	0.85	3.70	1.22	5.3

TABLE 6
Historical Summary of Analytical Vapor Sampling Results - Influent Thermal Oxidizer VES
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Sample Date	Notes	VES Wells On Line	Laboratory Analysis Methods	GRO Field OVA Reading	GRO		VOCs as Hexane ^A		Benzene		Ethylbenzene		MTBE		Toluene		o-Xylenes		m,p-Xylenes		Total Xylenes	
				(ppmv)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)
1/28/2021		Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-20, TFR-23, TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, TFR-19, TFR-22, TFR-25), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12), (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34); Eastern Area - (RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10); Southern Area -(RW-30), (VEW-40, RW-26, RW-28), (RW-29), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49).	8015 & 8260B	782	1,400	5,600	1,000	5,600	1.80	5.80	0.41	1.80	<.55	<2.0	0.40	1.50	0.32	1.40	0.99	4.30	1.31	5.7
2/24/2021		Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-20, TFR-23, TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, TFR-19, TFR-22, TFR-25), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12), (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34); Eastern Area - (RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10); Southern Area -(RW-30), (VEW-40, RW-26, RW-28), (RW-29), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49).	8015 & 8260B	826	980	4,000	740	4,000	1.40	4.60	0.41	1.80	<.55	<2.0	0.42	1.60	0.25	1.10	0.92	4.00	1.17	5.1
3/8/2021		Central Area - (TF-18, RTF-18-E, RTF-18-W, RTF-18-NW, RTF-18-NNW), (TFR-20, TFR-23, TFR-24, TFR-30, TFR-33), (TFR-29), (TFR-17, TFR-18, TFR-19, TFR-22, TFR-25), (TFR-13, TFR-14, TFR-15), (TFR-7, TFR-9, TFR-12), (TFR-21, TFR-26, TFR-27, TFR-28, TFR-34); Eastern Area - (RW-1), (RW-7), (RW-8), (RW-13), (RW-3, RW-4, RW-9, RW-10); Southern Area - (RW-21, RW-23), (RW-30), (VEW-38, VEW-40, RW-26, RW-28), (RW-24, RW-25, RW-27, RW-33, RW-43), (RW-22, RW-29), (RW-35, RW-40), (RW-36, RW-37, RW-41, RW-42), (RW-47, RW-48, RW-49, RW-50)	8015 & 8260B	696	540	2,200	400	2,200	1.80	5.60	0.46	2.00	<.55	<2.0	0.58	2.20	0.28	1.20	0.94	4.10	1.22	5.3

Legend / Notes:

VES = Vapor extraction system
 GRO = Gasoline range organics
 MTBE = Methyl tertiary-butyl ether
 OVA = Organic Vapor Analyzer (calibrated or correlated to Hexane)
 ppmv = Parts per million by volume
 µg/L = Micrograms per liter
 <1 = Not detected at or above the Method Reporting Limit (MRL) shown.
 -- = Not available or not analyzed

- Reported concentrations are shown in bold.

- A = Laboratory reporting Gasoline Range Organics (GRO) as Hexane prior to 11-05-20.
- 1 = Temporary thermal oxidizer VES started on 01/08/18.
- 2 = VES operations limited to daytime hours due to noise concerns from nearby residents.
- 3 = Noise abatement measures implemented in an effort to address concerns from nearby residents.
- 4 = Vapor extraction wells RW-3 through RW-6, RW-8, RW-11, RW-12, and RW-14 through RW-17 brought online 02/14/18 following the completion of installation and tie-in activities per SGI's June 30, 2017 *Remediation Well Installation Update Report*.
- 5 = No sample collected for analysis during February 2018 due to site condition and system operation status.
- 6 = Measured individual well concentrations and opened and/or closed select vapor extraction wells (see Table 9A through 9D for details).
- 7 = Vapor extraction wells RW-19, RW-20, RW-22, RW-24, RW-27 through RW-30, RW-32, RW-33, RW-35 through RW-38, and RW-40 through RW-50 brought online 6/27/18 following the completion of tie-in activities per SGI's June 30, 2017 report.
- 8 = Temporary thermal oxidizer VES shutdown on 01/08/2019.
- 9 = Permanent thermal oxidizer VES started on 03/13/2019.

TABLE 7A
Summary of LNAPL Removal in Well GMW-62 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing ^A (gallons)	LNAPL Removed with Socks ^A (pounds)	LNAPL Removed with Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^{A, B} (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^{A, B} (pounds)
<i>End of Fourth Quarter 2020:</i>							147.6	1,010.0
01/07/21	--	34.95	--	0.0	0.8	0.1	147.7	1,010.7
01/15/21	--	34.97	--	0.0	0.8	0.1	147.8	1,011.5
01/20/21	--	35.07	--	0.0	0.8	0.1	147.9	1,012.2
01/27/21	--	35.02	--	0.0	0.8	0.1	148.0	1,013.0
02/10/21	--	35.05	--	0.0	0.8	0.1	148.1	1,013.7
02/18/21	--	25.26	--	0.0	1.3	0.2	148.3	1,015.0
03/03/21	--	34.94	--	0.0	0.3	0.0	148.4	1,015.3
03/17/21	--	35.23	--	0.0	0.4	0.1	148.4	1,015.6
03/24/21	--	35.13	--	0.0	0.4	0.1	148.5	1,016.0
Cumulative for the Reporting Period^A:				0.0	6.1	0.9	0.9	6.1
Cumulative Beginning January 2014^{A, B}:				112.0	250.1	36.5	148.5	1,016.0

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Difference between additive sum and displayed cumulative value is a result of rounding and/or significant figures.

B = Cumulative LNAPL removed since January 2014. LNAPL removed prior to January 2014 can be found in previously submitted Remediation Progress Reports.



TABLE 7B
Summary of LNAPL Removal in Well GMW-68 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing ^A (gallons)	LNAPL Removed with Socks ^A (pounds)	LNAPL Removed with Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^{A, B} (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^{A, B} (pounds)
<i>End of Fourth Quarter 2020:</i>							87.8	600.7
01/07/21	--	34.12	--	0.0	2.1	0.3	88.1	602.8
01/15/21	--	34.08	--	0.0	2.3	0.3	88.4	605.1
01/20/21	--	34.22	--	0.0	1.4	0.2	88.6	606.5
01/27/21	--	34.16	--	0.0	2.6	0.4	89.0	609.1
02/10/21	--	34.22	--	0.0	2.6	0.4	89.4	611.7
02/18/21	--	34.33	--	0.0	1.9	0.3	89.7	613.6
03/03/21	--	34.22	--	0.0	2.9	0.4	90.1	616.5
03/17/21	--	34.35	--	0.0	3.1	0.5	90.5	619.6
03/24/21	--	34.15	--	0.0	2.1	0.3	90.8	621.7
Cumulative for the Reporting Period^A:				0.0	21.0	3.1	3.1	21.0
Cumulative Beginning October 2016^{A, B}:				33.5	393.9	57.5	90.8	621.7

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Difference between additive sum and displayed cumulative value is a result of rounding and/or significant figures.

B = Cumulative LNAPL removed since October 2016 following installation of well during July 2015 (no measureable product from July 2015 through February 2017).



TABLE 7C
Summary of LNAPL Removal in Well GMW-7 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via, Pumping, Bailing and Socks ^A (pounds)
No Product Removal Via Bailing, Skimming, or Absorbant Socks During 1st Quarter 2021								
Cumulative for the Reporting Period:				0.0	0.0	0.0	0.0	0.0
Cumulative Beginning December 2014 ^A:				8.0	135.6	19.8	27.8	190.4

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since December 2014. LNAPL removed prior to December 2014 can be found in previously submitted Remediation Progress Reports.



TABLE 7D
Summary of LNAPL Removal in Well TF-19 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Pumping, Bailing and Socks ^A (pounds)
No Product Removal Via Bailing, Skimming, or Absorbant Socks During 1st Quarter 2021								
Cumulative for the Reporting Period:				0.0	0.0	0.0	0.0	0.0
Cumulative Beginning June 2015 ^A:				6.75	199.1	29.08	35.8	245.2

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since June 2015 (no measureable product from January 2014 to May 2015). LNAPL removed prior to January 2014 can be found in previously submitted Remediation Progress Reports.



TABLE 7E
Summary of LNAPL Removal in Well TFR-9 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								
Cumulative for the Reporting Period:				0.0	0.0	0.0	0.0	0.0
Cumulative Beginning October 2018 ^{A,B}:				150.0	0.0	0.0	150.0	1,026.5

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since October 2018 following hookup of well to a newly installed controller.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of expanded product recovery system operations that began on October 8, 2018 (skimming from well TFR-9 initiated on October 8, 2018 but pump was manually shutdown on January 16, 2019 to allow for LNAPL recovery and resumed operating from February 7-27, 2019; Pump remained off-line through June 2019 based on regular gauging data showing little to no measureable product in the well).



TABLE 7F
Summary of LNAPL Removal in Well GMW-18 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								
Cumulative for the Reporting Period ^B:				0.0	0.0	0.0	0.0	0.0
Cumulative Beginning March 2017 ^A:				101.1	75.8	11.1	112.2	767.6

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since March 2017. LNAPL removed prior to March 2017 can be found in previously submitted Remediation Progress Reports.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of expanded product recovery system operations that began on October 8, 2018 (skimming from well GMW-18 initiated on October 8, 2018; pump manually shutdown on January 16, 2019 due to insufficient yield and remained off-line through June 2019).



TABLE 7G
Summary of LNAPL Removal in Well TFR-12 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								
Cumulative for the Reporting Period:				0.0	0.0	0.0	0.0	0.0
Cumulative Beginning April 2018 ^{A,B}:				284.3	0.0	0.0	284.3	1,945.7

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since April 2018 following installation of well during December 2017.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of a product recovery system that started operating on August 8, 2016 (skimming from well TFR-12 initiated on April 23, 2018, and temporarily discontinued from September 5, 2018 to October 8, 2018 pending hookup to a new controller; Pump manually shutdown on March 11, 2019 due to insufficient yield and remained off-line through June 2019).

TABLE 7H
Summary of LNAPL Removal in Well TFR-14 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								
Cumulative for the Reporting Period:				0.0	0.0	0.0	0.0	0.0
Cumulative Beginning April 2018 ^{A,B}:				2.1	0.0	0.0	2.1	14.2

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since April 2018 following installation of well during December 2017.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of a product recovery system that started operating on August 8, 2016 (skimming from well TFR-12 initiated on April 23, 2018, and temporarily discontinued from September 5, 2018 to October 8, 2018 pending hookup to a new controller; Pump manually shutdown on March 11, 2019 due to insufficient yield and remained off-line through June 2019).

TABLE 71
Summary of LNAPL Removal in Well TF-15 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								
Cumulative for the Reporting Period ^B:				0.0	0.0	0.0	0.0	0.0
Cumulative Beginning October 2016 ^A:				187.1	52.5	7.7	194.8	1,332.9

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since October 2016. No LNAPL removed previously during 2016 or throughout 2015 due to excavation project (January 2015 - March 2017) inadvertently resulting in burial of well head which was located during October 2016. LNAPL removed prior to well head being buried can be found in previously submitted Remediation Progress Reports.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of expanded product recovery system operations that began on October 8, 2018 (skimming from well TF-15 initiated on October 8, 2018 but pump was manually shutdown on November 15, 2018 to allow for LNAPL recovery, and also operated from November 28, 2018 to March 11, 2019 and April 17, 2019 to May 2, 2019; Pump has otherwise remained off-line due to insufficient yield).



TABLE 7J
Summary of LNAPL Removal in Well TFR-15 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								
Cumulative for the Reporting Period:				0.0	0.0	0.0	0.0	0.0
Cumulative Beginning October 2018 ^{A,B}:				23.0	0.0	0.0	23.0	157.4

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since October 2018 following hookup of well to a newly installed controller.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of expanded product recovery system operations that began on October 8, 2018 (skimming from well TFR-15 initiated on October 18, 2018 but pump was manually shutdown on November 15, 2018 to allow for LNAPL recovery with operations resuming from November 28, 2018 to December 7, 2018, and again from December 19, 2018 to February 27, 2019; Pump remained off-line through June 2019 due to insufficient yield).

TABLE 7K
Summary of LNAPL Removal in Well TF-16 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								

Cumulative for the Reporting Period:	0.0	0.0	0.0	0.0	0.0
Cumulative Beginning March 2017 - June 2019 ^B:	323.0	0.0	0.0	323.0	2,210.4
Cumulative Beginning October 2016 ^A:	333.3	35.8	5.2	338.5	2,316.3

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since October 2016. No LNAPL removed previously during 2016 or throughout 2015 due to excavation project (January 2015 - March 2017) inadvertently resulting in burial of well head which was located during October 2016. LNAPL removed prior to well head being buried can be found in previously submitted Remediation Progress Reports.

B = Well hooked up to product recovery system on March 3, 2017 (i.e., all LNAPL removed subsequent to this date achieved via pumping) with skimmer manually shutdown on March 28, 2018 to allow for LNAPL recovery; Operations resumed on an intermittent basis starting on July 19, 2018, and regularly from September 19, 2018 to October 3, 2018, and again from December 14, 2018 to March 11, 2019 and May 2-6, 2019. Pump has otherwise remained off-line due to insufficient yield.



TABLE 7L
Summary of LNAPL Removal in Well GW-14R - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								
Cumulative for the Reporting Period:				0.0	0.0	0.0	0.0	0.0
Cumulative Beginning October 2018 ^{A,B}:				360.0	0.0	0.0	360.0	2,463.6

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since October 2018 following hookup of well to a newly installed controller.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of expanded product recovery system operations that began on October 8, 2018 (skimming from well GW-14R initiated on October 8, 2018 but pump was manually shutdown on April 17, 2019 to allow for LNAPL recovery, and only otherwise operated briefly during the reporting period from May 2-6, 2019 to evaluate the well yield).

TABLE 7M
Summary of LNAPL Removal in Well TFR-18 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								
Cumulative for the Reporting Period:				0.0	0.0	0.0	0.0	0.0
Cumulative Beginning October 2018 ^{A,B}:				18.1	0.0	0.0	18.1	124.2

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since October 2018 following hookup of well to a newly installed controller.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of expanded product recovery system operations that began on October 8, 2018 (skimming from well GW-14R initiated on October 8, 2018 but pump was manually shutdown on April 17, 2019 to allow for LNAPL recovery, and only otherwise operated briefly during the reporting period from May 2-6, 2019 to evaluate the well yield).

TABLE 7N
Summary of LNAPL Removal in Well TFR-22 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
<i>End of Fourth Quarter 2020:</i>							255.4	1,747.8
01/07/21	33.59	34.08	0.49	0.0	--	--	255.4	1,747.8
01/15/21	31.28	32.52	1.24	1.4	--	--	256.8	1,757.6
01/20/21	33.51	34.60	1.09	1.4	--	--	258.3	1,767.4
01/28/21	33.93	34.05	0.12	1.4	--	--	259.7	1,777.3
02/10/21	33.72	34.53	0.81	1.4	--	--	261.1	1,787.1
02/17/21	33.10	36.43	3.33	4.3	--	--	265.5	1,816.6
03/03/21	33.22	37.11	3.89	4.3	--	--	269.8	1,846.1
03/09/21	32.86	36.14	3.28	4.3	--	--	274.1	1,875.5
03/17/21	33.13	35.32	2.19	2.9	--	--	276.9	1,895.2
03/24/21	32.51	36.88	4.37	4.3	--	--	281.3	1,924.7
03/25/21	32.72	37.26	4.54	4.3	--	--	285.6	1,954.1
Cumulative for the Reporting Period:				30.2	0.0	0.0	30.2	206.3
Cumulative Beginning October 2018 ^{A,B}:				285.6	0.0	0.0	285.6	1,954.1

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since October 2018 following hookup of well to a newly installed controller.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of expanded product recovery system operations that began on October 8, 2018 (skimming from well TFR-22 initiated on October 8, 2018 but pump was manually shutdown on November 28, 2018 to allow for LNAPL recovery; Pumping resumed on from December 14, 2018 to April 17, 2019, and May 30, 2019 through June 30, 2019).



TABLE 70
Summary of LNAPL Removal in Well TFR-24 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								
Cumulative for the Reporting Period:				0.0	0.0	0.0	0.0	0.0
Cumulative Beginning October 2018 ^{A,B}:				110.1	0.0	0.0	110.1	753.3

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since October 2018 following hookup of well to a newly installed controller.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of expanded product recovery system operations that began on October 8, 2018 (skimming from well TFR-24 initiated on October 8, 2018 but pump was manually shutdown on November 28, 2018 to allow for LNAPL recovery, and also operated from December 7-27, 2018, January 4-7, 2019, January 11, 2019 to February 7, 2019, and February 19, 2019 to March 11, 2019; Pump remained off-line through June 2019 due to insufficient yield; pump manually shutdown on February 14, 2020 due to insufficient yield).



TABLE 7P
Summary of LNAPL Removal in Well TFR-29 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing ^A (gallons)	LNAPL Removed with Socks ^A (pounds)	LNAPL Removed with Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^{A,B} (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^{A,B} (pounds)
<i>End of Fourth Quarter 2020:</i>							896.3	6,133.3
01/07/21	33.57	35.47	1.90	2.9	--	--	899.1	6,152.9
01/15/21	30.60	33.91	3.31	4.3	--	--	903.4	6,182.4
01/20/21	32.80	34.70	1.90	2.9	--	--	906.3	6,202.1
01/28/21	33.19	33.24	0.05	1.4	--	--	907.7	6,211.9
02/10/21	33.32	34.92	1.60	2.9	--	--	910.6	6,231.5
02/17/21	33.72	35.43	1.71	2.9	--	--	913.5	6,251.2
03/03/21	32.95	34.05	1.10	1.4	--	--	914.9	6,261.0
03/09/21	33.05	34.11	1.06	1.4	--	--	916.4	6,270.8
03/17/21	32.52	34.09	1.57	2.9	--	--	919.2	6,290.5
03/24/21	33.64	35.92	2.28	2.9	--	--	922.1	6,310.2
Cumulative for the Reporting Period ^A:				25.8	0.0	0.0	25.8	176.9
Cumulative Beginning April 2018 ^{A,B,C,D}:				922.1	0.0	0.0	922.1	6,310.2

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Difference between additive sum and displayed cumulative value is a result of rounding and/or significant figures.

B = Cumulative LNAPL removed since April 2018 following installation of well during November 2017.

C = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of a product recovery system that started operating on August 8, 2016 (skimming from well TFR-29 initiated on April 23, 2018, and temporarily discontinued from September 5, 2018 to October 8, 2018 pending hookup to a new controller).

D = Skimmer shutdown on February 21, 2020 due to insufficient yield.



TABLE 7Q
Summary of LNAPL Removal in Well TFR-33 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								
Cumulative for the Reporting Period:				0.0	0.0	0.0	0.0	0.0
Cumulative Beginning October 2018 ^{A,B}:				123.0	0.0	0.0	123.0	841.7

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since October 2018 following hookup of well to a newly installed controller.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of expanded product recovery system operations that began on October 8, 2018 (skimming from well TFR-33 initiated on October 8, 2018 but pump was manually shutdown on December 7, 2018 to allow for LNAPL recovery, and also operated from December 19, 2018 through February 27, 2019; Pump remained off-line through June 2019 due to insufficient yield).

TABLE 7R
Summary of LNAPL Removal in Well RTF-18-E - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								

Cumulative for the Reporting Period:	0.0	0.0	0.0	0.0	0.0	0.0
Cumulative Beginning May 2016 - July 2016 ^A:	47.5	0.0	0.0	47.5	325.1	0.0
Cumulative Beginning August 2016 - September 2019 ^B:	593.4	0.0	0.0	593.4	4,061.5	0.0
Cumulative Beginning May 2016 ^A:	679.1	0.0	0.0	679.1	4,647.1	0.0

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since May 2016 following installation of well during December 2015.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of a product recovery system that started operating on August 8, 2016 (skimming from well RTF-18-E initiated on August 11, 2016).

* = Well RTF-18-E was off-line from February 15, 2017 to October 4, 2017 to allow for LNAPL recovery which continued to be adequate for effective removal via skimming until March 15, 2018 when the pump was again shutdown and remained off-line until December 27, 2018 (pumping resumed until February 27, 2019 with no subsequent operations through June 2019 based on regular gauging data showing little to no measureable product in the well); pump shutdown on February 14, 2020 due to insufficient yield.

TABLE 7S
Summary of LNAPL Removal in Well RTF-18-NW - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								

Cumulative for the Reporting Period:	0.0	0.0	0.0	0.0	0.0	0.0
Cumulative Beginning May 2016 - July 2016 ^A:	76.5	0.0	0.0	76.5	523.5	0.0
Cumulative Beginning August 2016 - June 2019 ^B:	2,961.0	0.0	0.0	2,961.0	20,262.6	0.0
Cumulative Beginning May 2016 ^A:	3,039.6	0.0	0.0	3,039.6	20,800.5	0.0

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since May 2016 following installation of well during December 2015.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of a product recovery system that started operating on August 8, 2016 (skimming from well RTF-18-NW initiated on August 11, 2016).

* = Well RTF-18-NW was off-line from February 15, 2017 to August 10, 2017 to allow for LNAPL recovery which continued to be adequate for effective removal via skimming until March 11, 2019 with no subsequent operations through June 2019 based on regular gauging data showing little to no measureable product in the well.

TABLE 7T
Summary of LNAPL Removal in Well RTF-18-N - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								

Cumulative for the Reporting Period:	0.0	0.0	0.0	0.0	0.0	0.0
Cumulative Beginning April 2016 - July 2016 ^A:	47.5	0.0	0.0	47.5	325.1	0.0
Cumulative Beginning August 2016 - June 2019 ^B:	497.5	0.0	0.0	497.5	3,404.5	0.0
Cumulative Beginning April 2016 ^A:	545.0	0.0	0.0	545.0	3,729.6	0.0

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since April 2016 following installation of well during December 2015.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of a product recovery system that started operating on August 8, 2016 (skimming from well RTF-18-N initiated on August 11, 2016).

* = Well RTF-18-N was off-line from September 14, 2016 to October 10, 2017, and November 7, 2017 to January 7, 2018, to allow for LNAPL recovery (pumping resumed until February 27, 2019 with no subsequent operations through June 2019 based on regular gauging data showing little to no measureable product in the well).

TABLE 7U
Summary of LNAPL Removal in Well TF-18 - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								

Cumulative for the Reporting Period:	0.0	0.0	0.0	0.0	0.0
Cumulative Beginning January 2014 - July 2016 ^A:	266.1	307.3	44.9	311.0	2,128.1
Cumulative Beginning August 2016 - June 2019 ^B:	2,003.0	0.0	0.0	2,003.0	13,707.0
Cumulative Beginning January 2014 ^A:	2,271.2	307.3	44.9	2,316.1	15,849.3

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed prior to January 2014 can be found in previously submitted Remediation Progress Reports.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of a product recovery system that started operating on August 8, 2016 (skimming initially isolated to well TF-18 for testing purposes with other wells coming online August 11, 2016).

* = Product recovery system off-line from January 9-27, 2017 due to full storage tank, and well TF-18 resumed operating after tank was emptied until February 8, 2017 when skimmer was manually shutdown to allow for LNAPL recovery (pumping resumed from August 10, 2017 to January 25, 2019 with no subsequent operations through June 2019 based on regular gauging data showing little to no measureable product in the well).

TABLE 7V
Summary of LNAPL Removal in Well RTF-18-NNW - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								

Cumulative for the Reporting Period:	0.0	0.0	0.0	0.0	0.0	0.0
Cumulative Beginning April 2016 - July 2016 ^A:	54.5	0.0	0.0	54.5	373.0	0.0
Cumulative Beginning August 2016 - June 2019 ^B:	62.5	0.0	0.0	62.5	427.7	0.0
Cumulative Beginning April 2016 ^A:	117.0	0.0	0.0	117.0	800.7	0.0

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since April 2016 following installation of well during December 2015.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of a product recovery system that started operating on August 8, 2016 (skimming from well RTF-18-NNW initiated on September 14, 2016 (off-line since January 9, 2017).

* = Product recovery system off-line from January 9-27, 2017 due to full storage tank, and well RTF-18-NNW has since remained off-line to allow for LNAPL recovery which decreased from January 2017 to March 2017 with no measurable product from early March 2017 through mid-September 2017, and less than 0.3 foot at the end of 2017 (note that product thicknesses temporarily exhibited a further increasing overall trend during 2018 that has since reversed with little to no measurable product since late February 2019).

TABLE 7W
Summary of LNAPL Removal in Well RTF-18-W - First Quarter 2021
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Depth to LNAPL (feet btc)	Depth to Water (feet btc)	Measured LNAPL Thickness (feet)	LNAPL Removed Via Vacuum Truck, Pumping and/or Bailing (gallons)	LNAPL Removed with Socks (pounds)	LNAPL Removed with Socks (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (gallons)	Cumulative LNAPL Removed Via Vacuum Truck, Pumping, Bailing and Socks ^A (pounds)
No Pumping/Skimming from Product Recovery System Well During 1st Quarter 2021								

Cumulative for the Reporting Period:	0.0	0.0	0.0	0.0	0.0	0.0
Cumulative Beginning April 2016 - July 2016 ^A:	38.8	0.0	0.0	38.8	265.2	0.0
Cumulative Beginning August 2016 - June 2019 ^B:	371.0	0.0	0.0	371.0	2,538.8	0.0
Cumulative Beginning April 2016 ^A:	409.8	0.0	0.0	409.8	2,804.0	0.0

Legend / Notes:

LNAPL = Light non-aqueous phase liquids feet btc = Feet below top of casing Sock = LNAPL absorbent sock -- = Not applicable

A = Cumulative LNAPL removed since April 2016 following installation of well during December 2015.

B = Cumulative LNAPL removed from a pneumatically controlled skimmer installed as part of a product recovery system that started operating on August 8, 2016 (skimming from well RTF-18-W initiated on September 14, 2016).

* = Well RTF-18-W was off-line from December 9, 2016 to October 10, 2017 to allow for LNAPL recovery which continued to be adequate for effective removal via skimming until April 4, 2019 when the pump was again shutdown and remained off-line through June 2019 based on regular gauging data showing little to no measureable product in the well.

TABLE 8
Historical Summary of Analytical Groundwater Sampling Results - Influent GWETS
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Sample Date	Notes	GWETS Wells On Line	Laboratory Analysis Methods	TPHd	TPHg	Benzene	Toluene	Ethylbenzene	m,p-Xylenes	o-Xylene	TBA	MTBE	DIPE	ETBE	TAME
				(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)
04/22/08		--	--	--	--	71	25	17	42	30	14	4.6	<2.0	<2.0	<2.0
05/01/08		--	--	810	--	--	--	--	--	--	--	--	--	--	--
05/16/08		--	--	760	--	--	--	--	--	--	--	--	--	--	--
06/12/08		--	--	--	--	<0.50	<0.50	<0.50	<0.50	<0.50	25	7.7	<2.0	<2.0	<2.0
07/19/08		--	--	170	<100	27	0.77	7.0	13	7.9	<10	3.9	<2.0	<2.0	<2.0
09/03/08		--	--	--	--	--	--	--	--	--	<10	--	--	--	--
09/08/08		--	--	--	--	27	0.99	8.3	13	8.2	<10	3.1	<2.0	<2.0	<2.0
09/15/08		--	--	--	--	36	0.81	8.5	12	6.8	<10	3.8	<2.0	<2.0	<2.0
11/13/08		--	--	--	--	27	<0.50	2.0	12	5.6	<10	<0.50	<2.0	<2.0	<2.0
11/26/08		--	--	--	--	<0.50	<0.50	<0.50	1.3	0.61	16	5.6	<2.0	<2.0	<2.0
12/13/08		--	--	--	--	<0.50	<0.50	0.56	1.1	0.54	19	7.0	<2.0	<2.0	<2.0
01/09/09		--	--	--	--	<0.50	<0.50	<0.50	<0.50	<0.50	<10	<0.50	<2.0	<2.0	<2.0
03/05/09		--	--	<100	--	21	<0.50	2.5	7.2	3.1	12	3.1	<2.0	<2.0	<2.0
03/18/09		--	--	200	170	21	<0.50	2.9	7.0	4.5	13	3.3	<2.0	<2.0	<2.0
05/15/09		--	--	<100	--	--	--	--	--	--	--	--	--	--	--
06/04/09		--	--	190	--	26	<0.50	3.3	10	6.6	<10	4.8	<2.0	<2.0	<2.0
06/24/09		--	--	--	--	28	<0.50	2.5	7.6	4.2	12	4.4	<2.0	<2.0	<2.0
05/28/09		--	--	170	--	27	<0.50	2.6	7.9	4.5	<10	3.6	<2.0	<2.0	<2.0
11/19/09		--	--	<100	--	15	<0.50	1.3	5.8	2.9	5.6	2.3	1.2	<2.0	<2.0
10/26/10		--	--	--	--	20	<0.50	1.6	7.4	2.1	8.0	2.9	1.1	<2.0	<2.0
06/01/11		--	--	90	--	--	--	--	--	--	--	--	--	--	--
07/14/11		--	--	--	--	13	<0.50	2.3	6.2	3.0	6.7	1.6	<2.0	<2.0	<2.0
09/13/11		--	--	--	--	5.0	<0.50	0.37	3.4	0.99	<10	1.3	<2.0	<2.0	<2.0
09/22/11		--	--	--	--	5.5	<0.50	0.92	7.2	1.6	5.6	1.1	<2.0	<2.0	<2.0
10/19/11		--	--	--	--	8.2	<1.0	<1.0	<1.0	<1.0	<10	<1.0	<2.0	<2.0	<2.0
01/20/12		--	--	--	--	14	<0.50	2.8	7.8	1.2	16	1.3	0.42	<2.0	<2.0

TABLE 8
Historical Summary of Analytical Groundwater Sampling Results - Influent GWETS
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Sample Date	Notes	GWETS Wells On Line	Laboratory Analysis Methods	TPHd	TPHg	Benzene	Toluene	Ethylbenzene	m,p-Xylenes	o-Xylene	TBA	MTBE	DIPE	ETBE	TAME
				(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)
02/03/12		--	--	120	340	--	--	--	--	--	--	--	--	--	--
02/17/12		--	--	--	--	10	<0.50	1.5	7.4	1.2	15	1.2	0.39	<2.0	<2.0
02/24/12		--	--	180	--	26	<0.50	1.0	7.0	1.2	<10	1.2	0.41	<2.0	<2.0
03/02/12		--	--	--	--	23	<0.50	1.4	11	2.4	8.7	1.4	0.47	<2.0	<2.0
03/06/12		--	--	--	--	28	<0.50	1.0	9.0	1.7	13	1.1	0.37	<2.0	<2.0
06/15/12		--	--	--	--	39	13	17	88	26	<10	1.3	0.52	<2.0	<2.0
08/31/12		--	--	820	940	--	--	--	--	--	--	--	--	--	--
09/27/12		--	--	5,300	3,800	--	--	--	--	--	--	--	--	--	--
10/23/12		--	--	--	--	67	60	110	460	140	<10	<0.50	<2.0	<2.0	<2.0
01/31/13		--	--	3,600	--	--	--	--	--	--	--	--	--	--	--
05/01/13		--	--	6,300	5,500	20	4.7	8.0	41	14	4.8	0.56	<2.0	<2.0	<2.0
07/12/13		--	--	<100	<100	<0.50	<0.50	<0.50	<0.50	<0.50	<10	<0.50	<2.0	<2.0	<2.0
08/20/13		--	--	<100	<100	<0.50	<0.50	<0.50	<0.50	<0.50	<10	<0.50	<2.0	<2.0	<2.0
12/19/13		--	--	<100	<100	<0.50	<0.50	<0.50	<0.50	<0.50	<10	<0.50	<2.0	<2.0	<2.0
02/07/14		--	--	1,500	2,300	--	--	--	--	--	--	--	--	--	--
03/21/14		--	--	--	--	61	5.1	23	150	45	<10	0.87	<2.0	<2.0	<2.0
05/29/14	1	--	8015M & 8260B	--	--	29	1.0	30	180	45	<10	1.0	<2.0	<2.0	<2.0
07/09/14	2	GW-15, GW-16	8015M & 8260B	720	1,800	82	3.8	27	110	31	<7.0	<0.40	<0.50	<0.40	<0.30
08/13/14		GW-15, GW-16	8015M & 8260B	150	1,500	57	3.7	30	130	36	<7.0	0.77	<0.50	<0.40	<0.30
09/17/14		GW-15, GW-16	8015M & 8260B	800	3,500	23	0.73	20	170	40	<7.0	0.83	<0.50	<0.40	<0.30
10/20/14		GW-15, GW-16	8015M & 8260B	560	3,600	31	2.2	40	240	54	<7.0	0.6	<0.50	<0.40	<0.30
11/17/14	3,4,1	GW-15, GW-16	8015M & 8260B	260	1,400	21	0.71	10	62	18	<7.0	<0.40	<0.50	<0.40	<0.30
12/17/14	4,1	GW-15, GW-16	8015M & 8260B	190	880	23	0.66	8.8	48	14	<7.0	<0.40	<0.50	<0.40	<0.30
01/14/15	4,1	GW-15, GW-16	8015M & 8260B	4,600	3,800	150	2.8	29	130	37	<7.0	<0.40	<0.50	<0.40	<0.30
02/20/15	4,1	GW-15, GW-16	8015M & 8260B	2,500	8,100	230	9.8	220	880	220	<7.0	0.45	<0.50	<0.40	<0.30
03/27/15		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	620	980	9.9	<0.30	2.7	18	5.9	<7.0	1.0	<0.50	<0.40	<0.30

TABLE 8
Historical Summary of Analytical Groundwater Sampling Results - Influent GWETS
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Sample Date	Notes	GWETS Wells On Line	Laboratory Analysis Methods	TPHd	TPHg	Benzene	Toluene	Ethylbenzene	m,p-Xylenes	o-Xylene	TBA	MTBE	DIPE	ETBE	TAME
				(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)
05/11/15	5	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	<60	330	16	5.2	5.9	37	14	<7.0	0.58 J	<0.50	<0.40	<0.30
06/03/15		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	150	340	20	6.6	12	22	25	<7.0	0.52 J	<0.50	<0.40	<0.30
07/09/15		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	180	610	<0.20	<0.30	<0.20	<0.40	<0.30	<7.0	0.62 J	<0.50	<0.40	<0.30
08/17/15		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	430	<40	<0.20	<0.30	<0.20	0.95 J	<0.30	<7.0	0.71 J	<0.50	<0.40	<0.30
09/03/15		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	86 J	570	5.9	0.37 J	3.7	10	14	<7.0	0.45 J	<0.50	<0.40	<0.30
10/05/15		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	<60	500	7.3	<0.30	8.7	35	15	<7.0	0.73 J	<0.50	<0.40	<0.30
11/02/15		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	420	3,400	5.1	<0.30	17	130	22	<7.0	0.85 J	<0.50	<0.40	<0.30
12/07/15		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	710	3,800	0.70	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
01/12/16		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	2,000	510	14	<0.30	3.6	25	7.0	<7.0	<0.40	<0.50	<0.40	<0.30
02/01/16		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	72 J	180	13	<0.30	0.53	2.7	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
03/14/16		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	270	1,100	0.91	<0.30	<0.20	1.6	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
04/04/16	5	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	76 J	100	0.99	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
05/04/16		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	170	470	<0.20	<0.30	<0.20	1.3	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
06/01/16		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	280	75 J	4.9	<0.30	<0.20	<0.40	<0.30	<7.0	0.43 J	<0.50	<0.40	<0.30
07/11/16		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	330	<40	4.7	<0.30	<0.20	<0.40	<0.30	<7.0	0.79 J	<0.50	<0.40	<0.30
08/01/16		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	<60	<40	3.7	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
09/01/16		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	<60	<40	2.7	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
10/12/16	5	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	230	<40	4.5	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
11/01/16	5	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	120	52 J	3.1	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
12/05/16		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	450	51 J	<0.20	<0.30	<0.20	<0.40	<0.30	<7.0	0.60 J	<0.50	<0.40	<0.30
01/09/17		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	150	<40	4.4	<0.30	<0.20	<0.40	<0.30	<7.0	0.58 J	<0.50	<0.40	<0.30
02/06/17	6	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	110	<40	3.5	<0.30	0.41 J	0.60 J	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
03/15/17	5	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	68 J	<40	4.3	<0.30	<0.20	<0.40	<0.30	<7.0	0.60 J	<0.50	<0.40	<0.30
04/05/17	5	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	74 J	<40	8.4	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
05/03/17		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	72 J	<40	4.3	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
06/05/17		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	62 J	<40	5.0	<0.30	<0.20	0.50 J	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30

TABLE 8
Historical Summary of Analytical Groundwater Sampling Results - Influent GWETS
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Sample Date	Notes	GWETS Wells On Line	Laboratory Analysis Methods	TPHd	TPHg	Benzene	Toluene	Ethylbenzene	m,p-Xylenes	o-Xylene	TBA	MTBE	DIPE	ETBE	TAME
				(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)
07/19/17	5	GW-2, GW-15, GW-16	8015M & 8260B	75 J	<40	3.4	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
08/02/17		GW-2, GW-15, GW-16	8015M & 8260B	80 J	<40	4.0	<0.30	<0.20	<0.40	<0.30	<7.0	0.88 J	<0.50	<0.40	<0.30
09/13/17		GW-2, GW-15, GW-16	8015M & 8260B	84 J	<40	<0.20	<0.30	<0.20	<0.40	<0.30	<7.0	0.69 J	<0.50	<0.40	<0.30
10/16/17		GW-2, GW-15, GW-16	8015M & 8260B	64 J	<40	3.7	<0.30	<0.20	<0.40	<0.30	<7.0	0.54 J	<0.50	<0.40	<0.30
11/13/17		GW-2, GW-15, GW-16	8015M & 8260B	78 J	<40	4.5	<0.30	<0.20	<0.40	<0.30	<7.0	0.54 J	<0.50	<0.40	<0.30
12/11/17	7	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	<60	<40	2.8	<0.30	<0.20	<0.40	<0.30	8.8 J	<0.40	<0.50	<0.40	<0.30
01/11/18	7	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	73 J	<40	2.0	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
02/26/18	7	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	130	<40	5.3	<0.30	<0.20	<0.40	<0.30	<7.0	0.49 J	<0.50	<0.40	<0.30
03/20/18	7	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	<60	<40	4.4	<0.30	<0.20	<0.40	<0.30	<7.0	0.47 J	<0.50	<0.40	<0.30
04/02/18	7	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	65 J	<40	2.9	<0.30	<0.20	<0.40	<0.30	<7.0	0.50 J	<0.50	<0.40	<0.30
05/02/18	7	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	130	<40	2.5	<0.30	<0.20	<0.40	<0.30	<7.0	0.74 J	<0.50	<0.40	<0.30
06/04/18		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	<60	<40	0.74	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
07/02/18	7,8	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	<60	<40	1.1	<0.30	<0.20	<0.40	<0.30	<7.0	0.41 J	<0.50	<0.40	<0.30
08/06/18		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	<60	<40	3.1	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
09/13/18		GW-2, GW-15, GW-16	8015M & 8260B	<60	<40	0.38 J	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
10/29/18		GW-15, GW-16	8015M & 8260B	<60	<40	2.4	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
11/14/18		GW-15, GW-16	8015M & 8260B	<60	<40	2.0	<0.30	<0.20	<0.40	<0.30	<7.0	<0.40	<0.50	<0.40	<0.30
12/17/18	7	GW-2, GW-13, GW-15, GW-16	8015M & 624	170	<100	<0.5	<2.0	<2.0	<2.0	<2.0	<10	<2.0	<2.0	<2.0	<2.0
01/08/19		GW-2, GW-13, GW-15, GW-16	8015M & 8260B	--	<40	1.4	<0.30	<0.20	<0.40	<0.30	<7.0	0.92 J	<0.50	<0.40	<0.30
02/06/19	9	GW-2, GW-13, GW-15, GW-16	8015M & 8260B	<60	<40	1.4	<0.30	<0.20	0.52 J	<0.30	<7.0	0.49 J	<0.50	<0.40	<0.30
01/30/20	10,11	GW-13, GW-15, GW-16	8015B	790	--	--	--	--	--	--	--	--	--	--	--
03/11/20	10,11	GW-15, GW-16	8015B & EPA 624	370	--	<5	<5	<5	<1	<0.5	<10	<0.5	<0.5	<0.5	<0.5
04/22/20		GW-16	8015B	<94	<50	--	--	--	--	--	--	--	--	--	--
05/27/20		GW-16, GMW-31, GW-14R	8015B & EPA 624	610	490	46	<5	<5	<10	<5	<10	<5	<5	<1.0	<1.0
06/24/20		GW-16, GMW-31, GW-14R	8015B & EPA 624	850	640	79	<5	<5	<10	<5	12	6.4	<5	<1.0	<1.0
07/24/20	12	GW-16, GMW-31, GW-14R	8015B & EPA 624	1,000	150	6.2	<5	<5	<10	<5	18	<5	<5	<1.0	<1.0

TABLE 8
Historical Summary of Analytical Groundwater Sampling Results - Influent GWETS
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Sample Date	Notes	GWETS Wells On Line	Laboratory Analysis Methods	TPHd	TPHg	Benzene	Toluene	Ethylbenzene	m,p-Xylenes	o-Xylene	TBA	MTBE	DIPE	ETBE	TAME
				(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)	(µg/L)
11/24/20	12	GW-16, GMW-31, GW-14R	8015B & EPA 624	430	190	5.3	<5	<5	<10	<5	12	<5	<5	<1.0	<1.0
01/28/21	13	GW-16, GMW-31, GW-14R	8015B & EPA 624	860	410	34	<5	<5	<10	<5	25	<5	<5	<1.0	<1.0
02/10/21		GW-16, GMW-31, GW-14R	8015B & EPA 624	1,500	740	48	<5	<5	<10	<5	30	5.2	<5	<1.0	<1.0

Legend / Notes:

Data collected prior to July 2014 not verified for completeness nor accuracy.

GWETS = Groundwater extraction and treatment system TPHd = Total petroleum hydrocarbons as diesel

MTBE = Methyl tertiary-butyl ether

TBA = tertiary-Butyl alcohol

DIPE = Diisopropyl ether

ETBE = Ethyl tertiary-butyl ether

TPHg = Total petroleum hydrocarbons as gasoline

TAME = tertiary-Amyl-methyl ether

µg/L = Micrograms per liter

-- = Not available or not analyzed

<1 = Not detected at or above the Method Reporting Limit (MRL) shown. Beginning 7/9/14, not detected at or above the Method Detection Limit (MDL) shown.

J = Estimated value. Analyte detected at a level less than the MRL and greater than or equal to the MDL.

- Reported concentrations are shown in bold.

1 = GWETS manually shut down.

2 = GWETS restarted on 7/2/14, 1/13/15 and 2/25/15.

3 = GWETS manually shut down on 11/11/14.

4 = GWETS temporarily restarted but left off-line upon departure.

5 = GWETS manually shut down on 4/13/15, 5/6/15, 4/4/16, 9/26/16, 11/7/16, 3/8/17, 4/17/17 and 7/3/17, and restarted on 4/27/15, 5/8/15, 4/28/16, 10/12/16, 11/23/16, 3/15/17, 4/25/17 and 7/17/17, respectively.

6 = GWETS restarted following an automatic shut down on 2/4/17.

7 = GWETS manually shut down on 11/20/17 and largely remained off-line through late May 2018, as well as during July and December 2018, with the exception of a few operational days and/or weeks to collect system removal performance samples following the completion of media change out work, and/or to complete routine groundwater monitoring and sampling work along with system maintenance activities.

8 = GWETS manually shut down from 7/9/18 to 7/12/18 for installation of replacement discharge totalizer, 7/13/18 to 7/16/18 for repairs, and 7/18/18 to 7/20/18 for carbon changeout fieldwork.

9 = GWETS off-line since 2/27/19 pending the completion of an alternative waste discharge evaluation study.

10 = GWETS restarted on October 10, 2019 per the new sewer discharge permit. Sampling will begin January 1, 2020 per the permit requirements.

11 = TPHd and benzene, toluene, and ethylbenzene analyzed for mass extraction purposes only; new Industrial Waste Discharge (IWD) permit has different analytical requirements than previous stormsewer discharge permit.

12 = GWETS manually shut down on 6/30/20 and largely remained off-line through early January 2021 with the exception of a few operational days and/or weeks to collect system removal performance samples.

13 = GWETS restarted on 1/5/21.

TABLE 9A
Historical Summary of Field Vapor Readings - Former Tank Farm Horizontal Wells
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Notes	Vapor Extraction System(s) Wells On Line *	Well GRO Concentration (ppmv) / Screen Depth for Horizontal Wells or Interval in Feet Below Grade for Vertical Wells					
			HW-1	HW-3 **	HW-5	HW-7 **	HW-8	HW-9
			25	25	25	25	60	220
07/09/14	1	VEW-32, VEW-33, VEW-34, VEW-35, VEW-36, VEW-37, HW-1, HW-3, HW-5, HW-7	69	20	140	4,176	--	--
07/18/14		VEW-32, VEW-33, VEW-34, VEW-35, VEW-36, VEW-37, HW-1, HW-3, HW-5, HW-7	74	21	4,000	15,000	--	--
08/27/14	2	VEW-32, VEW-33, VEW-34, VEW-35, VEW-36, VEW-37, HW-1, HW-3, HW-5, HW-7	0.8	4.5	3.6	0.1	--	--
08/27/14	3	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	2.1	0	2.5	146.0	--	--
10/23/14	4	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	3.3	20.0	2.9	2	--	--
12/17/14	4	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	0	0	0	0.2	--	--
03/30/15	4,5	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	24	2	62	382.0	--	--
04/02/15	4	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	400	34	270	370	--	--
04/06/15	4	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	825	160	835	800	--	--
04/08/15	4	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	800	315	600	580	--	--
04/15/15	4	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	680	297	545	585	--	--
04/24/15	6	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	1,900	125	533	1,233	--	--
04/27/15	4,6	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	1,455	138	400	810	--	--
06/08/15	6,7	VEW-32, VEW-33, VEW-34	--	--	--	--	--	--
06/12/15	6	VEW-32, VEW-33, VEW-34	--	--	--	--	--	--
06/15/15	6	VEW-32, VEW-33, VEW-34	--	--	--	--	--	--
06/26/15	6	VEW-32, VEW-33, VEW-34	--	--	--	--	--	--
07/16/15	6	VEW-32, VEW-33, VEW-34	--	--	--	--	--	--
08/10/15	4,6,8	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5	1,947	28	676	732	--	--
08/20/15	6,9	VEW-32, VEW-33, HW-1, HW-3, HW-5	1,792	--	1,283	1,526	--	--
09/08/15	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	1,914	--	839	1,811	--	--
09/16/15	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	1,333	--	756	1,142	--	--
10/09/15	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	854	--	462	807	--	--
11/04/15	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	605	--	372	500	--	--
12/07/15	4,6	VEW-32, VEW-33, HW-1, HW-3, HW-5	880	--	590	760	--	--
01/13/16	4,6	VEW-32, VEW-33, HW-1, HW-3, HW-5	640	--	415	390	--	--
02/08/16	4,6	VEW-32, VEW-33, HW-1, HW-3, HW-5	520	--	300	240	--	--
03/02/16	4,6	VEW-32, VEW-33, HW-1, HW-3, HW-5	400	--	360	180	--	--
04/06/16	4,6	VEW-32, VEW-33, HW-1, HW-3, HW-5	420	--	260	220	--	--
05/04/16	4,6	VEW-32, VEW-33, HW-1, HW-3, HW-5	400	--	240	180	--	--
06/17/16	6	HW-1, HW-3, HW-5	740	--	470	330	--	--

TABLE 9A
Historical Summary of Field Vapor Readings - Former Tank Farm Horizontal Wells
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Notes	Vapor Extraction System(s) Wells On Line *	Well GRO Concentration (ppmv) / Screen Depth for Horizontal Wells or Interval in Feet Below Grade for Vertical Wells					
			HW-1	HW-3 **	HW-5	HW-7 **	HW-8	HW-9
			25	25	25	25	60	220
07/06/16	6,10	HW-1, HW-3, HW-5	480	--	340	220	--	--
08/05/16	6	HW-1, HW-3, HW-5	240	4	190	230.0	--	--
09/01/16	6,10	HW-1, HW-3, HW-5	280	--	220	260	--	--
10/20/16	4,6,10,11	HW-1, HW-3, HW-5, HW-7	200	140	240	280	--	--
11/01/16	6,10	HW-1, HW-3, HW-5, HW-7	160	120	180	260	--	--
12/05/16	4,6,10	HW-1, HW-3, HW-5, HW-7	120	100	200	240	--	--
01/09/17	6,10	HW-1, HW-3, HW-5, HW-7	80	17	180	200	--	--
02/06/17	4,6,10	HW-1, HW-3, HW-5, HW-7	100	13	160	180	--	--
03/20/17	12	HW-1, HW-3, HW-5, HW-7	110	12	120	160	--	--
04/17/17		HW-1, HW-3, HW-5, HW-7	120	10	160	220	--	--
05/03/17		HW-1, HW-3, HW-5, HW-7	100	19	140	260	--	--
06/05/17		HW-1, HW-3, HW-5	107	15	82	211	--	--
07/19/17	13	HW-5, HW-7 and VEW-39	--	49	79	286	--	--
08/09/17	14,15	HW-1, HW-5, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	192	--	94	236	--	--
09/07/17	14,15	HW-1, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	180	--	60	220	--	--
10/12/17	14,15	HW-1, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	220	--	80	260	--	--
11/02/17	14,15	HW-1, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	346	--	105	334	--	--
12/11/17	14,15	HW-1, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	280	--	90	220	--	--
01/11/18	15,16	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1, RW-9, RW-13, RW-18 and RW-26	160	--	120	340	--	--
02/12/18	15	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1 through RW-18, and RW-26	60	--	75	290	--	--
03/14/18	15	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1, -4, -5, -7, -9, -10, -11, -13, -14, -18 and -26	--	--	--	--	--	--
03/28/18	15	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1, -4, -5, -7, -9, -10, -11, -13, -14, -18 and -26	200	--	160	240	--	--
04/02/18	15	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1, -4, -5, -7, -9, -10, -11, -13, -14, -18 and -26	180	--	140	220	--	--
05/02/18	15	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1, -4, -5, -7, -9, -10, -11, -13, -14, -18 and -26	140	--	120	200	--	--
06/06/18	15	HW-1, HW-5, HW-7, VEW-39, RW-1, -4, -9, -10, -11, -13, -14 and -18	100	--	80	160	--	--

TABLE 9A
Historical Summary of Field Vapor Readings - Former Tank Farm Horizontal Wells
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Notes	Vapor Extraction System(s) Wells On Line *	Well GRO Concentration (ppmv) / Screen Depth for Horizontal Wells or Interval in Feet Below Grade for Vertical Wells					
			HW-1	HW-3 **	HW-5	HW-7 **	HW-8	HW-9
			25	25	25	25	60	220
06/27/18	15	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-19, -20, -22, -24, -26 through -30, -32, -33, -35 through -38 and -40 through -50	--	--	--	--	--	--
07/16/18	15	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-19, -20, -22, -24, -26 through -30, -32, -33, -35 through -38 and -40 through -50	--	--	--	--	--	--
07/30/18	15	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-19, -20, -22, -24, -26 through -30, -32, -33, -35 through -38 and -40 through -50	--	--	--	--	--	--
08/29/18	15	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-19, -20, -22, -24, -26 through -30, -32, -33, -35 through -38 and -40 through -50	--	--	--	--	--	--
12/03/18	15	HW-1, HW-5, HW-7, RW-1, -4, -5, -9, -10, -11, -14, -18, VEW-40, RW-22, -24, -26, -27 -28, -29, -35, -40, -44, 30, -32, -33, -36, -37, -41, -42, -43, -46-, -47, -48, -49, -50	--	--	--	--	--	--
01/25/19	15	HW-1, HW-5, HW-7, RW-1, -4, -5, -9, -10, -11, -14, -18, VEW-40, RW-22, -24, -26, -27 -28, -29, -35, -40, -44, 30, -32, -33, -36, -37, -41, -42, -43, -46-, -47, -48, -49, -50	1,127	--	375	474	--	--
02/12/19	15	HW-1, HW-5, HW-7, RW-1, -4, -5, -9, -10, -11, -14, -18, VEW-40, RW-22, -24, -26, -27 -28, -29, -35, -40, -44, 30, -32, -33, -36, -37, -41, -42, -43, -46-, -47, -48, -49, -50	1,845	--	696	718	--	--
03/06/19	15	HW-1, HW-5, HW-7, RW-1, -4, -5, -9, -10, -11, -14, -18, VEW-40, RW-22, -24, -26, -27 -28, -29, -35, -40, -44, 30, -32, -33, -36, -37, -41, -42, -43, -46-, -47, -48, -49, -50	1,309	--	1,115	939	--	--
03/12/19	15,17	HW-1, HW-5, HW-7, RW-1, -4, -5, -9, -10, -11, -14, -18, VEW-40, RW-22, -24, -26, -27 -28, -29, -35, -40, -44, 30, -32, -33, -36, -37, -41, -42, -43, -46-, -47, -48, -49, -50	--	--	--	--	--	--
03/20/19	15	HW-1, HW-5, HW-7, RW-1, -4, -5, -9, -10, -11, -14, -18, VEW-40, RW-22, -24, -26, -27 -28, -29, -35, -40, -44, 30, -32, -33, -36, -37, -41, -42, -43, -46-, -47, -48, -49, -50	591	--	234	730	--	--
03/26/19	15	HW-1, HW-5, HW-7, RW-1, -4, -5, -9, -10, -11, -14, -18, VEW-40, RW-22, -24, -26, -27 -28, -29, -35, -40, -44, 30, -32, -33, -36, -37, -41, -42, -43, -46-, -47, -48, -49, -50	--	--	--	--	--	--
04/09/19	15,18	HW-1, HW-5, HW-7, RW-1, -4, -5, -9, -10, -11, -14, -18, VEW-40, RW-22, -24, -26, -27 -28, -29, -35, -40, -44, 30, -32, -33, -36, -37, -41, -42, -43, -46-, -47, -48, -49, -50	>15,000	--	1,541	1,725	--	--
11/25/19	19,20	HW-1, HW-5, HW-7, HW-8, HW-9	730	--	501	730	--	1,820
12/16/19		HW-1, HW-5, HW-7, HW-8, HW-9	4,900	--	1,336	1,215	431	1,375
01/15/20		HW-1, HW-5, HW-7, HW-8, HW-9	184	--	6	10	976	22
02/05/20		HW-1, HW-5, HW-7, HW-8, HW-9	371	--	5	124	6	843
02/14/20		HW-1, HW-5, HW-7, HW-8, HW-9	397	--	24	366	4	805
02/18/20		HW-1, HW-5, HW-7, HW-8, HW-9	139	--	4	149	3	530
02/27/20		HW-1, HW-5, HW-7, HW-8, HW-9	155	--	29	21	2	1,192
03/04/20		HW-1, HW-5, HW-7, HW-8, HW-9	2,188	--	611	461	61	774
03/16/20		HW-1, HW-5, HW-7, HW-8, HW-9	1,520	--	241	186	21	4,344
03/24/20		HW-1, HW-5, HW-7, HW-8, HW-9	339	--	57	156	6	2,681

TABLE 9A
Historical Summary of Field Vapor Readings - Former Tank Farm Horizontal Wells
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Notes	Vapor Extraction System(s) Wells On Line *	Well GRO Concentration (ppmv) / Screen Depth for Horizontal Wells or Interval in Feet Below Grade for Vertical Wells					
			HW-1	HW-3 **	HW-5	HW-7 **	HW-8	HW-9
			25	25	25	25	60	220
04/01/20		HW-1, HW-5, HW-7, HW-8, HW-9	132	--	5	87	4	1,982
04/10/20		HW-1, HW-5, HW-7, HW-8, HW-9	172	--	5.1	145	0	378
04/15/20		HW-1, HW-5, HW-7, HW-8, HW-9	143	--	4	286	3	768
04/24/20		HW-1, HW-5, HW-7, HW-8, HW-9	83	--	16	337	4	780
05/01/20		HW-1, HW-5, HW-7, HW-8, HW-9	108	--	1	15000+	1	15000+
05/06/20		HW-1, HW-5, HW-7, HW-8, HW-9	99	--	18	15000+	2	15000+
05/15/20		HW-1, HW-5, HW-7, HW-8, HW-9	199	--	8	697	7	1,058
05/28/20		HW-1, HW-5, HW-7, HW-8, HW-9	105	--	5	636	5	1,841
06/03/20		HW-1, HW-5, HW-7, HW-8, HW-9	88	--	3	475	4	968
06/09/20		HW-1, HW-5, HW-7, HW-8, HW-9	73	--	3	399	1	853
06/22/20		HW-1, HW-5, HW-7, HW-8, HW-9	140	--	71	493	3	957
06/23/20	21	HW-1, HW-7, HW-9	--	--	--	--	--	--
07/01/20		HW-1, HW-7, HW-9	165	--	--	615	--	1,867
07/07/20		HW-1, HW-7, HW-9	123	--	--	457	--	1,882
07/17/20		HW-1, HW-7, HW-9	127	--	--	387	--	3,470
07/20/20		HW-1, HW-7, HW-9	127	--	--	339	--	1,893
07/31/20		HW-1, HW-7, HW-9	106	--	--	330	--	211
08/07/20		HW-1, HW-7, HW-9	320	--	--	503	--	929
08/10/20		HW-1, HW-7, HW-9	98	--	--	463	--	2,908
08/17/20		HW-1, HW-7, HW-9	128	--	--	660	--	3,633
08/24/20		HW-1, HW-7, HW-9	141	--	12	615	15	7,848
08/26/20		HW-1, HW-7, HW-9	108	--	--	546	--	2,573
08/31/20		HW-1, HW-7, HW-9	97	--	--	490	--	1,873
09/11/20		HW-1, HW-7, HW-9	86	--	--	439	--	1,502
09/14/20		HW-1, HW-7, HW-9	362	--	--	398	--	3,815
09/24/20		HW-1, HW-7, HW-9	42	--	--	311	--	34
09/28/20		HW-1, HW-7, HW-9	115	--	--	471	--	1,783
10/05/20		HW-1, HW-7, HW-9	122	--	--	400	--	3,011
10/12/20		HW-1, HW-7, HW-9	77	--	--	219	--	1,542
10/19/20		HW-1, HW-7, HW-9	101	--	--	1,791	--	1,771
10/28/20		HW-1, HW-7, HW-9	102	--	--	171	--	69
11/5/20		HW-1, HW-7, HW-9	107	--	49	165	124	1,421
11/16/20		HW-1, HW-5, HW-7, HW-9	64	--	25	134	--	964

TABLE 9A
Historical Summary of Field Vapor Readings - Former Tank Farm Horizontal Wells
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Notes	Vapor Extraction System(s) Wells On Line *	Well GRO Concentration (ppmv) / Screen Depth for Horizontal Wells or Interval in Feet Below Grade for Vertical Wells					
			HW-1	HW-3 **	HW-5	HW-7 **	HW-8	HW-9
			25	25	25	25	60	220
11/24/20		HW-1, HW-5, HW-7, HW-9	46	--	104	--	--	993
1/15/21		HW-1, HW-9, HW-5, HW-7	48	--	72	56	--	976
2/4/21		HW-1, HW-9, HW-5, HW-7	139	--	77	59	--	421
2/8/21		HW-1, HW-9, HW-5, HW-7	48	--	--	--	--	--
2/24/21		HW-1, HW-9, HW-5, HW-7	43	--	6	35	--	1,287
3/4/21		HW-1, HW-8, HW-9, HW-5, HW-7	48	--	33	295	46	535
3/8/21		HW-1, HW-8, HW-9, HW-5, HW-7	48	--	19	231	3	458
3/15/21		HW-1, HW-9, HW-5, HW-7	37	--	48	245	--	1,192
3/24/21		HW-1, HW-9, HW-5, HW-7	43	--	63	73	--	1,274
3/30/21		HW-1, HW-9, HW-5, HW-7	--	--	73	68	--	1,150

Legend / Notes:

GRO = Gasoline range organics ppmv = Parts per million by volume OVA = Organic Vapor Analyzer -- = Readings not taken VES = Vapor extraction system

Concentrations measured using calibrated field OVA.

- 1 = Initial readings on carbon VES restart (off line since manually shut down on 05/29/14).
- 2 = Readings prior to well optimization.
- 3 = Readings following well optimization (closed wells VEW-35, VEW-36 and VEW-37 based on field OVA readings).
- 4 = Offline wells temporarily opened for monitoring, then returned to closed position.
- 5 = Readings collected following slightly opening well field valve to vapor extraction system.
- 6 = Select soil biopiles also online.
- 7 = Closed select vapor wells to focus extraction efforts on soil biopiles.
- 8 = Opened vapor extraction wells HW-1, HW-3 and HW-5 based on field OVA readings.
- 9 = Closed vapor extraction well VEW-34 on 8/19/15 based on low to non-detectable lab results (see Table 7 for details).
- 10 = Valved down vapor extraction wells HW-1, HW-3 and/or HW-5 while leaving all other wells closed to focus extraction efforts on soil biopiles.
- 11 = Opened vapor extraction well HW-7 based on field OVA reading.
- 12 = Ex-situ remediation project completed/all soil biopiles disconnected and well valves subsequently set to optimize carbon VES in accordance with recent field OVA readings and/or lab data.
- 13 = Wells VEW-38, VEW-39 and VEW-40 tied into carbon VES during late June 2017 following installation per SGI's March 14, 2017 Well Replacement Report and Work Plan.
- 14 = For full list of wells online, see SGI's November 15, 2017 *Remediation Status Report - Third Quarter 2017* and February 15, 2018 *Remediation Status Report - Fourth Quarter 2017*, respectively.
- 15 = See Tables 9B, 9C and 9D for applicable RW on line well field vapor readings.
- 16 = Wells VEW-38, VEW-39 and VEW-40 disconnected from carbon VES and tied into thermal oxidizer VES upon 01/08/18 startup (see SGI's May 15, 2018 *Remediation Status Report - First Quarter 2018* for details).
- 17 = New Thermal Oxidizer system startup on 3/13/19.
- 18 = VES Carbon system shutdown on 4/18/19 to replace blower.
- 19 = HW-3 abandoned and replaced on 6/7/19 and 6/10/19 and replaced with new horizontal wells HW-8 and HW-9. Nw HW's connected to VES Carbon system on 7/16/19.
- 20 = VES Carbon system restart on 11/21/19 after new blower installation.
- 19 = HW-3 abandoned and replaced on 6/7/19 and 6/10/19 and replaced with new horizontal wells HW-8 and HW-9.
- 21 = Closed off trunklines 8 and 5 due to low PID readings. Trunklines 7 and 9 opened 100%

* = Carbon VES only through 2017 and also includes thermal oxidizer VES wells online after 2017.

** = Tabulated data corrected after determining well HW-3 was incorrectly labeled as well HW-7 and vice versa during late July 2017 re-development work.

TABLE 9C
Historical Summary of Field Vapor Readings - Eastern Area Vertical Wells
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Notes	Vapor Extraction System(s) Wells On Line *	Well GRO Concentration (ppmv) / Screen Interval in Feet Below Grade																									
			Truckline #1, VECV #1					Truckline #1, VECV #2					Truckline #1, VECV #3					Truckline #1, VECV #4				Truckline #1, VECV #5						
			RW-1 15 - 35	RW-6 17 - 37	RW-15 18 - 38	RW-16 14 - 34	RW-17 19 - 39	VEW-32 10 - 25	VEW-37 10 - 25	RW-2 13 - 33	RW-7 17 - 37	RW-11 16 - 36	VEW-33 10 - 25	VEW-36 10 - 25	RW-8 18.5 - 38.5	RW-12 14 - 34	RW-18 18 - 38	VEW-34 10 - 25	VEW-35 10 - 25	RW-13 15 - 35	RW-14 14 - 34	RW-3 17 - 37	RW-4 14 - 34	RW-5 14 - 34	RW-9 15 - 35	RW-10 14 - 34		
07/09/14	1	VEW-32, VEW-33, VEW-34, VEW-35, VEW-36, VEW-37, HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	154	20	--	--	10	6.4	--	--	4.2	5.5	--	--	--	--	--	--	--	--			
07/18/14		VEW-32, VEW-33, VEW-34, VEW-35, VEW-36, VEW-37, HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	134	18	--	--	5.6	4.1	--	--	3.3	2.1	--	--	--	--	--	--	--	--			
08/27/14	2	VEW-32, VEW-33, VEW-34, VEW-35, VEW-36, VEW-37, HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	6.3	0	--	--	0.4	0	--	--	0.4	0.2	--	--	--	--	--	--	--	--			
08/27/14	3	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	174	--	--	--	0.2	--	--	--	0	--	--	--	--	--	--	--	--	--			
10/23/14	4	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	191	151	--	--	22	9.1	--	--	8.0	28	--	--	--	--	--	--	--	--			
12/17/14	4	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	62	11	--	--	37	24	--	--	2.0	15	--	--	--	--	--	--	--	--			
03/30/15	4,5	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	2.5	1.0	--	--	0.1	20	--	--	0.3	4.8	--	--	--	--	--	--	--	--			
04/02/15	4	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	25	0	--	--	4.1	0	--	--	0	0	--	--	--	--	--	--	--	--			
04/06/15	4	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	171	0	--	--	5.7	0	--	--	3.0	0	--	--	--	--	--	--	--	--			
04/08/15	4	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	195	0	--	--	35	0	--	--	25	0	--	--	--	--	--	--	--	--			
04/15/15	4	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	273	0	--	--	223	0	--	--	87	0	--	--	--	--	--	--	--	--			
04/24/15	6	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--			
04/27/15	4,6	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	210	2.4	--	--	324	5.7	--	--	115	4.8	--	--	--	--	--	--	--	--			
06/08/15	6,7	VEW-32, VEW-33, VEW-34	--	--	--	--	--	180	--	--	--	130	--	--	--	40	--	--	--	--	--	--	--	--	--			
06/12/15	6	VEW-32, VEW-33, VEW-34	--	--	--	--	--	194	--	--	--	126	--	--	--	80	--	--	--	--	--	--	--	--	--			
06/15/15	6	VEW-32, VEW-33, VEW-34	--	--	--	--	--	158	--	--	--	77	--	--	--	39	--	--	--	--	--	--	--	--	--			
06/26/15	6	VEW-32, VEW-33, VEW-34	--	--	--	--	--	123	--	--	--	104	--	--	--	20	--	--	--	--	--	--	--	--	--			
07/16/15	6	VEW-32, VEW-33, VEW-34	--	--	--	--	--	256	--	--	--	147	--	--	--	17	--	--	--	--	--	--	--	--	--			
08/10/15	4,6,8	VEW-32, VEW-33, VEW-34, HW-1, HW-3, HW-5	--	--	--	--	--	456	3.9	--	--	334	2.2	--	--	63	16	--	--	--	--	--	--	--	--			
08/20/15	6,9	VEW-32, VEW-33, HW-1, HW-3, HW-5	--	--	--	--	--	530	--	--	--	329	--	--	--	--	--	--	--	--	--	--	--	--	--			
09/08/15	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	--	--	--	--	--	395	--	--	--	162	--	--	--	--	--	--	--	--	--	--	--	--	--			
09/16/15	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	--	--	--	--	--	266	--	--	--	184	--	--	--	--	--	--	--	--	--	--	--	--	--			
10/09/15	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	--	--	--	--	--	343	--	--	--	258	--	--	--	--	--	--	--	--	--	--	--	--	--			
11/04/15	6	VEW-32, VEW-33, HW-1, HW-3, HW-5	--	--	--	--	--	401	--	--	--	184	--	--	--	--	--	--	--	--	--	--	--	--	--			
12/07/15	4,6	VEW-32, VEW-33, HW-1, HW-3, HW-5	--	--	--	--	--	327	14	--	--	246	12	--	--	88	22	--	--	--	--	--	--	--	--			
01/13/16	4,6	VEW-32, VEW-33, HW-1, HW-3, HW-5	--	--	--	--	--	220	17	--	--	260	22	--	--	72	34	--	--	--	--	--	--	--	--			
02/08/16	4,6	VEW-32, VEW-33, HW-1, HW-3, HW-5	--	--	--	--	--	160	11	--	--	220	28	--	--	55	42	--	--	--	--	--	--	--	--			
03/02/16	4,6	VEW-32, VEW-33, HW-1, HW-3, HW-5	--	--	--	--	--	120	15	--	--	240	32	--	--	47	31	--	--	--	--	--	--	--	--			
04/06/16	4,6	VEW-32, VEW-33, HW-1, HW-3, HW-5	--	--	--	--	--	60	12	--	--	380	18	--	--	29	22	--	--	--	--	--	--	--	--			
05/04/16	4,6	VEW-32, VEW-33, HW-1, HW-3, HW-5	--	--	--	--	--	90	19	--	--	340	25	--	--	36	18	--	--	--	--	--	--	--	--			
06/17/16	6	HW-1, HW-3, HW-5	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--			
07/06/16	6,10	HW-1, HW-3, HW-5	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--			
08/05/16	6	HW-1, HW-3, HW-5	--	--	--	--	--	20	8.3	--	--	140	34	--	--	11	9.0	--	--	--	--	--	--	--	--			
09/01/16	6,10	HW-1, HW-3, HW-5	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--			

TABLE 9C
Historical Summary of Field Vapor Readings - Eastern Area Vertical Wells
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Notes	Vapor Extraction System(s) Wells On Line *	Well GRO Concentration (ppmv) / Screen Interval in Feet Below Grade																									
			Truckline #1, VECV #1					Truckline #1, VECV #2					Truckline #1, VECV #3					Truckline #1, VECV #4				Truckline #1, VECV #5						
			RW-1 15 - 35	RW-6 17 - 37	RW-15 18 - 38	RW-16 14 - 34	RW-17 19 - 39	VEW-32 10 - 25	VEW-37 10 - 25	RW-2 13 - 33	RW-7 17 - 37	RW-11 16 - 36	VEW-33 10 - 25	VEW-36 10 - 25	RW-8 18.5 - 38.5	RW-12 14 - 34	RW-18 18 - 38	VEW-34 10 - 25	VEW-35 10 - 25	RW-13 15 - 35	RW-14 14 - 34	RW-3 17 - 37	RW-4 14 - 34	RW-5 14 - 34	RW-9 15 - 35	RW-10 14 - 34		
10/20/16	4,6,10,11	HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	32	6.4	--	--	--	80	30	--	--	--	9.1	7.3	--	--	--	--	--	--			
11/01/16	6,10	HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--			
12/05/16	4,6,10	HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	20	7.1	--	--	--	60	20	--	--	--	17	8.8	--	--	--	--	--	--			
01/09/17	6,10	HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--			
02/06/17	4,6,10	HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	12	5.4	--	--	--	45	14	--	--	--	11	6.1	--	--	--	--	--	--			
03/20/17	12	HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--			
04/17/17		HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--			
05/03/17		HW-1, HW-3, HW-5, HW-7	--	--	--	--	--	15	6.7	--	--	--	33	19	--	--	--	17	8.1	--	--	--	--	--	--			
06/05/17		HW-1, HW-3, HW-5	--	--	--	--	--	10	11	--	--	--	14	12	--	--	--	8.0	7.1	--	--	--	--	--	--			
07/19/17	13	HW-5, HW-7 and VEW-39	--	--	--	--	--	12	4.8	--	--	--	47	6.2	--	--	--	9.3	4.1	--	--	--	--	--	--			
08/09/17	1,2,3	HW-1, HW-5, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	1,268	--	--	--	--	5.5	5.4	16	120	--	27	3.7	--	76	374	7.7	2.3	2,440	--	--	--	--	1,164	--		
09/07/17	2,3	HW-1, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	3,860	--	--	--	--	9.2	10	99	495	--	20	14	--	90	679	11	5.5	2,870	--	--	--	--	320	--		
10/12/17	2,3	HW-1, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	2,480	--	--	--	--	13	12	75	310	--	28	19	--	120	580	14	9.3	2,620	--	--	--	--	660	--		
11/02/17	2,2	HW-1, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	3,140	--	--	--	--	10	9.1	50	225	--	23	15	--	140	430	11	6.6	3,200	--	--	--	--	840	--		
12/11/17	2,3	HW-1, HW-7, VEW-38, VEW-39, VEW-40, and Select RW Wells	2,250	--	--	--	--	7.7	9.1	60	180	--	20	8.8	--	80	350	9.3	5.1	3,040	--	--	--	--	590	--		
03/14/18	4,5	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1, -4, -5, -7, -9, -10, -11, -13, -14, -18 and -26	2,520	15	12	40	28	7.2	4.3	31	181	420	2.4	0.4	5.1	5.5	937	8.1	7.3	2,000	1,235	68	598	4,600	2,824	>10,000		
07/16/18	4,5	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1, -4, -5, -7, -9, -10, -11, -13, -14, -18 and -26	725	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--		
07/30/18	4,5	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1, -4, -5, -7, -9, -10, -11, -13, -14, -18 and -26	--	--	--	--	--	--	--	401	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--		
08/29/18	4,5	HW-1, HW-5, HW-7, VEW-38, VEW-40, RW-1, -4, -5, -7, -9, -10, -11, -13, -14, -18 and -26	--	--	--	--	--	--	--	475	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--		
12/03/18	4,5	HW-1, HW-5, HW-7, RW-1, -4, -5, -9, -10, -11, -14, -18, VEW-40, RW-22, -24, -26, -27, -28, -29, -35, -40, -44, 30, -32, -33, -36, -37, -41, -42, -43, -46, -47, -48, -49, -50	--	--	--	--	--	--	--	--	--	641	--	--	--	--	952	--	--	--	8,157	--	--	>15,000	>15,000	>15,000	>15,000	
03/12/19	3,6	HW-1, HW-5, HW-7, RW-1, -4, -5, -9, -10, -11, -14, -18, VEW-40, RW-22, -24, -26, -27, -28, -29, -35, -40, -44, 30, -32, -33, -36, -37, -41, -42, -43, -46, -47, -48, -49, -50	190	0	0	16	3	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--		
03/27/19	3,6	HW-1, HW-5, HW-7, RW-1, -4, -5, -9, -10, -11, -14, -18, VEW-40, RW-22, -24, -26, -27, -28, -29, -35, -40, -44, 30, -32, -33, -36, -37, -41, -42, -43, -46, -47, -48, -49, -50	838	0	--	--	--	--	402	--	1,172	--	--	--	--	992	--	--	13,772	--	--	1,021	1,850	6,280	2,150			
06/05/19	3	RW-1, -4, -5, -9, -10, -11, -14, -18, VEW-40, RW-22, -24, -26, -27, -28, -29, -35, -40, -44, 30, -32, -33, -36, -37, -41, -42, -43, -46, -47, -48, -49, -50	574	--	--	--	--	--	--	--	10	--	--	--	--	420	--	--	3,420	--	--	776	1,083	4,210	1,143			
07/23/19		(RW-1), (RW-11), (RW-18), (RW-13), (RW-4), RW-5, RW-9, RW-10)	643	--	--	--	--	--	--	--	6	--	--	--	--	130	--	--	724.0	--	--	851	805	2,750	1,238			
08/26/19	7	(RW-1), (RW-18), (RW-13), (RW-4), RW-5, RW-9, RW-10)	678	2	3	19	3	--	--	33	52	5	--	40.0	37	7	7	13.0	7.0	1,520	1,380	522	430	512	1,455	502		
09/23/19		(RW-1), (RW-18), (RW-13), (RW-4), RW-5, RW-9, RW-10)	682	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	177	258	306	179	145	679	637			
12/03/19	7	(RW-1), (RW-13, RW-14), (RW-4), RW-5, RW-9, RW-10)	4	2	2	--	--	--	--	2	434	--	--	--	--	--	10	6	226	124	--	28	--	116	146			
01/08/20		(RW-1), (RW-7), (RW-13, RW-14), (RW-4), RW-9, RW-10)	1,050	--	--	--	--	--	--	--	466	--	--	--	--	--	--	--	630	184	--	360	--	1,720	900			
03/02/20	7	(RW-1), (RW-2, RW-7), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10)	1,156	--	--	--	--	--	2	1,370	262	--	--	2	1,024	2	14	2	2	88	128	46	202	8	836	746		
04/30/20		(RW-1), (RW-2, RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10)	694	--	--	--	--	--	10	84	--	--	--	514	--	--	--	--	110	164	148	188	--	2,158	710			
05/21/20		(RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10)	794	--	--	--	--	--	--	56	--	--	--	245	--	--	--	--	135	98	108	164	--	1,530	620			



TABLE 9C
Historical Summary of Field Vapor Readings - Eastern Area Vertical Wells
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Notes	Vapor Extraction System(s) Wells On Line *	Well GRO Concentration (ppmv) / Screen Interval in Feet Below Grade																						
			Truckline #1, VECV #1					Truckline #1, VECV #2					Truckline #1, VECV #3					Truckline #1, VECV #4				Truckline #1, VECV #5			
			RW-1 15 - 35	RW-6 17 - 37	RW-15 18 - 38	RW-16 14 - 34	RW-17 19 - 39	VEW-32 10 - 25	VEW-37 10 - 25	RW-2 13 - 33	RW-7 17 - 37	RW-11 16 - 36	VEW-33 10 - 25	VEW-36 10 - 25	RW-8 18.5 - 38.5	RW-12 14 - 34	RW-18 18 - 38	VEW-34 10 - 25	VEW-35 10 - 25	RW-13 15 - 35	RW-14 14 - 34	RW-3 17 - 37	RW-4 14 - 34	RW-5 14 - 34	RW-9 15 - 35
09/29/20	7	(RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10)	704	8	4	--	--	--	--	10	--	--	--	38	--	2	4	2	102	--	62	112	--	780	350
10/27/20		(RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10)	834	--	--	--	--	--	--	36	--	--	--	60	--	--	--	--	1,262	0	108	140	--	1,028	274
01/21/21	7	(RW-1), (RW-7), (RW-8), (RW-13, RW-14), (RW-3, RW-4, RW-9, RW-10)	604	4	0	0	0	0	0	40	0	0	0	116	0	6	0	0	1,676	4	6	140	2	2,086	28
03/05/21		(RW-1), (RW-7), (RW-8), (RW-13), (RW-3, RW-4, RW-9, RW-10)	740	--	--	--	--	--	--	6	--	--	--	46	--	--	--	--	442	--	22	160	--	1,660	142

Legend / Notes:

GRO = Gasoline range organics ppmv = Parts per million by volume OVA = Organic Vapor Analyzer -- = Readings not taken VES = Vapor extraction system

Concentrations measured using calibrated field OVA.

1 = Wells RW-1, RW-2, RW-7, RW-9, RW-12, RW-13 and RW-18 initially tied into carbon VES during early August 2017 following installation per SGI's June 30, 2017 *Remediation Well Installation Update Report*.

2 = For full list of wells on line, see SGI's November 15, 2017 *Remediation Status Report - Third Quarter 2017* and *February 15, 2018 Remediation Status Report - Fourth Quarter 2017*, respectively.

3 = See Tables 9A, 9B and 9D for applicable HW, VEW and RW on line well field vapor readings.

4 = Wells RW-1, RW-2, RW-7, RW-9, RW-12, RW-13 and RW-18 disconnected from carbon VES and tied into thermal oxidizer VES upon 01/08/18 startup.

5 = Wells RW-3 through RW-6, RW-8, RW-10, RW-11, and RW-14 through RW-17 tied into thermal oxidizer VES during mid-February 2018 following installation per SGI's June 30, 2017 *Remediation Well Installation Update Report*.

6 = New Thermal Oxidizer system startup on 3/13/19.

7 = Closed wells were opened to check for rebound concentrations.

* = Carbon VES only through 2017 and also includes thermal oxidizer VES wells online after 2017.

TABLE 10
Historical Summary of Analytical Vapor Sampling Results - Individual Wells
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Well ID	Sample Date	Notes	Laboratory Analysis Methods	GRO Field OVA Reading	GRO		Benzene		Toluene		Ethylbenzene		o-Xylene		m,p-Xylenes		MTBE	
				(ppmv)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)
HW-1	07/09/14	1	8015 & 8260B	69	23	96	<0.2	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.6	<2.0
	10/23/14			3.3	<4.9	<20	<0.2	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.6	<2.0
	04/27/15	2		1,455	830	3,400	1.1	3.5	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	08/10/15			1,947	2,700	11,000	1.0	3.3	<0.13	<0.50	0.25	1.1	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	02/08/16			520	440	1,800	0.88	2.8	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	04/06/16			420	340	1,400	1.0	3.2	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	01/18/17			80	88	310	0.59	1.9	0.18	0.67	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	11/02/17			346	240	1,000	0.59	1.9	<0.13	<0.50	0.15	0.66	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	02/12/18			60	27	110	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	03/28/18			167	180	730	0.34	1.1	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	08/06/18			--	110	450	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0
	02/12/19			1,845	810	3,300	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0
	11/25/19			730	200	820	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0
	02/18/20			139	24	98	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0
	05/15/20			199	24	100	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0
	08/24/20			141	12	50	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0
11/05/20	107	8.3	34	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0			
02/24/21	43	8.3	34	<0.16	<0.5	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0			
HW-3 *	07/09/14	1	20	<4.9	<20	<0.2	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.6	<2.0	
	10/23/14		20	<4.9	<20	<0.2	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.6	<2.0	
	04/27/15	2	138	66	270	0.28	0.9	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	08/10/15		28	7.3	30	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	01/18/17		17	8.5	30	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
HW-5	07/09/14	1	140	46	190	<0.2	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.6	<2.0	
	10/23/14		2.9	<4.9	<20	<0.2	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.6	<2.0	
	04/27/15	2	400	290	1,200	0.17	0.55	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	0.30	1.3	<0.55	<2.0	
	08/10/15		676	930	3,800	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	02/08/16		300	320	1,300	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	04/06/16		260	210	870	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	08/08/16		190	120	480	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	01/18/17		180	85	300	0.34	1.1	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	11/02/17		105	39	160	0.21	0.7	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	02/12/18		75	90	370	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	03/28/18		91	140	560	0.63	2.0	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	08/06/18		--	100	410	0.50	1.6	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	02/12/19		696	270	1,100	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0	
	11/25/19		501	170	710	0.56	1.8	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0	
	02/18/20		4	<4.9	<20	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0	
05/15/20	8		<4.9	<20	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0		
08/24/20	12	<4.9	<20	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0			
11/05/20	49	<4.9	<20	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0			
02/24/21	6	<4.9	<20	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0			
HW-7 *	07/09/14	1	4,176	2,055	8,400	3.1	10	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.6	<2.0	
	10/23/14		2.0	<4.9	<20	<0.2	<0.50	<0.1	<0.50	<0.1	<0.50	<0.1	<0.50	<0.2	<1.0	<0.6	<2.0	
	04/27/15		810	590	2,400	3.4	11	0.69	2.6	0.32	1.4	0.20	0.88	1.2	5.0	<0.55	<2.0	

TABLE 10
Historical Summary of Analytical Vapor Sampling Results - Individual Wells
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Well ID	Sample Date	Notes	Laboratory Analysis Methods	GRO Field OVA Reading	GRO		Benzene		Toluene		Ethylbenzene		o-Xylene		m,p-Xylenes		MTBE	
				(ppmv)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)
HW-7 *	08/10/15	2		732	950	3,900	6.3	20	0.34	1.3	0.64	2.8	0.30	1.3	2.3	10	<0.55	<2.0
	02/08/16			240	190	780	1.2	3.8	0.37	1.4	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	04/06/16			220	170	710	1.4	4.4	0.53	2.0	<0.12	<0.50	<0.12	<0.50	0.28	1.2	<0.55	<2.0
	08/08/16			230	170	710	2.0	6.5	0.56	2.1	<0.12	<0.50	<0.12	<0.50	0.32	1.4	<0.55	<2.0
	01/18/17			200	110	370	2.0	6.5	0.82	3.1	0.12	0.52	0.12	0.51	0.35	1.5	<0.55	<2.0
	05/03/17			260	240	1,000	2.1	6.6	1.2	4.6	0.15	0.64	0.15	0.66	0.51	2.2	<0.55	<2.0
	11/02/17			334	210	860	2.3	7.4	1.2	4.4	0.18	0.78	0.16	0.68	0.51	2.2	<0.55	<2.0
	02/12/18			290	230	960	1.3	4.0	0.48	1.8	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	03/28/18			270	190	760	0.59	1.9	0.21	0.79	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	08/06/18			--	210	840	1.30	4.2	0.80	3.00	0.12	0.53	0	1	0	2	<0.55	<2.0
	02/12/19			696	240	1,000	2.30	7.2	0.88	3.30	0.14	0.60	0	1	0	2	<0.55	<2.0
	11/25/19			730	240	1,000	0.53	1.7	0.42	1.60	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	02/18/20			149	16	64	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	05/15/20			697	190	760	0.81	2.6	0.69	2.6	<0.12	<0.50	0.12	0.54	0.28	1.2	<0.55	<2.0
08/24/20	615	130	540	0.88	2.8	0.45	1.70	<0.12	<0.50	<0.12	<0.50	0.28	1.2	<0.55	<2.0			
11/05/20	165	18	72	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0			
02/24/21	35	6.6	27	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0			
HW-8	11/25/19	8		--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
	02/18/20			3	<4.9	<20	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0
	05/15/20			7	<4.9	<20	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0
	08/24/20			15	<4.9	<20	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0
11/05/20	124	<4.9	<20	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0			
HW-9	11/25/19	8	8015 & 8260B	1,820	390	1,600	<0.16	<0.5	<0.13	<0.50	0.25	1.1	0.35	1.50	0.94	4.10	<0.55	<2.0
	02/18/20			530	320	1,300	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0
	05/15/20			1,058	510	2,100	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0
	08/24/20			7,848	560	2,300	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0
	11/05/20			1,421	340	1,400	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0
02/24/21	1,287	320	1,300	<0.16	<0.50	<0.13	<0.5	<0.12	<0.5	<0.12	<0.5	<0.23	<1.0	<0.55	<2.0			
VEW-32	07/09/14	1		154	132	540	<0.2	<0.5	<0.1	<0.5	<0.1	<0.5	<0.1	<0.5	<0.2	<1.0	<0.6	<2.0
	10/23/14			191	19	76	<0.2	<0.5	<0.1	<0.5	<0.1	<0.5	<0.1	<0.5	<0.2	<1.0	<0.6	<2.0
	04/27/15			210	320	1,300	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	08/10/15			456	460	1,900	0.66	2.1	<0.13	<0.50	0.23	1.0	<0.12	<0.50	0.46	2.0	<0.55	<2.0
	02/08/16			160	130	550	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	04/06/16			60	17	68	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
06/27/17	9.0	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0			
VEW-33	07/09/14	1		10	<4.9	<20	<0.2	<0.5	<0.1	<0.5	<0.1	<0.5	<0.1	<0.5	<0.2	<1.0	<0.6	<2.0
	10/23/14			22	6.6	27	<0.2	<0.5	<0.1	<0.5	<0.1	<0.5	<0.1	<0.5	<0.2	<1.0	<0.6	<2.0
	04/27/15			324	270	1,100	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	08/10/15			334	290	1,200	0.50	1.6	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	0.32	1.4	<0.55	<2.0
	02/08/16			220	270	1,100	0.38	1.2	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	04/06/16			380	340	1,400	0.50	1.6	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	0.25	1.1	<0.55	<2.0
06/27/17	5.8	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0			
VEW-34	07/09/14	1		4.2	<4.9	<20	<0.2	<0.5	<0.1	<0.5	<0.1	<0.5	<0.1	<0.5	<0.2	<1.0	<0.6	<2.0
	10/23/14			8.0	<4.9	<20	<0.2	<0.5	<0.1	<0.5	<0.1	<0.5	<0.1	<0.5	<0.2	<1.0	<0.6	<2.0
04/27/15	115	44	180	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0			



TABLE 10
Historical Summary of Analytical Vapor Sampling Results - Individual Wells
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Well ID	Sample Date	Notes	Laboratory Analysis Methods	GRO Field OVA Reading	GRO		Benzene		Toluene		Ethylbenzene		o-Xylene		m,p-Xylenes		MTBE	
				(ppmv)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)
VEW-34	08/10/15		8015 & 8260B	63	14	57	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	06/27/17			7.0	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
VEW-35	07/09/14	1		5.5	<4.9	<20	<0.2	<0.5	<0.1	<0.5	<0.1	<0.5	<0.1	<0.5	<0.2	<1.0	<0.6	<2.0
	10/23/14	28		<4.9	<20	<0.2	<0.5	<0.1	<0.5	<0.1	<0.5	<0.1	<0.5	<0.2	<1.0	<0.6	<2.0	
VEW-35	04/27/15			4.8	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	08/10/15			16.4	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
VEW-36	06/27/17	1		4.5	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	07/09/14			6.4	<4.9	<20	<0.2	<0.5	<0.1	<0.5	<0.1	<0.5	<0.1	<0.5	<0.2	<1.0	<0.6	<2.0
	10/23/14			9.1	<4.9	<20	<0.2	<0.5	<0.1	<0.5	<0.1	<0.5	<0.1	<0.5	<0.2	<1.0	<0.6	<2.0
	04/27/15			5.7	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
VEW-36	08/10/15			2.2	8.1	33	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	06/27/17			6.7	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	07/09/14			20	<4.9	<20	<0.2	<0.5	<0.1	<0.5	<0.1	<0.5	<0.1	<0.5	<0.2	<1.0	<0.6	<2.0
	10/23/14			151	<4.9	<20	<0.2	<0.5	<0.1	<0.5	<0.1	<0.5	<0.1	<0.5	<0.2	<1.0	<0.6	<2.0
VEW-37	04/27/15	1		2.4	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	08/10/15			3.9	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	06/27/17			5.7	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	07/09/14			331	37	150	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
VEW-38	07/27/17	3		--	490	2,000	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	09/07/17			480	440	1,800	<0.16	<0.50	<0.13	<0.50	0.17	0.74	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	06/27/18			51	8.3	34	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
VEW-39	06/27/17	3		130	37	150	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	07/27/17			--	1,100	4,300	0.41	1.3	<0.13	<0.50	0.78	3.4	<0.12	<0.50	0.62	2.7	<0.55	<2.0
	09/07/17			190	29	120	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
VEW-40	06/27/17	3	3,018	2,700	11,000	0.28	0.88	<0.13	<0.50	0.99	4.3	<0.12	<0.50	0.81	3.5	<0.55	<2.0	
	07/27/17		--	8,800	36,000	1.4	4.4	<0.13	<0.50	8.5	37	0.23	1.0	5.3	23	<0.55	<2.0	
	09/07/17		9,200	7,600	31,000	0.97	3.1	<0.13	<0.50	3.7	16	0.25	1.1	2.2	9.0	<0.55	<2.0	
	06/27/18		5,100	2,900	12,000	<0.78	<2.5	<0.78	<2.5	0.78	3.4	<0.58	<2.5	<1.2	<5.0	<2.8	<10	
RW-1	08/09/17	5	1,268	1,100	4,400	1.7	5.4	3.7	14	0.85	3.7	0.55	2.4	2.5	11	<0.55	<2.0	
	09/07/17		3,860	2,300	9,600	6.3	20	16	60	2.8	12	2.0	8.9	7.4	32	<0.55	<2.0	
RW-2	08/09/17	5	16	39	160	0.19	0.61	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	03/14/18		31	22	92	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
RW-3	03/14/18	6	68	37	150	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
RW-4	03/14/18	6	598	460	1,900	1.8	5.9	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
RW-5	03/14/18	6	4,600	2,900	12,000	1.7	5.5	<0.13	<0.50	0.78	3.4	0.18	0.76	2.5	11	<0.55	<2.0	
RW-7	08/09/17	5	120	320	1,300	<0.16	<0.50	0.14	0.53	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	03/14/18		54	64	260	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
RW-9	08/09/17	5	1,164	1,100	4,500	0.44	1.4	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	09/07/17		320	240	1,000	0.75	2.4	<0.13	<0.50	0.19	0.83	<0.12	<0.50	0.41	1.8	<0.55	<2.0	
	03/14/18		2,824	2,000	8,100	18	59	<0.13	<0.50	5.1	22	3.0	13	9.4	41	<0.55	<2.0	
RW-10	03/14/18	6	>10,000	14,000	58,000	14	45	<0.13	<0.50	0.69	3.0	0.53	2.3	5.8	25	<0.55	<2.0	
RW-11	03/14/18	6	420	230	950	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
RW-12	08/09/17	5	76	100	420	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	03/14/18		5.5	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	

TABLE 10
Historical Summary of Analytical Vapor Sampling Results - Individual Wells
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Well ID	Sample Date	Notes	Laboratory Analysis Methods	GRO Field OVA Reading	GRO		Benzene		Toluene		Ethylbenzene		o-Xylene		m,p-Xylenes		MTBE	
				(ppmv)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)
RW-13	08/09/17	5	8015 & 8260B	2,440	1,800	7,400	1.6	5.0	<0.13	<0.50	0.22	0.95	0.28	1.2	1.7	7.4	<0.55	<2.0
	09/07/17			2,870	1,800	7,400	5.9	19.0	<0.13	<0.50	1.8	7.9	1.5	6.4	6.4	28	<0.55	<2.0
	03/14/18			2,000	7,300	30,000	9.1	29	<0.13	<0.50	0.64	2.8	0.46	2.0	1.8	7.6	<0.55	<2.0
RW-14	03/14/18	6		1,235	950	3,900	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-18	08/09/17	5		374	170	700	1.3	4.2	<0.13	<0.50	0.32	1.4	0.28	1.2	1.2	5.3	<0.55	<2.0
	09/07/17			679	320	1,300	2.2	7.1	0.7	3	0.62	2.7	0.53	2.3	2.2	9.6	<0.55	<2.0
	03/14/18			937	490	2,000	1.4	4.4	<0.13	<0.50	<0.12	<0.50	0.25	1.1	0.76	3.3	<0.55	<2.0
RW-19	06/27/18	4		43	4.9	20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-20	08/16/17	5		129	73	300	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	09/07/17			58	61	250	<0.16	<0.50	<0.13	<0.50	0.16	0.69	<0.12	<0.50	0.32	1.4	<0.55	<2.0
	06/27/18			4	42	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55
RW-21	08/09/17	5		160	95	390	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	06/27/18	4		55	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-22	08/16/17	5		1,775	1,600	6,700	0.38	1.2	<0.13	<0.50	3.2	14	0.20	0.88	4.6	20	<0.55	<2.0
	09/07/17			1,379	1,200	5,000	0.44	1.4	<0.13	<0.50	2.2	9.5	0.48	2.1	3.2	14	<0.55	<2.0
	06/27/18			4	2,595	1,200	4,800	<0.78	<2.5	<0.66	<2.5	<0.58	<2.5	<0.58	<2.5	<1.2	<5.0	<2.8
RW-23	08/09/17	5		787	660	2,700	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	09/07/17			141	83	340	<0.16	<0.50	<0.13	<0.50	0.25	1.1	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-24	08/16/17	5		1,525	1,400	5,900	<0.16	<0.50	<0.13	<0.50	0.19	0.82	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	09/07/17			1,423	930	3,800	<0.16	<0.50	<0.13	<0.50	0.37	1.6	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	06/27/18			4	459	98	400	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55
RW-25	06/27/18	4		89	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-26	08/09/17	5		4,340	7,100	29,000	0.23	0.75	<0.13	<0.50	0.94	4.1	<0.12	<0.50	0.35	1.5	<0.55	<2.0
	09/07/17			3,290	3,200	13,000	<0.16	<0.50	<0.13	<0.50	0.88	3.8	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	06/27/18			4	1,821	710	2,900	<0.78	<2.5	<0.66	<2.5	<0.58	<2.5	<0.58	<2.5	<1.2	<5.0	<2.8
RW-27	06/27/18	4		1,215	420	1,700	<0.31	<1.0	<0.27	<1.0	<0.23	<1.0	<0.23	<1.0	<0.46	<2.0	<1.1	<4.0
RW-28	08/09/17	5		8,420	7,600	31,000	2.4	7.6	<0.13	<0.50	9.4	41	0.28	1.2	3.7	16	<0.55	<2.0
	09/07/17			8,080	7,300	30,000	1.7	5.5	<0.13	<0.50	8.1	35	0.25	1.1	3.0	13	<0.55	<2.0
	06/27/18			4	5,000	4,200	17,000	<0.78	<2.5	<0.66	<2.5	2.3	10	<0.58	<2.5	1.9	8.2	<2.8
RW-29	08/09/17	5		620	640	2,600	0.16	0.52	<0.13	<0.50	0.17	0.75	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	09/07/17			1,123	930	3,800	0.17	0.54	<0.13	<0.50	0.13	0.56	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
	06/27/18			4	2,563	780	3,200	<0.78	<2.5	<0.66	<2.5	<0.58	<2.5	<0.58	<2.5	<1.2	<5.0	<2.8
RW-30	08/09/17	5	6,550	12,000	50,000	0.85	2.7	<0.13	<0.50	17	72	<0.12	<0.50	0.81	3.5	<0.55	<2.0	
	09/07/17		8,240	3,200	13,000	<0.16	<0.50	<0.13	<0.50	6.9	30	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	06/27/18		4	32	13	54	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-31	08/09/17	5	7,165	6,800	28,000	1.2	3.9	0.20	0.76	3.2	14	1.6	7.1	3.7	16	<0.55	<2.0	
	09/07/17		3,400	2,900	12,000	0.4	1.4	<0.13	<0.50	3.0	13	1.1	4.9	2.3	10	<0.55	<2.0	
	06/27/18		4	80	12	51	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-32	08/16/17	5	820	880	3,600	<0.16	<0.50	<0.13	<0.50	0.78	3.4	<0.12	<0.50	0.28	1.2	<0.55	<2.0	
	09/07/17		715	810	3,300	0.17	0.54	<0.13	<0.50	0.55	2.4	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	06/27/18		4	421	66	270	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-33	08/16/17	5	1,230	860	3,500	<0.16	<0.50	<0.13	<0.50	0.44	1.9	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	09/07/17		836	640	2,600	<0.16	<0.50	<0.13	<0.50	0.35	1.5	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	
	06/27/18		4	843	210	840	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-34	06/27/18	4	46	<4.9	<20	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0	

TABLE 10
Historical Summary of Analytical Vapor Sampling Results - Individual Wells
 DFSP, Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Well ID	Sample Date	Notes	Laboratory Analysis Methods	GRO Field OVA Reading	GRO		Benzene		Toluene		Ethylbenzene		o-Xylene		m,p-Xylenes		MTBE	
				(ppmv)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)	(ppmv)	(µg/L)
RW-35	06/27/18	4	8015 & 8260B	416	83	340	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-36	06/27/18	4		452	440	1,800	<0.78	<2.5	<0.66	<2.5	<0.58	<2.5	<0.58	<2.5	<1.2	<5.0	<2.8	<10
RW-37	06/27/18	4		1,509	210	850	<0.31	<1.0	<0.27	<1.0	<0.23	<1.0	<0.23	<1.0	<0.46	<2.0	<1.1	<4.0
RW-38	06/27/18	4		134	24	100	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-39	06/27/18	4		24	37	150	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-40	06/27/18	4		1,782	2,900	12,000	<0.78	<2.5	<0.66	<2.5	0.78	3.4	<0.58	<2.5	<1.2	<5.0	<2.8	<10
RW-41	06/27/18	4		849	1,300	5,300	<0.78	<2.5	<0.66	<2.5	<0.58	<2.5	<0.58	<2.5	<1.2	<5.0	<2.8	<10
RW-42	06/27/18	4		3,040	1,500	6,200	<0.78	<2.5	<0.66	<2.5	<0.58	<2.5	<0.58	<2.5	<1.2	<5.0	<2.8	<10
RW-43	06/27/18	4		886	230	950	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-44	06/27/18	4		728	88	360	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	2.2	9.4	0.60	2.6	<0.55	<2.0
RW-45	06/27/18	4		56	14	57	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	0.12	0.50	<0.23	<1.0	<0.55	<2.0
RW-46	06/27/18	4		191	44	180	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-47	06/27/18	4		751	240	1,000	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-48	06/27/18	4		1,454	540	2,200	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-49	06/27/18	4		823	180	720	<0.16	<0.50	<0.13	<0.50	<0.12	<0.50	<0.12	<0.50	<0.23	<1.0	<0.55	<2.0
RW-50	06/27/18	4		5,000	1,600	6,500	<0.78	<2.5	<0.66	<2.5	1.2	5.0	<0.58	<2.5	<1.2	<5.0	<2.8	<10
RTF-18-NW	10/05/17	7		9,000	16,000	67,000	100	330	0.18	0.66	12	52	13	56	60	260	<0.55	<2.0
	10/09/17	7		3,635	18,000	72,000	170	550	<1.3	<5.0	17	75	19	83	92	400	<5.5	<20

Legend / Notes:

GRO = Gasoline range organics

OVA = Organic Vapor Analyzer (calibrated or correlated to Hexane)

MTBE = Methyl tertiary-butyl ether

ppmv = Parts per million by volume

µg/L = Micrograms per liter

<0.6 = Not detected at or above the method reporting limit (MRL) shown.

-- = Not measured

- Reported concentrations are shown in bold.

1 = Samples collected following system restart (off line since manual shut down on 05/29/14).

2 = Field OVA reading from 01/09/17.

3 = System tie in work to allow for vapor extraction completed during late June 2017 following installation per SGI's March 14, 2017 *Well Replacement Report and Work Plan*.

4 = System tie in work to allow for vapor extraction completed during late June 2018 following installation per SGI's July 2018 *Well Installation Completion Report*.

5 = System tie in work to allow for vapor extraction completed during early August 2017 following installation per SGI's June 30, 2017 *Remediation Well Installation Update Report*.

6 = System tie in work to allow for vapor extraction completed during mid-February 2018 following installation per SGI's June 30, 2017 *Remediation Well Installation Update Report*.

7 = Well temporarily utilized as an extraction point as part of vacuum enhanced LNAPL recovery testing per SGI's July 2018 *LNAPL Recovery Testing Report*.

8 = HW-3 abandoned and replaced on 6/7/19 and 6/10/19 and replaced with new horizontal wells HW-8 and HW-9. Nw HW's connected to VES Carbon system on 7/16/19.

* = Tabulated data corrected after determining well HW-3 was incorrectly labeled as well HW-7 and vice versa during late July 2017 re-development work.

TABLE 11A
Biosparge System Operations Summary - January
 DFSP Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Data Source	Notes	Cumulative Blower Runtime (hours)	Blower Discharge Pressure (psig)	Blower Discharge Temperature (°F)	HE Outlet Temperature (°F)	Main Header Pressure (psig)	Sparge Total Flow-dP (in WC)	Sparge Total Pressure (psig)	Sparge Total Temperature (°F)
01/01/21	Offline		10703.1	--	--	--	--	--	--	--
01/02/21	Offline		10703.1	--	--	--	--	--	--	--
01/03/21	Offline		10703.1	--	--	--	--	--	--	--
01/04/21	Offline		10703.1	--	--	--	--	--	--	--
01/05/21	Offline		10703.1	--	--	--	--	--	--	--
01/06/21	Technician	1	10703.1	--	--	--	--	--	--	--
01/07/21	Technician	2	10721.1	--	--	--	--	--	--	--
01/08/21	Offline		10721.1	--	--	--	--	--	--	--
01/09/21	Offline		10721.1	--	--	--	--	--	--	--
01/10/21	Offline		10721.1	--	--	--	--	--	--	--
01/11/21	Offline		10721.1	--	--	--	--	--	--	--
01/12/21	Technician	1	10721.3	--	--	--	--	--	--	--
01/13/21	*		10745.7	--	--	--	--	--	--	--
01/14/21	Technician		10770.0	7	235	121	6	5.0	8	112
01/15/21	*		10793.8	--	--	--	--	--	--	--
01/16/21	*		10817.5	--	--	--	--	--	--	--
01/17/21	*		10841.3	--	--	--	--	--	--	--
01/18/21	*		10865.0	--	--	--	--	--	--	--
01/19/21	*		10888.8	--	--	--	--	--	--	--
01/20/21	*		10912.5	--	--	--	--	--	--	--
01/21/21	*		10936.3	--	--	--	--	--	--	--
01/22/21	Technician	2	10960.0	--	--	--	--	--	--	--
01/23/21	Offline		10960.0	--	--	--	--	--	--	--
01/24/21	Offline		10960.0	--	--	--	--	--	--	--
01/25/21	Offline		10960.0	--	--	--	--	--	--	--
01/26/21	Offline		10960.0	--	--	--	--	--	--	--
01/27/21	Technician	1	10960.0	--	--	--	--	--	--	--
01/28/21	Technician		10982.1	10	216	90	8	7.9	7	86
01/29/21	*		11006.0	--	--	--	--	--	--	--
01/30/21	*		11029.9	--	--	--	--	--	--	--
01/31/21	*		11053.7	--	--	--	--	--	--	--

Legend / Notes:

System operating under SCAQMD Various Locations Permit #G52288

1 = Biosparge system restarted.

2 = Biosparge system manually shut down.

Biosparge wells on line this month (grouped by location):

Central Area - (TFB-15, -16, 17, -18, -19, -25), (TFB-20, -23, -24, -30, -33), (TFB-32, -35, -36, -37, -38), (TFB-7, -9, -10, -11, -12, -13, -14), (TFB-21, -26, -27, -28, -31, -34), (BSP-25, -26, -28, -29, -30), (BSP-21, -22, -23, -24, -27), (TFB-1, -2, -4, -5, -6, -8). **Eastern Area** - (RW-1, -6, -15, -16, -17), (BSP-10, -11, RW-2, -7, -11), (BSP-12, -13, RW-3, -8, -12, -18), (BSP-14, RW-4, -5, -9, -10, -13, -14); **Southern Area** - (BSP-19, -20, RW-21, -23, -26), (BSP-17, -18, RW-30, -31, -32, -34), (BSP-15, -16, RW-19, -20, -25, -28), (RW-22, -24, -27, -29, -33, -43), (RW-35, -38, -39, -40), (RW-36, -37, -41, -42, -46), (RW-47, -48, -49, -50).

psig = pounds per square inch

in. WC = inches of water column

°F = Degrees Fahrenheit

NA = Not available

HE = Heat Exchanger

-- = Not applicable or not measured

* = Operational values interpolated from chart recorder data or previous monitoring event.



TABLE 11B
Biosparge System Operations Summary - February
 DFSP Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Data Source	Notes	Cumulative Blower Runtime (hours)	Blower Discharge Pressure (psig)	Blower Discharge Temperature (°F)	HE Outlet Temperature (°F)	Main Header Pressure (psig)	Sparge Total Flow (in WC)	Sparge Total Pressure (psig)	Sparge Total Temperature (°F)
02/01/21	*		11077.6	--	--	--	--	--	--	--
02/02/21	*		11101.5	--	--	--	--	--	--	--
02/03/21	*		11125.4	--	--	--	--	--	--	--
02/04/21	*		11149.2	--	--	--	--	--	--	--
02/05/21	Technician		11173.1	10	230	105	8	8.1	7.6	88
02/06/21	*		11196.9	--	--	--	--	--	--	--
02/07/21	*		11220.7	--	--	--	--	--	--	--
02/08/21	*		11244.5	--	--	--	--	--	--	--
02/09/21	*		11268.2	--	--	--	--	--	--	--
02/10/21	*		11292.0	--	--	--	--	--	--	--
02/11/21	Technician		11315.8	9	210	94	8	8.6	6.5	88
02/12/21	*		11340.2	--	--	--	--	--	--	--
02/13/21	*		11364.6	--	--	--	--	--	--	--
02/14/21	*		11389.0	--	--	--	--	--	--	--
02/15/21	*		11413.3	--	--	--	--	--	--	--
02/16/21	*		11437.7	--	--	--	--	--	--	--
02/17/21	*		11462.1	--	--	--	--	--	--	--
02/18/21	Technician		11486.5	7	220	108	6	8.0	5.0	95
02/19/21	Technician	1	11512.2	--	--	--	--	--	--	--
02/20/21	Offline		11512.2	--	--	--	--	--	--	--
02/21/21	Offline		11512.2	--	--	--	--	--	--	--
02/22/21	Technician	2	11512.2	--	--	--	--	--	--	--
02/23/21	*		11536.6	--	--	--	--	--	--	--
02/24/21	*		11560.9	--	--	--	--	--	--	--
02/25/21	Technician		11585.3	--	--	--	--	--	--	--
02/26/21	*		11607.3	--	--	--	--	--	--	--
02/27/21	*		11629.2	--	--	--	--	--	--	--
02/28/21	*		11651.2	--	--	--	--	--	--	--

Legend / Notes:

System operating under SCAQMD Various Locations Permit #G52288

1 = Biosparge system manually shut down for scheduled SCE power outage.

2 = Biosparge system restarted.

Biosparge wells on line this month (grouped by location):

Central Area - (TFB-15, -16, 17, -18, -19, -25), (TFB-20, -23, -24, -30, -33), (TFB-32, -35, -36, -37, -38), (TFB-7, -9, -10, -11, -12, -13, -14), (TFB-21, -26, -27, -28, -31, -34), (BSP-25, -26, -28, -29, -30), (BSP-21, -22, -23, -24, -27), (TFB-1, -2, -4, -5, -6, -8). **Eastern Area** - (RW-1, -6, -15, -16, -17), (BSP-10, -11, RW-2, -7, -11), (BSP-12, -13, RW-3, -8, -12, -18), (BSP-14, RW-4, -5, -9, -10, -13, -14); **Southern Area** - (BSP-19, -20, RW-21, -23, -26), (BSP-17, -18, RW-30, -31, -32, -34), (BSP-15, -16, RW-19, -20, -25, -28), (RW-22, -24, -27, -29, -33, -43), (RW-35, -38, -39, -40), (RW-36, -37, -41, -42, -46), (RW-47, -48, -49, -50).

psig = pounds per square inch

in. WC = inches of water column

°F = Degrees Fahrenheit

NA = Not available

HE = Heat Exchanger

-- = Not applicable or not measured

* = Operational values interpolated from chart recorder data or previous monitoring event.



TABLE 11C
Biosparge System Operations Summary - March
 DFSP Norwalk
 15306 Norwalk Blvd., Norwalk, CA

Date	Data Source	Notes	Cumulative Blower Runtime (hours)	Blower Discharge Pressure (psig)	Blower Discharge Temperature (°F)	HE Outlet Temperature (°F)	Main Header Pressure (psig)	Sparge Total Flow (in WC)	Sparge Total Pressure (psig)	Sparge Total Temperature (°F)
03/01/21	*		11673.1	--	--	--	--	--	--	--
03/02/21	Technician		11695.1	10	100	100	8	8.5	7	95
03/03/21	*		11719.2	--	--	--	--	--	--	--
03/04/21	*		11743.3	--	--	--	--	--	--	--
03/05/21	*		11767.4	--	--	--	--	--	--	--
03/06/21	*		11791.6	--	--	--	--	--	--	--
03/07/21	*		11815.7	--	--	--	--	--	--	--
03/08/21	*		11839.8	--	--	--	--	--	--	--
03/09/21	Technician		11863.9	9	205	96	7	8.5	7	90
03/10/21	*		11888.1	--	--	--	--	--	--	--
03/11/21	*		11912.3	--	--	--	--	--	--	--
03/12/21	*		11936.5	--	--	--	--	--	--	--
03/13/21	*		11960.6	--	--	--	--	--	--	--
03/14/21	*		11984.8	--	--	--	--	--	--	--
03/15/21	Technician		12009.0	11	210	90	9	8.5	8	80
03/16/21	*		12032.7	--	--	--	--	--	--	--
03/17/21	*		12056.3	--	--	--	--	--	--	--
03/18/21	*		12080.0	--	--	--	--	--	--	--
03/19/21	*		12103.7	--	--	--	--	--	--	--
03/20/21	*		12127.3	--	--	--	--	--	--	--
03/21/21	*		12151.0	--	--	--	--	--	--	--
03/22/21	*		12174.7	--	--	--	--	--	--	--
03/23/21	*		12198.3	--	--	--	--	--	--	--
03/24/21	Technician		12222.0	9	210	100	8	9.0	5.5	95
03/25/21	Technician	1	12249.9	--	--	--	--	--	--	--
03/26/21	Offline		12249.9	--	--	--	--	--	--	--
03/27/21	Offline		12249.9	--	--	--	--	--	--	--
03/28/21	Offline		12249.9	--	--	--	--	--	--	--
03/29/21	Technician	2	12249.9	--	--	--	--	--	--	--
03/30/21	Technician		12274.1	9	215	100	7	8.5	7.0	94
03/31/21	*		12290.1	--	--	--	--	--	--	--

Legend / Notes:

System operating under SCAQMD Various Locations Permit #G52288

1 = Biosparge system manually shut down.

2 = Biosparge system restarted.

Biosparge wells on line this month (grouped by location):

Central Area - (TFB-15, -16, 17, -18, -19, -25), (TFB-20, -23, -24, -30, -33), (TFB-32, -35, -36, -37, -38), (TFB-7, -9, -10, -11, -12, -13, -14), (TFB-21, -26, -27, -28, -31, -34), (BSP-25, -26, -28, -29, -30), (BSP-21, -22, -23, -24, -27), (TFB-1, -2, -3, -4, -5, -6, -8). **Eastern Area**- (RW-1, -6, -15, -16, -17), (BSP-10, -11, RW-2, -7, -11), (BSP-12, -13, RW-3, -8, -12, -18), (BSP-14, RW-4, -5, -9, -10, -13, -14); **Southern Area** - (BSP-19, -20, RW-21, -23, -26), (BSP-17, -18, RW-30, -31, -32, -34), (BSP-15, -16, -19, -20, -25, -28), (RW-22, -24, -27, -29, -33, -43), (RW-40), (RW-36, -37, -41, -42, -46), (RW-47, -48, -49, -50).

psig = pounds per square inch

in. WC = inches of water column

°F = Degrees Fahrenheit

NA = Not available

HE = Heat Exchanger

-- = Not applicable or not measured

* = Operational values interpolated from chart recorder data or previous monitoring event.



APPENDIX A

LABORATORY ANALYTICAL REPORTS AND CHAIN-OF-CUSTODY DOCUMENTS



9765 Eton Avenue
Chatsworth
California 91311
Tel: (818) 998-5547
Fax: (818) 998-7258

March 04, 2021

Neil Irish

The Source Group, Inc. (SH)
1962 Freeman Ave.
Signal Hill, CA 90755

**Re : DFSP Norwalk VES AQMD / 04-NDLA-013
A5333941 / 1B24010**

Enclosed is an analytical report for the above-referenced project. The samples included in this report were received on 02/24/21 17:38 and analyzed in accordance with the attached chain-of-custody.

Unless otherwise noted, all analytical testing was accomplished in accordance with the guidelines established in our Quality Assurance Program Manual, applicable standard operating procedures, and other related documentation. The results in this analytical report are limited to the samples tested and any reproduction thereof must be made in its entirety.

If you have any questions regarding this report or require additional information please call me at American Analytix.

Sincerely,

A handwritten signature in black ink, appearing to read 'V. Vasile'.

Viorel Vasile
Operations Manager

**LABORATORY ANALYSIS RESULTS**

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333941
Date Received: 02/24/21
Date Reported: 03/04/21

Sample ID	Laboratory ID	Matrix	TAT	Date Sampled	Date Received
-----------	---------------	--------	-----	--------------	---------------

VOCs BTEX/MTBE Vapor GC/MS

After GAC-1	1B24010-01	Vapor	5	02/24/21 09:24	02/24/21 17:38
After GAC-2	1B24010-02	Vapor	5	02/24/21 09:23	02/24/21 17:38

VOCs Gasoline Range Organics Vapor

After GAC-1	1B24010-01	Vapor	5	02/24/21 09:24	02/24/21 17:38
After GAC-2	1B24010-02	Vapor	5	02/24/21 09:23	02/24/21 17:38

VOCs in Vapor as Hexane

After GAC-1	1B24010-01	Vapor	5	02/24/21 09:24	02/24/21 17:38
After GAC-2	1B24010-02	Vapor	5	02/24/21 09:23	02/24/21 17:38

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333941
Date Received: 02/24/21
Date Reported: 03/04/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

After GAC-1

1B24010-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.50	ug/L	0.50	<0.16	ppmv	0.16
Ethylbenzene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	<0.50	ug/L	0.50	<0.13	ppmv	0.13
o-Xylene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
m,p-Xylenes	<1.0	ug/L	1.0	<0.23	ppmv	0.23

Surrogates	%REC	%REC Limits
4-Bromofluorobenzene	98.1 %	70-140
Dibromofluoromethane	82.4 %	70-140
Toluene-d8	87.4 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333941
Date Received: 02/24/21
Date Reported: 03/04/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

After GAC-2

1B24010-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.50	ug/L	0.50	<0.16	ppmv	0.16
Ethylbenzene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	<0.50	ug/L	0.50	<0.13	ppmv	0.13
o-Xylene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
m,p-Xylenes	<1.0	ug/L	1.0	<0.23	ppmv	0.23

Surrogates	%REC	%REC Limits
4-Bromofluorobenzene	97.5 %	70-140
Dibromofluoromethane	83.1 %	70-140
Toluene-d8	87.0 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333941
Date Received: 02/24/21
Date Reported: 03/04/21
Sampled: 02/24/21
Prepared: 02/26/21
Analyzed: 02/26/21

After GAC-1

1B24010-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	<20	ug/L	20	<4.9	ppmv	4.9
Surrogates		%REC				%REC Limits
a,a,a-Trifluorotoluene		85.2 %				70-130

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333941
Date Received: 02/24/21
Date Reported: 03/04/21
Sampled: 02/24/21
Prepared: 02/26/21
Analyzed: 02/26/21

After GAC-2

1B24010-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	<20	ug/L	20	<4.9	ppmv	4.9
Surrogates		%REC				%REC Limits
a,a,a-Trifluorotoluene		85.2 %				70-130

Viorel Vasile
Operations Manager

**LABORATORY ANALYSIS RESULTS**

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Method: VOCs in Vapor as Hexane

AA Project No: A5333941
Date Received: 02/24/21
Date Reported: 03/04/21
Units: ppmv

Date Sampled:	02/24/21	02/24/21	
Date Prepared:	02/26/21	02/26/21	
Date Analyzed:	02/26/21	02/26/21	
AA ID No:	1B24010-01	1B24010-02	
Client ID No:	After GAC-1	After GAC-2	
Matrix:	Vapor	Vapor	
Dilution Factor:	1	1	MRL

VOCs in Vapor as Hexane (EPA 8015M)

Total VOCs as Hexane	<4.9	<4.9	4.9
----------------------	------	------	-----

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333941
Date Received: 02/24/21
Date Reported: 03/04/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC %REC	Limits	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1B2512 - *** DEFAULT PREP ***</i>										
Blank (B1B2512-BLK1)				Prepared & Analyzed: 02/25/21						
Benzene	<0.25	0.25	ug/L							
Ethylbenzene	<0.25	0.25	ug/L							
Methyl-tert-Butyl Ether (MTBE)	<1.0	1.0	ug/L							
Toluene	<0.25	0.25	ug/L							
o-Xylene	<0.25	0.25	ug/L							
m,p-Xylenes	<0.50	0.50	ug/L							
<i>Surrogate: 4-Bromofluorobenzene</i>	49.8		ug/L	50.0		99.6	70-140			
<i>Surrogate: Dibromofluoromethane</i>	43.3		ug/L	50.0		86.5	70-140			
<i>Surrogate: Toluene-d8</i>	43.1		ug/L	50.0		86.2	70-140			
LCS (B1B2512-BS1)				Prepared & Analyzed: 02/25/21						
Benzene	17.4	0.50	ug/L	20.0		86.8	75-125			
Ethylbenzene	20.0	0.50	ug/L	20.0		99.8	75-125			
Methyl-tert-Butyl Ether (MTBE)	32.6	2.0	ug/L	40.0		81.5	75-125			
Toluene	19.5	0.50	ug/L	20.0		97.6	75-125			
o-Xylene	19.6	0.50	ug/L	20.0		97.8	75-125			
m,p-Xylenes	40.7	1.0	ug/L	40.0		102	75-125			
<i>Surrogate: 4-Bromofluorobenzene</i>	49.4		ug/L	50.0		98.7	70-140			
<i>Surrogate: Dibromofluoromethane</i>	39.2		ug/L	50.0		78.4	70-140			
<i>Surrogate: Toluene-d8</i>	43.8		ug/L	50.0		87.7	70-140			
LCS Dup (B1B2512-BSD1)				Prepared & Analyzed: 02/25/21						
Benzene	17.4	0.50	ug/L	20.0		87.2	75-125	0.345	30	
Ethylbenzene	20.0	0.50	ug/L	20.0		100	75-125	0.250	30	
Methyl-tert-Butyl Ether (MTBE)	32.3	2.0	ug/L	40.0		80.8	75-125	0.955	30	
Toluene	19.6	0.50	ug/L	20.0		98.0	75-125	0.307	30	
o-Xylene	19.4	0.50	ug/L	20.0		97.0	75-125	0.821	30	
m,p-Xylenes	40.9	1.0	ug/L	40.0		102	75-125	0.589	30	
<i>Surrogate: 4-Bromofluorobenzene</i>	48.8		ug/L	50.0		97.6	70-140			
<i>Surrogate: Dibromofluoromethane</i>	38.6		ug/L	50.0		77.2	70-140			
<i>Surrogate: Toluene-d8</i>	44.1		ug/L	50.0		88.2	70-140			
Duplicate (B1B2512-DUP1)				Source: 1B24011-04 Prepared & Analyzed: 02/25/21						

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333941
Date Received: 02/24/21
Date Reported: 03/04/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control

Batch B1B2512 - *** DEFAULT PREP ***

Duplicate (B1B2512-DUP1) Continued Source: 1B24011-04 Prepared & Analyzed: 02/25/21

Benzene	<0.50	0.50	ug/L		0.210				30	
Ethylbenzene	<0.50	0.50	ug/L						30	
Methyl-tert-Butyl Ether (MTBE)	<2.0	2.0	ug/L						30	
Toluene	<0.50	0.50	ug/L						30	
o-Xylene	<0.50	0.50	ug/L						30	
m,p-Xylenes	<1.0	1.0	ug/L		0.830			8.81	30	
Surrogate: 4-Bromofluorobenzene	46.8		ug/L	50.0		93.6	70-140			
Surrogate: Dibromofluoromethane	43.0		ug/L	50.0		86.1	70-140			
Surrogate: Toluene-d8	44.6		ug/L	50.0		89.3	70-140			

Gasoline Range Organics in Vapor by GC/FID - Quality Control

Batch B1B2601 - *** DEFAULT PREP ***

Blank (B1B2601-BLK1) Prepared & Analyzed: 02/26/21

Gasoline Range Organics (GRO)	<20	20	ug/L							
Surrogate: a,a,a-Trifluorotoluene	42.7		ug/L	50.0		85.4	70-130			

LCS (B1B2601-BS1) Prepared & Analyzed: 02/26/21

Gasoline Range Organics (GRO)	485	20	ug/L	500		97.0	75-125			
Surrogate: a,a,a-Trifluorotoluene	51.6		ug/L	50.0		103	70-130			

LCS Dup (B1B2601-BSD1) Prepared & Analyzed: 02/26/21

Gasoline Range Organics (GRO)	504	20	ug/L	500		101	75-125	3.87	30	
Surrogate: a,a,a-Trifluorotoluene	52.6		ug/L	50.0		105	70-130			

Duplicate (B1B2601-DUP1) Source: 1B24010-01 Prepared & Analyzed: 02/26/21

Gasoline Range Organics (GRO)	<20	20	ug/L		<20				30	
Surrogate: a,a,a-Trifluorotoluene	46.7		ug/L	50.0		93.5	70-130			

VOCs in Vapor as Hexane - Quality Control

Batch B1B2601 - *** DEFAULT PREP ***

Blank (B1B2601-BLK1) Prepared & Analyzed: 02/26/21

Total VOCs as Hexane	<4.9	4.9	ppmv							
----------------------	------	-----	------	--	--	--	--	--	--	--

Duplicate (B1B2601-DUP1) Source: 1B24010-01 Prepared & Analyzed: 02/26/21

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333941
Date Received: 02/24/21
Date Reported: 03/04/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs in Vapor as Hexane - Quality Control										
<i>Batch B1B2601 - *** DEFAULT PREP ***</i>										
Duplicate (B1B2601-DUP1) Continued Source: 1B24010-01 Prepared & Analyzed: 02/26/21										
Total VOCs as Hexane	<4.9	4.9	ppmv		<4.9				30	

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333941
Date Received: 02/24/21
Date Reported: 03/04/21

Special Notes

A handwritten signature in black ink, appearing to be 'VA' or similar, located below the 'Special Notes' section.

Viorel Vasile
Operations Manager



9765 Eton Avenue
Chatsworth
California 91311
Tel: (818) 998-5547
Fax: (818) 998-7258

March 04, 2021

Neil Irish

The Source Group, Inc. (SH)
1962 Freeman Ave.
Signal Hill, CA 90755

**Re : DFSP Norwalk VES AQMD / 04-NDLA-013
A5333943 / 1B24012**

Enclosed is an analytical report for the above-referenced project. The samples included in this report were received on 02/24/21 17:38 and analyzed in accordance with the attached chain-of-custody.

Unless otherwise noted, all analytical testing was accomplished in accordance with the guidelines established in our Quality Assurance Program Manual, applicable standard operating procedures, and other related documentation. The results in this analytical report are limited to the samples tested and any reproduction thereof must be made in its entirety.

If you have any questions regarding this report or require additional information please call me at American Analytix.

Sincerely,

A handwritten signature in black ink, appearing to be 'V. Vasile'.

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333943
Date Received: 02/24/21
Date Reported: 03/04/21

Sample ID	Laboratory ID	Matrix	TAT	Date Sampled	Date Received
-----------	---------------	--------	-----	--------------	---------------

VOCs BTEX/MTBE Vapor GC/MS

VES Carbon-Influent	1B24012-01	Vapor	5	02/24/21 09:25	02/24/21 17:38
VES Carbon-Effluent	1B24012-02	Vapor	5	02/24/21 09:21	02/24/21 17:38

VOCs Gasoline Range Organics Vapor

VES Carbon-Influent	1B24012-01	Vapor	5	02/24/21 09:25	02/24/21 17:38
VES Carbon-Effluent	1B24012-02	Vapor	5	02/24/21 09:21	02/24/21 17:38

VOCs in Vapor as Hexane

VES Carbon-Influent	1B24012-01	Vapor	5	02/24/21 09:25	02/24/21 17:38
VES Carbon-Effluent	1B24012-02	Vapor	5	02/24/21 09:21	02/24/21 17:38

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333943
Date Received: 02/24/21
Date Reported: 03/04/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

VES Carbon-Influent
1B24012-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.50	ug/L	0.50	<0.16	ppmv	0.16
Ethylbenzene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	<0.50	ug/L	0.50	<0.13	ppmv	0.13
o-Xylene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
m,p-Xylenes	<1.0	ug/L	1.0	<0.23	ppmv	0.23

<u>Surrogates</u>	<u>%REC</u>	<u>%REC Limits</u>
4-Bromofluorobenzene	99.1 %	70-140
Dibromofluoromethane	85.7 %	70-140
Toluene-d8	86.4 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 0.5
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333943
Date Received: 02/24/21
Date Reported: 03/04/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

VES Carbon-Effluent
1B24012-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.25	ug/L	0.50	<0.078	ppmv	0.16
Ethylbenzene	<0.25	ug/L	0.50	<0.058	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<1.0	ug/L	2.0	<0.28	ppmv	0.55
Toluene	<0.25	ug/L	0.50	<0.066	ppmv	0.13
o-Xylene	<0.25	ug/L	0.50	<0.058	ppmv	0.12
m,p-Xylenes	<0.50	ug/L	1.0	<0.12	ppmv	0.23

<u>Surrogates</u>	<u>%REC</u>	<u>%REC Limits</u>
4-Bromofluorobenzene	99.9 %	70-140
Dibromofluoromethane	86.0 %	70-140
Toluene-d8	88.1 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333943
Date Received: 02/24/21
Date Reported: 03/04/21
Sampled: 02/24/21
Prepared: 02/26/21
Analyzed: 02/26/21

VES Carbon-Influent
1B24012-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	<20	ug/L	20	<4.9	ppmv	4.9
<u>Surrogates</u>		<u>%REC</u>			<u>%REC Limits</u>	
a,a,a-Trifluorotoluene		85.8 %			70-130	

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333943
Date Received: 02/24/21
Date Reported: 03/04/21
Sampled: 02/24/21
Prepared: 02/26/21
Analyzed: 02/26/21

VES Carbon-Effluent
1B24012-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	<20	ug/L	20	<4.9	ppmv	4.9
<u>Surrogates</u>		<u>%REC</u>			<u>%REC Limits</u>	
a,a,a-Trifluorotoluene		87.6 %			70-130	

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Method: VOCs in Vapor as Hexane

AA Project No: A5333943
Date Received: 02/24/21
Date Reported: 03/04/21
Units: ppmv

Date Sampled:	02/24/21	02/24/21	
Date Prepared:	02/26/21	02/26/21	
Date Analyzed:	02/26/21	02/26/21	
AA ID No:	1B24012-01	1B24012-02	
Client ID No:	VES	VES	
	Carbon-Influent	Carbon-Effluent	
Matrix:	Vapor	Vapor	
Dilution Factor:	1	1	MRL

VOCs in Vapor as Hexane (EPA 8015M)

Total VOCs as Hexane	<4.9	<4.9	4.9
----------------------	------	------	-----

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333943
Date Received: 02/24/21
Date Reported: 03/04/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC %REC	Limit	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1B2512 - *** DEFAULT PREP ***</i>										
Blank (B1B2512-BLK1)				Prepared & Analyzed: 02/25/21						
Benzene	<0.25	0.25	ug/L							
Ethylbenzene	<0.25	0.25	ug/L							
Methyl-tert-Butyl Ether (MTBE)	<1.0	1.0	ug/L							
Toluene	<0.25	0.25	ug/L							
o-Xylene	<0.25	0.25	ug/L							
m,p-Xylenes	<0.50	0.50	ug/L							
<i>Surrogate: 4-Bromofluorobenzene</i>	49.8		ug/L	50.0		99.6	70-140			
<i>Surrogate: Dibromofluoromethane</i>	43.3		ug/L	50.0		86.5	70-140			
<i>Surrogate: Toluene-d8</i>	43.1		ug/L	50.0		86.2	70-140			
LCS (B1B2512-BS1)				Prepared & Analyzed: 02/25/21						
Benzene	17.4	0.50	ug/L	20.0		86.8	75-125			
Ethylbenzene	20.0	0.50	ug/L	20.0		99.8	75-125			
Methyl-tert-Butyl Ether (MTBE)	32.6	2.0	ug/L	40.0		81.5	75-125			
Toluene	19.5	0.50	ug/L	20.0		97.6	75-125			
o-Xylene	19.6	0.50	ug/L	20.0		97.8	75-125			
m,p-Xylenes	40.7	1.0	ug/L	40.0		102	75-125			
<i>Surrogate: 4-Bromofluorobenzene</i>	49.4		ug/L	50.0		98.7	70-140			
<i>Surrogate: Dibromofluoromethane</i>	39.2		ug/L	50.0		78.4	70-140			
<i>Surrogate: Toluene-d8</i>	43.8		ug/L	50.0		87.7	70-140			
LCS Dup (B1B2512-BSD1)				Prepared & Analyzed: 02/25/21						
Benzene	17.4	0.50	ug/L	20.0		87.2	75-125	0.345	30	
Ethylbenzene	20.0	0.50	ug/L	20.0		100	75-125	0.250	30	
Methyl-tert-Butyl Ether (MTBE)	32.3	2.0	ug/L	40.0		80.8	75-125	0.955	30	
Toluene	19.6	0.50	ug/L	20.0		98.0	75-125	0.307	30	
o-Xylene	19.4	0.50	ug/L	20.0		97.0	75-125	0.821	30	
m,p-Xylenes	40.9	1.0	ug/L	40.0		102	75-125	0.589	30	
<i>Surrogate: 4-Bromofluorobenzene</i>	48.8		ug/L	50.0		97.6	70-140			
<i>Surrogate: Dibromofluoromethane</i>	38.6		ug/L	50.0		77.2	70-140			
<i>Surrogate: Toluene-d8</i>	44.1		ug/L	50.0		88.2	70-140			
Duplicate (B1B2512-DUP1)				Source: 1B24011-04 Prepared & Analyzed: 02/25/21						

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333943
Date Received: 02/24/21
Date Reported: 03/04/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control

Batch B1B2512 - *** DEFAULT PREP ***

Duplicate (B1B2512-DUP1) Continued Source: 1B24011-04 Prepared & Analyzed: 02/25/21

Benzene	<0.50	0.50	ug/L		0.210				30	
Ethylbenzene	<0.50	0.50	ug/L						30	
Methyl-tert-Butyl Ether (MTBE)	<2.0	2.0	ug/L						30	
Toluene	<0.50	0.50	ug/L						30	
o-Xylene	<0.50	0.50	ug/L						30	
m,p-Xylenes	<1.0	1.0	ug/L		0.830			8.81	30	
Surrogate: 4-Bromofluorobenzene	46.8		ug/L	50.0		93.6	70-140			
Surrogate: Dibromofluoromethane	43.0		ug/L	50.0		86.1	70-140			
Surrogate: Toluene-d8	44.6		ug/L	50.0		89.3	70-140			

Gasoline Range Organics in Vapor by GC/FID - Quality Control

Batch B1B2601 - *** DEFAULT PREP ***

Blank (B1B2601-BLK1) Prepared & Analyzed: 02/26/21

Gasoline Range Organics (GRO)	<20	20	ug/L							
Surrogate: a,a,a-Trifluorotoluene	42.7		ug/L	50.0		85.4	70-130			

LCS (B1B2601-BS1) Prepared & Analyzed: 02/26/21

Gasoline Range Organics (GRO)	485	20	ug/L	500		97.0	75-125			
Surrogate: a,a,a-Trifluorotoluene	51.6		ug/L	50.0		103	70-130			

LCS Dup (B1B2601-BSD1) Prepared & Analyzed: 02/26/21

Gasoline Range Organics (GRO)	504	20	ug/L	500		101	75-125	3.87	30	
Surrogate: a,a,a-Trifluorotoluene	52.6		ug/L	50.0		105	70-130			

Duplicate (B1B2601-DUP1) Source: 1B24010-01 Prepared & Analyzed: 02/26/21

Gasoline Range Organics (GRO)	<20	20	ug/L						30	
Surrogate: a,a,a-Trifluorotoluene	46.7		ug/L	50.0		93.5	70-130			

VOCs in Vapor as Hexane - Quality Control

Batch B1B2601 - *** DEFAULT PREP ***

Blank (B1B2601-BLK1) Prepared & Analyzed: 02/26/21

Total VOCs as Hexane	<4.9	4.9	ppmv							
----------------------	------	-----	------	--	--	--	--	--	--	--

Duplicate (B1B2601-DUP1) Source: 1B24010-01 Prepared & Analyzed: 02/26/21

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333943
Date Received: 02/24/21
Date Reported: 03/04/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs in Vapor as Hexane - Quality Control										
<i>Batch B1B2601 - *** DEFAULT PREP ***</i>										
Duplicate (B1B2601-DUP1) Continued Source: 1B24010-01 Prepared & Analyzed: 02/26/21										
Total VOCs as Hexane	<4.9	4.9	ppmv						30	

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333943
Date Received: 02/24/21
Date Reported: 03/04/21

Special Notes

A handwritten signature in black ink, appearing to be 'AV' or similar initials.

Viorel Vasile
Operations Manager



AMERICAN ANALYTICS CHAIN-OF-CUSTODY RECORD

9765 ETON AVE., CHATSWORTH, CA 91311
Tel: 818-998-5547 FAX: 818-998-7258

22135

Client: The Source Group, Inc.	Project Name / No.: DFSP - Norwalk / 091-NOR-001	Sampler's Name: Glenn Androsko
Project Manager: Neil Irish	Site Address: 15306 Norwalk Blvd	Sampler's Signature:
Phone: 562-597-1055	City: Norwalk	P.O. No.:
Fax: 569-597-1070	State & Zip: CA 90650	Quote No.:

TAT Turnaround Codes **

- ① = Same Day Rush
- ② = 24 Hour Rush
- ③ = 48 Hour Rush
- ④ = 72 Hour Rush
- ⑤ = 5 Day Rush
- X = 10 Working Days (Standard TAT)

ANALYSIS REQUESTED (Test Name)

Client I.D.	Sample Matrix	Date	Time	No. of Cont	Please enter the TAT Turnaround Codes ** below			Special Instructions
					Total VOCs Gas 8019	Total VOCs Hexane 8015	BTEX/MTBE 8260B	
VES Carbon-Influent	Air	2-24-21	0925	1	✓	✓	✓	VOC's reported as
VES Carbon-Effluent	Air	"	0921	1	✓	✓	✓	GRO (detection limit = 4.9 ppmv) and VOCs as Hexane (detection limit = 4.9 ppmv)
								Benzene (detection limit = 0.15 ppmv)

PRIORITY

Relinquished by	Date	Time	Received by
	2-24-21	1200	
	2/24/21	1738	
	1/Date	Time	

AS333943 / 1324012

Note: By relinquishing samples to American Analytics, client agrees to pay for the services requested on this chain of custody form and any additional client-requested analyses performed on this project. Payment for services is due within 30 days from the date of invoice. Sample(s) will be disposed of after 45 days following the submittal of the sample(s) to American Analytics.



9765 Eton Avenue
Chatsworth
California 91311
Tel: (818) 998-5547
Fax: (818) 998-7258

March 16, 2021

Neil Irish

The Source Group, Inc. (SH)
1962 Freeman Ave.
Signal Hill, CA 90755

**Re : DFSP Norwalk VES AQMD / 04-NDLA-013
A5333947 / 1C08015**

Enclosed is an analytical report for the above-referenced project. The samples included in this report were received on 03/08/21 16:58 and analyzed in accordance with the attached chain-of-custody.

Unless otherwise noted, all analytical testing was accomplished in accordance with the guidelines established in our Quality Assurance Program Manual, applicable standard operating procedures, and other related documentation. The results in this analytical report are limited to the samples tested and any reproduction thereof must be made in its entirety.

If you have any questions regarding this report or require additional information please call me at American Analytix.

Sincerely,

A handwritten signature in black ink, appearing to read 'V. Vasile'.

Viorel Vasile
Operations Manager

**LABORATORY ANALYSIS RESULTS**

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333947
Date Received: 03/08/21
Date Reported: 03/16/21

Sample ID	Laboratory ID	Matrix	TAT	Date Sampled	Date Received
-----------	---------------	--------	-----	--------------	---------------

VOCs BTEX/MTBE Vapor GC/MS

VES After GAC-1	1C08015-01	Vapor	5	03/08/21 09:17	03/08/21 16:58
VES After GAC-2	1C08015-02	Vapor	5	03/08/21 09:16	03/08/21 16:58

VOCs Gasoline Range Organics Vapor

VES After GAC-1	1C08015-01	Vapor	5	03/08/21 09:17	03/08/21 16:58
VES After GAC-2	1C08015-02	Vapor	5	03/08/21 09:16	03/08/21 16:58

VOCs in Vapor as Hexane

VES After GAC-1	1C08015-01	Vapor	5	03/08/21 09:17	03/08/21 16:58
VES After GAC-2	1C08015-02	Vapor	5	03/08/21 09:16	03/08/21 16:58

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333947
Date Received: 03/08/21
Date Reported: 03/16/21
Sampled: 03/08/21
Prepared: 03/09/21
Analyzed: 03/09/21

VES After GAC-1
1C08015-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.50	ug/L	0.50	<0.16	ppmv	0.16
Ethylbenzene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	<0.50	ug/L	0.50	<0.13	ppmv	0.13
o-Xylene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
m,p-Xylenes	<1.0	ug/L	1.0	<0.23	ppmv	0.23

<u>Surrogates</u>	<u>%REC</u>	<u>%REC Limits</u>
4-Bromofluorobenzene	104 %	70-140
Dibromofluoromethane	110 %	70-140
Toluene-d8	103 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333947
Date Received: 03/08/21
Date Reported: 03/16/21
Sampled: 03/08/21
Prepared: 03/09/21
Analyzed: 03/09/21

VES After GAC-2
1C08015-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.50	ug/L	0.50	<0.16	ppmv	0.16
Ethylbenzene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	<0.50	ug/L	0.50	<0.13	ppmv	0.13
o-Xylene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
m,p-Xylenes	<1.0	ug/L	1.0	<0.23	ppmv	0.23

<u>Surrogates</u>	<u>%REC</u>	<u>%REC Limits</u>
4-Bromofluorobenzene	104 %	70-140
Dibromofluoromethane	111 %	70-140
Toluene-d8	104 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333947
Date Received: 03/08/21
Date Reported: 03/16/21
Sampled: 03/08/21
Prepared: 03/09/21
Analyzed: 03/09/21

VES After GAC-1

1C08015-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	<20	ug/L	20	<4.9	ppmv	4.9
<u>Surrogates</u>		<u>%REC</u>				<u>%REC Limits</u>
a,a,a-Trifluorotoluene		82.9 %				70-130

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333947
Date Received: 03/08/21
Date Reported: 03/16/21
Sampled: 03/08/21
Prepared: 03/09/21
Analyzed: 03/09/21

VES After GAC-2

1C08015-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	<20	ug/L	20	<4.9	ppmv	4.9

<u>Surrogates</u>	<u>%REC</u>	<u>%REC Limits</u>
a,a,a-Trifluorotoluene	92.6 %	70-130

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Method: VOCs in Vapor as Hexane

AA Project No: A5333947
Date Received: 03/08/21
Date Reported: 03/16/21
Units: ppmv

Date Sampled:	03/08/21	03/08/21	
Date Prepared:	03/09/21	03/09/21	
Date Analyzed:	03/09/21	03/09/21	
AA ID No:	1C08015-01	1C08015-02	
Client ID No:	VES After GAC-1	VES After GAC-2	
Matrix:	Vapor	Vapor	
Dilution Factor:	1	1	MRL

VOCs in Vapor as Hexane (EPA 8015M)

Total VOCs as Hexane	<4.9	<4.9	4.9
----------------------	------	------	-----

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333947
Date Received: 03/08/21
Date Reported: 03/16/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC %REC	Limits	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1C0916 - *** DEFAULT PREP ***</i>										
Blank (B1C0916-BLK1)				Prepared & Analyzed: 03/09/21						
Benzene	<0.25	0.25	ug/L							
Ethylbenzene	<0.25	0.25	ug/L							
Methyl-tert-Butyl Ether (MTBE)	<1.0	1.0	ug/L							
Toluene	<0.25	0.25	ug/L							
o-Xylene	<0.25	0.25	ug/L							
m,p-Xylenes	<0.50	0.50	ug/L							
<i>Surrogate: 4-Bromofluorobenzene</i>	52.1		ug/L	50.0		104	70-140			
<i>Surrogate: Dibromofluoromethane</i>	56.5		ug/L	50.0		113	70-140			
<i>Surrogate: Toluene-d8</i>	51.9		ug/L	50.0		104	70-140			
LCS (B1C0916-BS1)				Prepared & Analyzed: 03/09/21						
Benzene	22.1	0.50	ug/L	20.0		110	75-125			
Ethylbenzene	22.0	0.50	ug/L	20.0		110	75-125			
Methyl-tert-Butyl Ether (MTBE)	41.8	2.0	ug/L	40.0		104	75-125			
Toluene	20.7	0.50	ug/L	20.0		104	75-125			
o-Xylene	20.6	0.50	ug/L	20.0		103	75-125			
m,p-Xylenes	41.3	1.0	ug/L	40.0		103	75-125			
<i>Surrogate: 4-Bromofluorobenzene</i>	52.4		ug/L	50.0		105	70-140			
<i>Surrogate: Dibromofluoromethane</i>	51.2		ug/L	50.0		102	70-140			
<i>Surrogate: Toluene-d8</i>	52.3		ug/L	50.0		105	70-140			
LCS Dup (B1C0916-BSD1)				Prepared & Analyzed: 03/09/21						
Benzene	20.9	0.50	ug/L	20.0		105	75-125	5.30	30	
Ethylbenzene	21.8	0.50	ug/L	20.0		109	75-125	0.548	30	
Methyl-tert-Butyl Ether (MTBE)	43.0	2.0	ug/L	40.0		107	75-125	2.88	30	
Toluene	20.9	0.50	ug/L	20.0		105	75-125	1.15	30	
o-Xylene	20.8	0.50	ug/L	20.0		104	75-125	1.25	30	
m,p-Xylenes	42.0	1.0	ug/L	40.0		105	75-125	1.78	30	
<i>Surrogate: 4-Bromofluorobenzene</i>	50.7		ug/L	50.0		101	70-140			
<i>Surrogate: Dibromofluoromethane</i>	49.9		ug/L	50.0		99.9	70-140			
<i>Surrogate: Toluene-d8</i>	52.0		ug/L	50.0		104	70-140			
Duplicate (B1C0916-DUP1)				Source: 1C08018-02 Prepared & Analyzed: 03/09/21						

Viorel Vasile
 Operations Manager

**LABORATORY ANALYSIS RESULTS**

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333947
Date Received: 03/08/21
Date Reported: 03/16/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1C0916 - *** DEFAULT PREP ***</i>										
Duplicate (B1C0916-DUP1) Continued Source: 1C08018-02 Prepared & Analyzed: 03/09/21										
Benzene	<0.50	0.50	ug/L						30	
Ethylbenzene	<0.50	0.50	ug/L						30	
Methyl-tert-Butyl Ether (MTBE)	<2.0	2.0	ug/L						30	
Toluene	<0.50	0.50	ug/L						30	
o-Xylene	<0.50	0.50	ug/L						30	
m,p-Xylenes	<1.0	1.0	ug/L						30	
<i>Surrogate: 4-Bromofluorobenzene</i>	<i>52.1</i>		<i>ug/L</i>	<i>50.0</i>		<i>104</i>	<i>70-140</i>			
<i>Surrogate: Dibromofluoromethane</i>	<i>56.0</i>		<i>ug/L</i>	<i>50.0</i>		<i>112</i>	<i>70-140</i>			
<i>Surrogate: Toluene-d8</i>	<i>51.6</i>		<i>ug/L</i>	<i>50.0</i>		<i>103</i>	<i>70-140</i>			
Gasoline Range Organics in Vapor by GC/FID - Quality Control										
<i>Batch B1C0918 - *** DEFAULT PREP ***</i>										
Blank (B1C0918-BLK1) Prepared & Analyzed: 03/09/21										
Gasoline Range Organics (GRO)	<20	20	ug/L							
<i>Surrogate: a,a,a-Trifluorotoluene</i>	<i>43.1</i>		<i>ug/L</i>	<i>50.0</i>		<i>86.2</i>	<i>70-130</i>			
LCS (B1C0918-BS1) Prepared & Analyzed: 03/09/21										
Gasoline Range Organics (GRO)	498	20	ug/L	500		99.7	75-125			
<i>Surrogate: a,a,a-Trifluorotoluene</i>	<i>53.6</i>		<i>ug/L</i>	<i>50.0</i>		<i>107</i>	<i>70-130</i>			
LCS Dup (B1C0918-BSD1) Prepared & Analyzed: 03/09/21										
Gasoline Range Organics (GRO)	498	20	ug/L	500		99.5	75-125	0.112	30	
<i>Surrogate: a,a,a-Trifluorotoluene</i>	<i>52.9</i>		<i>ug/L</i>	<i>50.0</i>		<i>106</i>	<i>70-130</i>			
Duplicate (B1C0918-DUP1) Source: 1C08016-01 Prepared & Analyzed: 03/09/21										
Gasoline Range Organics (GRO)	26.8	20	ug/L		27.9			3.99	30	
<i>Surrogate: a,a,a-Trifluorotoluene</i>	<i>41.8</i>		<i>ug/L</i>	<i>50.0</i>		<i>83.6</i>	<i>70-130</i>			
VOCs in Vapor as Hexane - Quality Control										
<i>Batch B1C0918 - *** DEFAULT PREP ***</i>										
Blank (B1C0918-BLK1) Prepared & Analyzed: 03/09/21										
Total VOCs as Hexane	<4.9	4.9	ppmv							
Duplicate (B1C0918-DUP1) Source: 1C08016-01 Prepared & Analyzed: 03/09/21										

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333947
Date Received: 03/08/21
Date Reported: 03/16/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs in Vapor as Hexane - Quality Control										
<i>Batch B1C0918 - *** DEFAULT PREP ***</i>										
Duplicate (B1C0918-DUP1) Continued Source: 1C08016-01 Prepared & Analyzed: 03/09/21										
Total VOCs as Hexane	4.90	4.9	ppmv		5.10			4.00	30	

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333947
Date Received: 03/08/21
Date Reported: 03/16/21

Special Notes

A handwritten signature in black ink, appearing to be 'VA' or similar, written over a horizontal line.

Viorel Vasile
Operations Manager



AMERICAN ANALYTICS CHAIN-OF-CUSTODY RECORD

9765 ETON AVE., CHATSWORTH, CA 91311

Tel: 818-998-5547 FAX: 818-998-7258

22203

Page 1 of 1

Client: The Source Group, Inc. Project Name / No.: DFSP - Norwalk / 091-NDLA Sampler's Name: Glenn Androska
 Project Manager: Neil Irish Site Address: 15306 Norwalk Blvd Sampler's Signature: Glenn Androska
 Phone: 562-597-1055 City: Norwalk P.O. No.: _____
 Fax: 569-597-1070 State & Zip: CA 90650 Quote No.: _____

TAT Turnaround Codes **

- (1) = Same Day Rush
- (2) = 24 Hour Rush
- (3) = 48 Hour Rush
- (4) = 72 Hour Rush
- (5) = 5 Day Rush
- X = 10 Working Days (Standard TAT)

ANALYSIS REQUESTED (Test Name)

Total VOCs Gas 8015	
Total VOCs Hexane 8015	
BTEX/MTBE 8260B	
Special Instructions	

Please enter the TAT Turnaround Codes ** below

Client I.D.	Date	Time	Sample Matrix	No. of Conts	Total VOCs Gas 8015	Total VOCs Hexane 8015	BTEX/MTBE 8260B	Special Instructions	Relinquished by	Date	Time	Received by
VES After GAC-1	3-8-21	0917	Air	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		Glenn Androska	3-8-21	1115	[Signature]
VES After GAC-2	"	0916	Air	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		Glenn Androska	3-8-21	1658	[Signature]
PRIORITIZED												
A5333947/1008015												
												Received by
												Received by
												Received by

Note: By relinquishing samples to American Analytics, client agrees to pay for the services requested on this chain of custody form and any additional client-requested analyses performed on this project. Payment for services is due within 30 days from the date of invoice. Sample(s) will be disposed of after 45 days following the submittal of the sample(s) to American Analytics.



9765 Eton Avenue
Chatsworth
California 91311
Tel: (818) 998-5547
Fax: (818) 998-7258

March 16, 2021

Neil Irish

The Source Group, Inc. (SH)
1962 Freeman Ave.
Signal Hill, CA 90755

**Re : DFSP Norwalk VES AQMD / 04-NDLA-013
A5333948 / 1C08016**

Enclosed is an analytical report for the above-referenced project. The samples included in this report were received on 03/08/21 16:58 and analyzed in accordance with the attached chain-of-custody.

Unless otherwise noted, all analytical testing was accomplished in accordance with the guidelines established in our Quality Assurance Program Manual, applicable standard operating procedures, and other related documentation. The results in this analytical report are limited to the samples tested and any reproduction thereof must be made in its entirety.

If you have any questions regarding this report or require additional information please call me at American Analytix.

Sincerely,

A handwritten signature in black ink, appearing to be 'V. Vasile'.

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333948
Date Received: 03/08/21
Date Reported: 03/16/21

Sample ID	Laboratory ID	Matrix	TAT	Date Sampled	Date Received
-----------	---------------	--------	-----	--------------	---------------

VOCs BTEX/MTBE Vapor GC/MS

VES Carbon-Influent	1C08016-01	Vapor	5	03/08/21 09:18	03/08/21 16:58
VES Carbon-Effluent	1C08016-02	Vapor	5	03/08/21 09:10	03/08/21 16:58

VOCs Gasoline Range Organics Vapor

VES Carbon-Influent	1C08016-01	Vapor	5	03/08/21 09:18	03/08/21 16:58
VES Carbon-Effluent	1C08016-02	Vapor	5	03/08/21 09:10	03/08/21 16:58

VOCs in Vapor as Hexane

VES Carbon-Influent	1C08016-01	Vapor	5	03/08/21 09:18	03/08/21 16:58
VES Carbon-Effluent	1C08016-02	Vapor	5	03/08/21 09:10	03/08/21 16:58

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333948
Date Received: 03/08/21
Date Reported: 03/16/21
Sampled: 03/08/21
Prepared: 03/09/21
Analyzed: 03/09/21

VES Carbon-Influent
1C08016-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.50	ug/L	0.50	<0.16	ppmv	0.16
Ethylbenzene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	<0.50	ug/L	0.50	<0.13	ppmv	0.13
o-Xylene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
m,p-Xylenes	<1.0	ug/L	1.0	<0.23	ppmv	0.23

<u>Surrogates</u>	<u>%REC</u>	<u>%REC Limits</u>
4-Bromofluorobenzene	103 %	70-140
Dibromofluoromethane	112 %	70-140
Toluene-d8	103 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 0.5
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333948
Date Received: 03/08/21
Date Reported: 03/16/21
Sampled: 03/08/21
Prepared: 03/09/21
Analyzed: 03/09/21

VES Carbon-Effluent
1C08016-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.25	ug/L	0.50	<0.078	ppmv	0.16
Ethylbenzene	<0.25	ug/L	0.50	<0.058	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<1.0	ug/L	2.0	<0.28	ppmv	0.55
Toluene	<0.25	ug/L	0.50	<0.066	ppmv	0.13
o-Xylene	<0.25	ug/L	0.50	<0.058	ppmv	0.12
m,p-Xylenes	<0.50	ug/L	1.0	<0.12	ppmv	0.23

<u>Surrogates</u>	<u>%REC</u>	<u>%REC Limits</u>
4-Bromofluorobenzene	104 %	70-140
Dibromofluoromethane	115 %	70-140
Toluene-d8	103 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333948
Date Received: 03/08/21
Date Reported: 03/16/21
Sampled: 03/08/21
Prepared: 03/09/21
Analyzed: 03/09/21

VES Carbon-Influent

1C08016-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	28	ug/L	20	6.8	ppmv	4.9
<u>Surrogates</u>		<u>%REC</u>				<u>%REC Limits</u>
a,a,a-Trifluorotoluene		75.9 %				70-130

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333948
Date Received: 03/08/21
Date Reported: 03/16/21
Sampled: 03/08/21
Prepared: 03/09/21
Analyzed: 03/09/21

VES Carbon-Effluent
1C08016-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	<20	ug/L	20	<4.9	ppmv	4.9
Surrogates		%REC			%REC Limits	
a,a,a-Trifluorotoluene		87.9 %			70-130	

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Method: VOCs in Vapor as Hexane

AA Project No: A5333948
Date Received: 03/08/21
Date Reported: 03/16/21
Units: ppmv

Date Sampled:	03/08/21	03/08/21	
Date Prepared:	03/09/21	03/09/21	
Date Analyzed:	03/09/21	03/09/21	
AA ID No:	1C08016-01	1C08016-02	
Client ID No:	VES	VES	
	Carbon-Influent	Carbon-Effluent	
Matrix:	Vapor	Vapor	
Dilution Factor:	1	1	MRL

VOCs in Vapor as Hexane (EPA 8015M)

Total VOCs as Hexane	5.1	<4.9	4.9
----------------------	------------	------	-----

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333948
Date Received: 03/08/21
Date Reported: 03/16/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC %REC	Limit	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1C0916 - *** DEFAULT PREP ***</i>										
Blank (B1C0916-BLK1)				Prepared & Analyzed: 03/09/21						
Benzene	<0.25	0.25	ug/L							
Ethylbenzene	<0.25	0.25	ug/L							
Methyl-tert-Butyl Ether (MTBE)	<1.0	1.0	ug/L							
Toluene	<0.25	0.25	ug/L							
o-Xylene	<0.25	0.25	ug/L							
m,p-Xylenes	<0.50	0.50	ug/L							
<i>Surrogate: 4-Bromofluorobenzene</i>	52.1		ug/L	50.0		104	70-140			
<i>Surrogate: Dibromofluoromethane</i>	56.5		ug/L	50.0		113	70-140			
<i>Surrogate: Toluene-d8</i>	51.9		ug/L	50.0		104	70-140			
LCS (B1C0916-BS1)				Prepared & Analyzed: 03/09/21						
Benzene	22.1	0.50	ug/L	20.0		110	75-125			
Ethylbenzene	22.0	0.50	ug/L	20.0		110	75-125			
Methyl-tert-Butyl Ether (MTBE)	41.8	2.0	ug/L	40.0		104	75-125			
Toluene	20.7	0.50	ug/L	20.0		104	75-125			
o-Xylene	20.6	0.50	ug/L	20.0		103	75-125			
m,p-Xylenes	41.3	1.0	ug/L	40.0		103	75-125			
<i>Surrogate: 4-Bromofluorobenzene</i>	52.4		ug/L	50.0		105	70-140			
<i>Surrogate: Dibromofluoromethane</i>	51.2		ug/L	50.0		102	70-140			
<i>Surrogate: Toluene-d8</i>	52.3		ug/L	50.0		105	70-140			
LCS Dup (B1C0916-BSD1)				Prepared & Analyzed: 03/09/21						
Benzene	20.9	0.50	ug/L	20.0		105	75-125	5.30	30	
Ethylbenzene	21.8	0.50	ug/L	20.0		109	75-125	0.548	30	
Methyl-tert-Butyl Ether (MTBE)	43.0	2.0	ug/L	40.0		107	75-125	2.88	30	
Toluene	20.9	0.50	ug/L	20.0		105	75-125	1.15	30	
o-Xylene	20.8	0.50	ug/L	20.0		104	75-125	1.25	30	
m,p-Xylenes	42.0	1.0	ug/L	40.0		105	75-125	1.78	30	
<i>Surrogate: 4-Bromofluorobenzene</i>	50.7		ug/L	50.0		101	70-140			
<i>Surrogate: Dibromofluoromethane</i>	49.9		ug/L	50.0		99.9	70-140			
<i>Surrogate: Toluene-d8</i>	52.0		ug/L	50.0		104	70-140			
Duplicate (B1C0916-DUP1)				Source: 1C08018-02 Prepared & Analyzed: 03/09/21						

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333948
Date Received: 03/08/21
Date Reported: 03/16/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1C0916 - *** DEFAULT PREP ***</i>										
Duplicate (B1C0916-DUP1) Continued Source: 1C08018-02 Prepared & Analyzed: 03/09/21										
Benzene	<0.50	0.50	ug/L						30	
Ethylbenzene	<0.50	0.50	ug/L						30	
Methyl-tert-Butyl Ether (MTBE)	<2.0	2.0	ug/L						30	
Toluene	<0.50	0.50	ug/L						30	
o-Xylene	<0.50	0.50	ug/L						30	
m,p-Xylenes	<1.0	1.0	ug/L						30	
<i>Surrogate: 4-Bromofluorobenzene</i>	<i>52.1</i>		<i>ug/L</i>	<i>50.0</i>		<i>104</i>	<i>70-140</i>			
<i>Surrogate: Dibromofluoromethane</i>	<i>56.0</i>		<i>ug/L</i>	<i>50.0</i>		<i>112</i>	<i>70-140</i>			
<i>Surrogate: Toluene-d8</i>	<i>51.6</i>		<i>ug/L</i>	<i>50.0</i>		<i>103</i>	<i>70-140</i>			
Gasoline Range Organics in Vapor by GC/FID - Quality Control										
<i>Batch B1C0918 - *** DEFAULT PREP ***</i>										
Blank (B1C0918-BLK1) Prepared & Analyzed: 03/09/21										
Gasoline Range Organics (GRO)	<20	20	ug/L							
<i>Surrogate: a,a,a-Trifluorotoluene</i>	<i>43.1</i>		<i>ug/L</i>	<i>50.0</i>		<i>86.2</i>	<i>70-130</i>			
LCS (B1C0918-BS1) Prepared & Analyzed: 03/09/21										
Gasoline Range Organics (GRO)	498	20	ug/L	500		99.7	75-125			
<i>Surrogate: a,a,a-Trifluorotoluene</i>	<i>53.6</i>		<i>ug/L</i>	<i>50.0</i>		<i>107</i>	<i>70-130</i>			
LCS Dup (B1C0918-BSD1) Prepared & Analyzed: 03/09/21										
Gasoline Range Organics (GRO)	498	20	ug/L	500		99.5	75-125	0.112	30	
<i>Surrogate: a,a,a-Trifluorotoluene</i>	<i>52.9</i>		<i>ug/L</i>	<i>50.0</i>		<i>106</i>	<i>70-130</i>			
Duplicate (B1C0918-DUP1) Source: 1C08016-01 Prepared & Analyzed: 03/09/21										
Gasoline Range Organics (GRO)	26.8	20	ug/L		27.9			3.99	30	
<i>Surrogate: a,a,a-Trifluorotoluene</i>	<i>41.8</i>		<i>ug/L</i>	<i>50.0</i>		<i>83.6</i>	<i>70-130</i>			
VOCs in Vapor as Hexane - Quality Control										
<i>Batch B1C0918 - *** DEFAULT PREP ***</i>										
Blank (B1C0918-BLK1) Prepared & Analyzed: 03/09/21										
Total VOCs as Hexane	<4.9	4.9	ppmv							
Duplicate (B1C0918-DUP1) Source: 1C08016-01 Prepared & Analyzed: 03/09/21										

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333948
Date Received: 03/08/21
Date Reported: 03/16/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs in Vapor as Hexane - Quality Control										
<i>Batch B1C0918 - *** DEFAULT PREP ***</i>										
Duplicate (B1C0918-DUP1) Continued Source: 1C08016-01 Prepared & Analyzed: 03/09/21										
Total VOCs as Hexane	4.90	4.9	ppmv		5.10			4.00	30	

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333948
Date Received: 03/08/21
Date Reported: 03/16/21

Special Notes

A handwritten signature in black ink, appearing to be 'VA' or similar, located below the 'Special Notes' section.

Viorel Vasile
Operations Manager



9765 Eton Avenue
Chatsworth
California 91311
Tel: (818) 998-5547
Fax: (818) 998-7258

February 08, 2021

Neil Irish

The Source Group, Inc. (SH)
1962 Freeman Ave.
Signal Hill, CA 90755

**Re : DFSP Norwalk VES AQMD / 04-NDLA-013
A5333920 / 1A28006**

Enclosed is an analytical report for the above-referenced project. The samples included in this report were received on 01/28/21 14:27 and analyzed in accordance with the attached chain-of-custody.

Unless otherwise noted, all analytical testing was accomplished in accordance with the guidelines established in our Quality Assurance Program Manual, applicable standard operating procedures, and other related documentation. The results in this analytical report are limited to the samples tested and any reproduction thereof must be made in its entirety.

If you have any questions regarding this report or require additional information please call me at American Analytix.

Sincerely,

A handwritten signature in black ink, appearing to read 'V. Vasile', is written over a light blue horizontal line.

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333920
Date Received: 01/28/21
Date Reported: 02/08/21

Sample ID	Laboratory ID	Matrix	TAT	Date Sampled	Date Received
-----------	---------------	--------	-----	--------------	---------------

VOCs BTEX/MTBE Vapor GC/MS

VES Thermox-Influent	1A28006-01	Vapor	5	01/28/21 11:20	01/28/21 14:27
VES Thermox-Effluent	1A28006-02	Vapor	5	01/28/21 11:15	01/28/21 14:27

VOCs Gasoline Range Organics Vapor

VES Thermox-Influent	1A28006-01	Vapor	5	01/28/21 11:20	01/28/21 14:27
VES Thermox-Effluent	1A28006-02	Vapor	5	01/28/21 11:15	01/28/21 14:27

VOCs in Vapor as Hexane

VES Thermox-Influent	1A28006-01	Vapor	5	01/28/21 11:20	01/28/21 14:27
VES Thermox-Effluent	1A28006-02	Vapor	5	01/28/21 11:15	01/28/21 14:27

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333920
Date Received: 01/28/21
Date Reported: 02/08/21
Sampled: 01/28/21
Prepared: 01/29/21
Analyzed: 01/29/21

VES Thermax-Influent
1A28006-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	5.8	ug/L	0.50	1.8	ppmv	0.16
Ethylbenzene	1.8	ug/L	0.50	0.41	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	1.5	ug/L	0.50	0.40	ppmv	0.13
o-Xylene	1.4	ug/L	0.50	0.32	ppmv	0.12
m,p-Xylenes	4.3	ug/L	1.0	0.99	ppmv	0.23

Surrogates	%REC	%REC Limits
4-Bromofluorobenzene	92.7 %	70-140
Dibromofluoromethane	84.7 %	70-140
Toluene-d8	91.0 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 0.5
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333920
Date Received: 01/28/21
Date Reported: 02/08/21
Sampled: 01/28/21
Prepared: 01/29/21
Analyzed: 01/29/21

VES Thermax-Effluent
1A28006-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.25	ug/L	0.50	<0.078	ppmv	0.16
Ethylbenzene	<0.25	ug/L	0.50	<0.058	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<1.0	ug/L	2.0	<0.28	ppmv	0.55
Toluene	<0.25	ug/L	0.50	<0.066	ppmv	0.13
o-Xylene	<0.25	ug/L	0.50	<0.058	ppmv	0.12
m,p-Xylenes	<0.50	ug/L	1.0	<0.12	ppmv	0.23

<u>Surrogates</u>	<u>%REC</u>	<u>%REC Limits</u>
4-Bromofluorobenzene	99.3 %	70-140
Dibromofluoromethane	81.1 %	70-140
Toluene-d8	96.5 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 5
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333920
Date Received: 01/28/21
Date Reported: 02/08/21
Sampled: 01/28/21
Prepared: 01/29/21
Analyzed: 01/29/21

VES Thermax-Influent
1A28006-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	5600	ug/L	20	1400	ppmv	4.9
Surrogates		%REC			%REC Limits	
a,a,a-Trifluorotoluene		101 %			70-130	

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333920
Date Received: 01/28/21
Date Reported: 02/08/21
Sampled: 01/28/21
Prepared: 01/29/21
Analyzed: 01/29/21

VES Thermax-Effluent
1A28006-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	<20	ug/L	20	<4.9	ppmv	4.9
<u>Surrogates</u>		<u>%REC</u>			<u>%REC Limits</u>	
a,a,a-Trifluorotoluene		88.6 %			70-130	

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Method: VOCs in Vapor as Hexane

AA Project No: A5333920
Date Received: 01/28/21
Date Reported: 02/08/21
Units: ppmv

Date Sampled:	01/28/21	01/28/21	
Date Prepared:	01/29/21	01/29/21	
Date Analyzed:	01/29/21	01/29/21	
AA ID No:	1A28006-01	1A28006-02	
Client ID No:	VES	VES	
	Thermox-Influent	Thermox-Effluent	
Matrix:	Vapor	Vapor	
Dilution Factor:	5	1	MRL

VOCs in Vapor as Hexane (EPA 8015M)

Total VOCs as Hexane	1000	<4.9	4.9
----------------------	-------------	------	-----

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333920
Date Received: 01/28/21
Date Reported: 02/08/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC %REC	Limit	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1A2910 - *** DEFAULT PREP ***</i>										
Blank (B1A2910-BLK1) Prepared & Analyzed: 01/29/21										
Benzene	<0.25	0.25	ug/L							
Ethylbenzene	<0.25	0.25	ug/L							
Methyl-tert-Butyl Ether (MTBE)	<1.0	1.0	ug/L							
Toluene	<0.25	0.25	ug/L							
o-Xylene	<0.25	0.25	ug/L							
m,p-Xylenes	<0.50	0.50	ug/L							
<i>Surrogate: 4-Bromofluorobenzene</i>	43.1		ug/L	50.0		86.1	70-140			
<i>Surrogate: Dibromofluoromethane</i>	36.4		ug/L	50.0		72.8	70-140			
<i>Surrogate: Toluene-d8</i>	44.2		ug/L	50.0		88.4	70-140			
LCS (B1A2910-BS1) Prepared & Analyzed: 01/29/21										
Benzene	18.7	0.50	ug/L	20.0		93.4	75-125			
Ethylbenzene	20.0	0.50	ug/L	20.0		100	75-125			
Methyl-tert-Butyl Ether (MTBE)	37.7	2.0	ug/L	40.0		94.3	75-125			
Toluene	20.2	0.50	ug/L	20.0		101	75-125			
o-Xylene	20.4	0.50	ug/L	20.0		102	75-125			
m,p-Xylenes	40.9	1.0	ug/L	40.0		102	75-125			
<i>Surrogate: 4-Bromofluorobenzene</i>	48.9		ug/L	50.0		97.7	70-140			
<i>Surrogate: Dibromofluoromethane</i>	43.3		ug/L	50.0		86.5	70-140			
<i>Surrogate: Toluene-d8</i>	47.9		ug/L	50.0		95.8	70-140			
LCS Dup (B1A2910-BSD1) Prepared & Analyzed: 01/29/21										
Benzene	18.7	0.50	ug/L	20.0		93.4	75-125	0.0535	30	
Ethylbenzene	20.8	0.50	ug/L	20.0		104	75-125	3.77	30	
Methyl-tert-Butyl Ether (MTBE)	37.0	2.0	ug/L	40.0		92.5	75-125	1.87	30	
Toluene	21.2	0.50	ug/L	20.0		106	75-125	4.44	30	
o-Xylene	20.8	0.50	ug/L	20.0		104	75-125	1.94	30	
m,p-Xylenes	39.3	1.0	ug/L	40.0		98.3	75-125	3.84	30	
<i>Surrogate: 4-Bromofluorobenzene</i>	49.3		ug/L	50.0		98.6	70-140			
<i>Surrogate: Dibromofluoromethane</i>	42.1		ug/L	50.0		84.3	70-140			
<i>Surrogate: Toluene-d8</i>	49.1		ug/L	50.0		98.3	70-140			
Duplicate (B1A2910-DUP1) Source: 1A28006-01 Prepared & Analyzed: 01/29/21										

Viorel Vasile
Operations Manager

**LABORATORY ANALYSIS RESULTS**

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333920
Date Received: 01/28/21
Date Reported: 02/08/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1A2910 - *** DEFAULT PREP ***</i>										
Duplicate (B1A2910-DUP1) Continued Source: 1A28006-01 Prepared & Analyzed: 01/29/21										
Benzene	5.66	0.50	ug/L		5.84			3.13	30	
Ethylbenzene	1.96	0.50	ug/L		1.81			7.96	30	
Methyl-tert-Butyl Ether (MTBE)	<2.0	2.0	ug/L		<2.0				30	
Toluene	1.53	0.50	ug/L		1.51			1.32	30	
o-Xylene	1.41	0.50	ug/L		1.36			3.61	30	
m,p-Xylenes	4.41	1.0	ug/L		4.28			2.99	30	
<i>Surrogate: 4-Bromofluorobenzene</i>	46.6		ug/L	50.0		93.2	70-140			
<i>Surrogate: Dibromofluoromethane</i>	39.6		ug/L	50.0		79.3	70-140			
<i>Surrogate: Toluene-d8</i>	47.1		ug/L	50.0		94.2	70-140			
Gasoline Range Organics in Vapor by GC/FID - Quality Control										
<i>Batch B1A2902 - *** DEFAULT PREP ***</i>										
Blank (B1A2902-BLK1) Prepared & Analyzed: 01/29/21										
Gasoline Range Organics (GRO)	<20	20	ug/L							
<i>Surrogate: a,a,a-Trifluorotoluene</i>	40.4		ug/L	50.0		80.8	70-130			
LCS (B1A2902-BS1) Prepared & Analyzed: 01/29/21										
Gasoline Range Organics (GRO)	480	20	ug/L	500		95.9	75-125			
<i>Surrogate: a,a,a-Trifluorotoluene</i>	49.6		ug/L	50.0		99.3	70-130			
LCS Dup (B1A2902-BSD1) Prepared & Analyzed: 01/29/21										
Gasoline Range Organics (GRO)	493	20	ug/L	500		98.6	75-125	2.73	30	
<i>Surrogate: a,a,a-Trifluorotoluene</i>	53.3		ug/L	50.0		107	70-130			
Duplicate (B1A2902-DUP1) Source: 1A28010-02 Prepared & Analyzed: 01/29/21										
Gasoline Range Organics (GRO)	32.1	20	ug/L		44.0			31.4	30	
<i>Surrogate: a,a,a-Trifluorotoluene</i>	45.1		ug/L	50.0		90.2	70-130			
VOCs in Vapor as Hexane - Quality Control										
<i>Batch B1A2902 - *** DEFAULT PREP ***</i>										
Blank (B1A2902-BLK1) Prepared & Analyzed: 01/29/21										
Total VOCs as Hexane	<4.9	4.9	ppmv							
Duplicate (B1A2902-DUP1) Source: 1A28010-02 Prepared & Analyzed: 01/29/21										

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333920
Date Received: 01/28/21
Date Reported: 02/08/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs in Vapor as Hexane - Quality Control										
<i>Batch B1A2902 - *** DEFAULT PREP ***</i>										
Duplicate (B1A2902-DUP1) Continued Source: 1A28010-02 Prepared & Analyzed: 01/29/21										
Total VOCs as Hexane	5.86	4.9	ppmv		7.96			30.3	30	

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333920
Date Received: 01/28/21
Date Reported: 02/08/21

Special Notes

A handwritten signature in black ink, appearing to be 'AV' or similar initials.

Viorel Vasile
Operations Manager



9765 Eton Avenue
Chatsworth
California 91311
Tel: (818) 998-5547
Fax: (818) 998-7258

March 03, 2021

Neil Irish

The Source Group, Inc. (SH)
1962 Freeman Ave.
Signal Hill, CA 90755

**Re : DFSP Norwalk VES AQMD / 04-NDLA-013
A5333940 / 1B24009**

Enclosed is an analytical report for the above-referenced project. The samples included in this report were received on 02/24/21 17:38 and analyzed in accordance with the attached chain-of-custody.

Unless otherwise noted, all analytical testing was accomplished in accordance with the guidelines established in our Quality Assurance Program Manual, applicable standard operating procedures, and other related documentation. The results in this analytical report are limited to the samples tested and any reproduction thereof must be made in its entirety.

If you have any questions regarding this report or require additional information please call me at American Analytix.

Sincerely,

A handwritten signature in black ink, appearing to read 'V. Vasile'.

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333940
Date Received: 02/24/21
Date Reported: 03/03/21

Sample ID	Laboratory ID	Matrix	TAT	Date Sampled	Date Received
-----------	---------------	--------	-----	--------------	---------------

VOCs BTEX/MTBE Vapor GC/MS

VES Thermox-Influent	1B24009-01	Vapor	5	02/24/21 08:08	02/24/21 17:38
VES Thermox-Effluent	1B24009-02	Vapor	5	02/24/21 08:00	02/24/21 17:38

VOCs Gasoline Range Organics Vapor

VES Thermox-Influent	1B24009-01	Vapor	5	02/24/21 08:08	02/24/21 17:38
VES Thermox-Effluent	1B24009-02	Vapor	5	02/24/21 08:00	02/24/21 17:38

VOCs in Vapor as Hexane

VES Thermox-Influent	1B24009-01	Vapor	5	02/24/21 08:08	02/24/21 17:38
VES Thermox-Effluent	1B24009-02	Vapor	5	02/24/21 08:00	02/24/21 17:38

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333940
Date Received: 02/24/21
Date Reported: 03/03/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

VES Thermax-Influent
1B24009-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	4.6	ug/L	0.50	1.4	ppmv	0.16
Ethylbenzene	1.8	ug/L	0.50	0.41	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	1.6	ug/L	0.50	0.42	ppmv	0.13
o-Xylene	1.1	ug/L	0.50	0.25	ppmv	0.12
m,p-Xylenes	4.0	ug/L	1.0	0.92	ppmv	0.23

Surrogates	%REC	%REC Limits
4-Bromofluorobenzene	92.0 %	70-140
Dibromofluoromethane	84.7 %	70-140
Toluene-d8	87.1 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 0.5
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333940
Date Received: 02/24/21
Date Reported: 03/03/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

VES Thermax-Effluent
1B24009-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.25	ug/L	0.50	<0.078	ppmv	0.16
Ethylbenzene	<0.25	ug/L	0.50	<0.058	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<1.0	ug/L	2.0	<0.28	ppmv	0.55
Toluene	<0.25	ug/L	0.50	<0.066	ppmv	0.13
o-Xylene	<0.25	ug/L	0.50	<0.058	ppmv	0.12
m,p-Xylenes	<0.50	ug/L	1.0	<0.12	ppmv	0.23

<u>Surrogates</u>	<u>%REC</u>	<u>%REC Limits</u>
4-Bromofluorobenzene	99.3 %	70-140
Dibromofluoromethane	86.3 %	70-140
Toluene-d8	87.4 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 2
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333940
Date Received: 02/24/21
Date Reported: 03/03/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

VES Thermax-Influent

1B24009-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	4000	ug/L	20	980	ppmv	4.9
<u>Surrogates</u>		<u>%REC</u>				<u>%REC Limits</u>
a,a,a-Trifluorotoluene		96.6 %				70-130

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333940
Date Received: 02/24/21
Date Reported: 03/03/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

VES Thermax-Effluent
1B24009-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	20	ug/L	20	4.9	ppmv	4.9
Surrogates		%REC				%REC Limits
a,a,a-Trifluorotoluene		79.6 %				70-130

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Method: VOCs in Vapor as Hexane

AA Project No: A5333940
Date Received: 02/24/21
Date Reported: 03/03/21
Units: ppmv

Date Sampled:	02/24/21	02/24/21	
Date Prepared:	02/25/21	02/25/21	
Date Analyzed:	02/25/21	02/25/21	
AA ID No:	1B24009-01	1B24009-02	
Client ID No:	VES	VES	
	Thermox-Influent	Thermox-Effluent	
Matrix:	Vapor	Vapor	
Dilution Factor:	2	1	MRL

VOCs in Vapor as Hexane (EPA 8015M)

Total VOCs as Hexane	740	<4.9	4.9
----------------------	------------	------	-----

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333940
Date Received: 02/24/21
Date Reported: 03/03/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC %REC	Limit	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1B2512 - *** DEFAULT PREP ***</i>										
Blank (B1B2512-BLK1)				Prepared & Analyzed: 02/25/21						
Benzene	<0.25	0.25	ug/L							
Ethylbenzene	<0.25	0.25	ug/L							
Methyl-tert-Butyl Ether (MTBE)	<1.0	1.0	ug/L							
Toluene	<0.25	0.25	ug/L							
o-Xylene	<0.25	0.25	ug/L							
m,p-Xylenes	<0.50	0.50	ug/L							
<i>Surrogate: 4-Bromofluorobenzene</i>	49.8		ug/L	50.0		99.6	70-140			
<i>Surrogate: Dibromofluoromethane</i>	43.3		ug/L	50.0		86.5	70-140			
<i>Surrogate: Toluene-d8</i>	43.1		ug/L	50.0		86.2	70-140			
LCS (B1B2512-BS1)				Prepared & Analyzed: 02/25/21						
Benzene	17.4	0.50	ug/L	20.0		86.8	75-125			
Ethylbenzene	20.0	0.50	ug/L	20.0		99.8	75-125			
Methyl-tert-Butyl Ether (MTBE)	32.6	2.0	ug/L	40.0		81.5	75-125			
Toluene	19.5	0.50	ug/L	20.0		97.6	75-125			
o-Xylene	19.6	0.50	ug/L	20.0		97.8	75-125			
m,p-Xylenes	40.7	1.0	ug/L	40.0		102	75-125			
<i>Surrogate: 4-Bromofluorobenzene</i>	49.4		ug/L	50.0		98.7	70-140			
<i>Surrogate: Dibromofluoromethane</i>	39.2		ug/L	50.0		78.4	70-140			
<i>Surrogate: Toluene-d8</i>	43.8		ug/L	50.0		87.7	70-140			
LCS Dup (B1B2512-BSD1)				Prepared & Analyzed: 02/25/21						
Benzene	17.4	0.50	ug/L	20.0		87.2	75-125	0.345	30	
Ethylbenzene	20.0	0.50	ug/L	20.0		100	75-125	0.250	30	
Methyl-tert-Butyl Ether (MTBE)	32.3	2.0	ug/L	40.0		80.8	75-125	0.955	30	
Toluene	19.6	0.50	ug/L	20.0		98.0	75-125	0.307	30	
o-Xylene	19.4	0.50	ug/L	20.0		97.0	75-125	0.821	30	
m,p-Xylenes	40.9	1.0	ug/L	40.0		102	75-125	0.589	30	
<i>Surrogate: 4-Bromofluorobenzene</i>	48.8		ug/L	50.0		97.6	70-140			
<i>Surrogate: Dibromofluoromethane</i>	38.6		ug/L	50.0		77.2	70-140			
<i>Surrogate: Toluene-d8</i>	44.1		ug/L	50.0		88.2	70-140			
Duplicate (B1B2512-DUP1)				Source: 1B24011-04 Prepared & Analyzed: 02/25/21						

Viorel Vasile
Operations Manager

**LABORATORY ANALYSIS RESULTS**

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333940
Date Received: 02/24/21
Date Reported: 03/03/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1B2512 - *** DEFAULT PREP ***</i>										
Duplicate (B1B2512-DUP1) Continued Source: 1B24011-04 Prepared & Analyzed: 02/25/21										
Benzene	<0.50	0.50	ug/L		0.210				30	
Ethylbenzene	<0.50	0.50	ug/L						30	
Methyl-tert-Butyl Ether (MTBE)	<2.0	2.0	ug/L						30	
Toluene	<0.50	0.50	ug/L						30	
o-Xylene	<0.50	0.50	ug/L						30	
m,p-Xylenes	<1.0	1.0	ug/L		0.830			8.81	30	
<i>Surrogate: 4-Bromofluorobenzene</i>	46.8		ug/L	50.0		93.6	70-140			
<i>Surrogate: Dibromofluoromethane</i>	43.0		ug/L	50.0		86.1	70-140			
<i>Surrogate: Toluene-d8</i>	44.6		ug/L	50.0		89.3	70-140			
Gasoline Range Organics in Vapor by GC/FID - Quality Control										
<i>Batch B1B2511 - *** DEFAULT PREP ***</i>										
Blank (B1B2511-BLK1) Prepared & Analyzed: 02/25/21										
Gasoline Range Organics (GRO)	<20	20	ug/L							
<i>Surrogate: a,a,a-Trifluorotoluene</i>	36.2		ug/L	50.0		72.5	70-130			
LCS (B1B2511-BS1) Prepared & Analyzed: 02/25/21										
Gasoline Range Organics (GRO)	488	20	ug/L	500		97.5	75-125			
<i>Surrogate: a,a,a-Trifluorotoluene</i>	51.6		ug/L	50.0		103	70-130			
LCS Dup (B1B2511-BSD1) Prepared & Analyzed: 02/25/21										
Gasoline Range Organics (GRO)	481	20	ug/L	500		96.2	75-125	1.32	30	
<i>Surrogate: a,a,a-Trifluorotoluene</i>	51.7		ug/L	50.0		103	70-130			
Duplicate (B1B2511-DUP1) Source: 1B24009-01 Prepared & Analyzed: 02/25/21										
Gasoline Range Organics (GRO)	4790	40	ug/L		4040			17.0	30	
<i>Surrogate: a,a,a-Trifluorotoluene</i>	44.0		ug/L	50.0		88.0	70-130			

VOCs in Vapor as Hexane - Quality Control*Batch B1B2511 - *** DEFAULT PREP ******Blank (B1B2511-BLK1)**

Prepared & Analyzed: 02/25/21

Total VOCs as Hexane <4.9 4.9 ppmv

Duplicate (B1B2511-DUP1)

Source: 1B24009-01 Prepared & Analyzed: 02/25/21

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333940
Date Received: 02/24/21
Date Reported: 03/03/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs in Vapor as Hexane - Quality Control										
<i>Batch B1B2511 - *** DEFAULT PREP ***</i>										
Duplicate (B1B2511-DUP1) Continued Source: 1B24009-01 Prepared & Analyzed: 02/25/21										
Total VOCs as Hexane	863	9.8	ppmv		736			16.0	30	

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333940
Date Received: 02/24/21
Date Reported: 03/03/21

Special Notes

A handwritten signature in black ink, appearing to be 'VA'.

Viorel Vasile
Operations Manager



AMERICAN ANALYTICS CHAIN-OF-CUSTODY RECORD

9765 ETON AVE., CHATSWORTH, CA 91311
Tel: 818-998-5547 FAX: 818-998-7258

22132

Page 1 of 1

Client: The Source Group, Inc. **Project Name / No.:** DFSP - Norwalk / 091-NOR-001 Task 2 **Sampler's Name:** Glenn Androsko
Project Manager: Neil Irish **Site Address:** 15306 Norwalk Blvd **Sampler's Signature:** *Glenn Androsko*
Phone: 562-597-1055 **City:** Norwalk **P.O. No.:**
Fax: 569-597-1070 **State & Zip:** CA 90650 **Quote No.:**

TAT Turnaround Codes **

- ① = Same Day Rush
- ④ = 72 Hour Rush
- ② = 24 Hour Rush
- ⑤ = 5 Day Rush
- ③ = 48 Hour Rush
- X = 10 Working Days (Standard TAT)

Client I.D.	Date	Time	Sample Matrix	No. of Cont	ANALYSIS REQUESTED (Test Name)			Special Instructions
					Total VOCs Gas 8019	Total VOCs Hexane 8015	BTEX/MTBE 8260B	
VES Thermox-Influent	2-24-21	0808	Air	1	✓	✓	✓	VOC's reported as
VES Thermox-Effluent	"	0800	Air	1	✓	✓	✓	GRO (detection limit = 4.9 ppmv) and VOCs as Hexane (detection limit = 4.9 ppmv) Benzene (detection limit = 0.15 ppmv)

Relinquished by: *Glenn Androsko* Date: 2-24-21 Time: 1301 Received by: _____
Relinquished by: _____ Date: 2/24/21 Time: 1738 Received by: _____
Relinquished by: _____ Date: Time: Received by: _____

AS333940 / 1324009

Note: By relinquishing samples to American Analytics, client agrees to pay for the services requested on this chain of custody form and any additional client-requested analyses performed on this project. Payment for services is due within 30 days from the date of invoice. Sample(s) will be disposed of after 45 days following the submittal of the sample(s) to American Analytics.

AS333940 / 1324009



9765 Eton Avenue
Chatsworth
California 91311
Tel: (818) 998-5547
Fax: (818) 998-7258

March 16, 2021

Neil Irish

The Source Group, Inc. (SH)
1962 Freeman Ave.
Signal Hill, CA 90755

**Re : DFSP Norwalk VES AQMD / 04-NDLA-013
A5333946 / 1C08014**

Enclosed is an analytical report for the above-referenced project. The samples included in this report were received on 03/08/21 16:58 and analyzed in accordance with the attached chain-of-custody.

Unless otherwise noted, all analytical testing was accomplished in accordance with the guidelines established in our Quality Assurance Program Manual, applicable standard operating procedures, and other related documentation. The results in this analytical report are limited to the samples tested and any reproduction thereof must be made in its entirety.

If you have any questions regarding this report or require additional information please call me at American Analytix.

Sincerely,

A handwritten signature in black ink, appearing to read 'V. Vasile'.

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333946
Date Received: 03/08/21
Date Reported: 03/16/21

Sample ID	Laboratory ID	Matrix	TAT	Date Sampled	Date Received
-----------	---------------	--------	-----	--------------	---------------

VOCs BTEX/MTBE Vapor GC/MS

VES Thermox-Influent	1C08014-01	Vapor	5	03/08/21 09:49	03/08/21 16:58
VES Thermox-Effluent	1C08014-02	Vapor	5	03/08/21 09:42	03/08/21 16:58

VOCs Gasoline Range Organics Vapor

VES Thermox-Influent	1C08014-01	Vapor	5	03/08/21 09:49	03/08/21 16:58
VES Thermox-Effluent	1C08014-02	Vapor	5	03/08/21 09:42	03/08/21 16:58

VOCs in Vapor as Hexane

VES Thermox-Influent	1C08014-01	Vapor	5	03/08/21 09:49	03/08/21 16:58
VES Thermox-Effluent	1C08014-02	Vapor	5	03/08/21 09:42	03/08/21 16:58

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333946
Date Received: 03/08/21
Date Reported: 03/16/21
Sampled: 03/08/21
Prepared: 03/09/21
Analyzed: 03/09/21

VES Thermax-Influent
1C08014-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	5.6	ug/L	0.50	1.8	ppmv	0.16
Ethylbenzene	2.0	ug/L	0.50	0.46	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	2.2	ug/L	0.50	0.58	ppmv	0.13
o-Xylene	1.2	ug/L	0.50	0.28	ppmv	0.12
m,p-Xylenes	4.1	ug/L	1.0	0.94	ppmv	0.23

Surrogates	%REC	%REC Limits
4-Bromofluorobenzene	97.3 %	70-140
Dibromofluoromethane	113 %	70-140
Toluene-d8	103 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 0.5
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333946
Date Received: 03/08/21
Date Reported: 03/16/21
Sampled: 03/08/21
Prepared: 03/09/21
Analyzed: 03/09/21

VES Thermax-Effluent
1C08014-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.25	ug/L	0.50	<0.078	ppmv	0.16
Ethylbenzene	<0.25	ug/L	0.50	<0.058	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<1.0	ug/L	2.0	<0.28	ppmv	0.55
Toluene	<0.25	ug/L	0.50	<0.066	ppmv	0.13
o-Xylene	<0.25	ug/L	0.50	<0.058	ppmv	0.12
m,p-Xylenes	<0.50	ug/L	1.0	<0.12	ppmv	0.23

Surrogates	%REC	%REC Limits
4-Bromofluorobenzene	101 %	70-140
Dibromofluoromethane	108 %	70-140
Toluene-d8	102 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 10
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333946
Date Received: 03/08/21
Date Reported: 03/16/21
Sampled: 03/08/21
Prepared: 03/09/21
Analyzed: 03/09/21

VES Thermax-Influent
1C08014-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	2200	ug/L	20	540	ppmv	4.9
Surrogates		%REC			%REC Limits	
a,a,a-Trifluorotoluene		91.8 %			70-130	

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333946
Date Received: 03/08/21
Date Reported: 03/16/21
Sampled: 03/08/21
Prepared: 03/09/21
Analyzed: 03/09/21

VES Thermax-Effluent
1C08014-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	<20	ug/L	20	<4.9	ppmv	4.9
Surrogates		%REC			%REC Limits	
a,a,a-Trifluorotoluene		76.3 %			70-130	

Viorel Vasile
 Operations Manager

**LABORATORY ANALYSIS RESULTS**

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Method: VOCs in Vapor as Hexane

AA Project No: A5333946
Date Received: 03/08/21
Date Reported: 03/16/21
Units: ppmv

Date Sampled:	03/08/21	03/08/21	
Date Prepared:	03/09/21	03/09/21	
Date Analyzed:	03/09/21	03/09/21	
AA ID No:	1C08014-01	1C08014-02	
Client ID No:	VES	VES	
	Thermox-Influent	Thermox-Effluent	
Matrix:	Vapor	Vapor	
Dilution Factor:	10	1	MRL

VOCs in Vapor as Hexane (EPA 8015M)

Total VOCs as Hexane	400	<4.9	4.9
----------------------	------------	------	-----

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333946
Date Received: 03/08/21
Date Reported: 03/16/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC %REC	Limit	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1C0916 - *** DEFAULT PREP ***</i>										
Blank (B1C0916-BLK1)				Prepared & Analyzed: 03/09/21						
Benzene	<0.25	0.25	ug/L							
Ethylbenzene	<0.25	0.25	ug/L							
Methyl-tert-Butyl Ether (MTBE)	<1.0	1.0	ug/L							
Toluene	<0.25	0.25	ug/L							
o-Xylene	<0.25	0.25	ug/L							
m,p-Xylenes	<0.50	0.50	ug/L							
<i>Surrogate: 4-Bromofluorobenzene</i>	52.1		ug/L	50.0		104	70-140			
<i>Surrogate: Dibromofluoromethane</i>	56.5		ug/L	50.0		113	70-140			
<i>Surrogate: Toluene-d8</i>	51.9		ug/L	50.0		104	70-140			
LCS (B1C0916-BS1)				Prepared & Analyzed: 03/09/21						
Benzene	22.1	0.50	ug/L	20.0		110	75-125			
Ethylbenzene	22.0	0.50	ug/L	20.0		110	75-125			
Methyl-tert-Butyl Ether (MTBE)	41.8	2.0	ug/L	40.0		104	75-125			
Toluene	20.7	0.50	ug/L	20.0		104	75-125			
o-Xylene	20.6	0.50	ug/L	20.0		103	75-125			
m,p-Xylenes	41.3	1.0	ug/L	40.0		103	75-125			
<i>Surrogate: 4-Bromofluorobenzene</i>	52.4		ug/L	50.0		105	70-140			
<i>Surrogate: Dibromofluoromethane</i>	51.2		ug/L	50.0		102	70-140			
<i>Surrogate: Toluene-d8</i>	52.3		ug/L	50.0		105	70-140			
LCS Dup (B1C0916-BSD1)				Prepared & Analyzed: 03/09/21						
Benzene	20.9	0.50	ug/L	20.0		105	75-125	5.30	30	
Ethylbenzene	21.8	0.50	ug/L	20.0		109	75-125	0.548	30	
Methyl-tert-Butyl Ether (MTBE)	43.0	2.0	ug/L	40.0		107	75-125	2.88	30	
Toluene	20.9	0.50	ug/L	20.0		105	75-125	1.15	30	
o-Xylene	20.8	0.50	ug/L	20.0		104	75-125	1.25	30	
m,p-Xylenes	42.0	1.0	ug/L	40.0		105	75-125	1.78	30	
<i>Surrogate: 4-Bromofluorobenzene</i>	50.7		ug/L	50.0		101	70-140			
<i>Surrogate: Dibromofluoromethane</i>	49.9		ug/L	50.0		99.9	70-140			
<i>Surrogate: Toluene-d8</i>	52.0		ug/L	50.0		104	70-140			
Duplicate (B1C0916-DUP1)				Source: 1C08018-02 Prepared & Analyzed: 03/09/21						

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333946
Date Received: 03/08/21
Date Reported: 03/16/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control

Batch B1C0916 - *** DEFAULT PREP ***

Duplicate (B1C0916-DUP1) Continued Source: 1C08018-02 Prepared & Analyzed: 03/09/21

Benzene	<0.50	0.50	ug/L						30	
Ethylbenzene	<0.50	0.50	ug/L						30	
Methyl-tert-Butyl Ether (MTBE)	<2.0	2.0	ug/L						30	
Toluene	<0.50	0.50	ug/L						30	
o-Xylene	<0.50	0.50	ug/L						30	
m,p-Xylenes	<1.0	1.0	ug/L						30	
Surrogate: 4-Bromofluorobenzene	52.1		ug/L	50.0		104	70-140			
Surrogate: Dibromofluoromethane	56.0		ug/L	50.0		112	70-140			
Surrogate: Toluene-d8	51.6		ug/L	50.0		103	70-140			

Gasoline Range Organics in Vapor by GC/FID - Quality Control

Batch B1C0918 - *** DEFAULT PREP ***

Blank (B1C0918-BLK1) Prepared & Analyzed: 03/09/21

Gasoline Range Organics (GRO)	<20	20	ug/L							
Surrogate: a,a,a-Trifluorotoluene	43.1		ug/L	50.0		86.2	70-130			

LCS (B1C0918-BS1) Prepared & Analyzed: 03/09/21

Gasoline Range Organics (GRO)	498	20	ug/L	500		99.7	75-125			
Surrogate: a,a,a-Trifluorotoluene	53.6		ug/L	50.0		107	70-130			

LCS Dup (B1C0918-BSD1) Prepared & Analyzed: 03/09/21

Gasoline Range Organics (GRO)	498	20	ug/L	500		99.5	75-125	0.112	30	
Surrogate: a,a,a-Trifluorotoluene	52.9		ug/L	50.0		106	70-130			

Duplicate (B1C0918-DUP1) Source: 1C08016-01 Prepared & Analyzed: 03/09/21

Gasoline Range Organics (GRO)	26.8	20	ug/L		27.9			3.99	30	
Surrogate: a,a,a-Trifluorotoluene	41.8		ug/L	50.0		83.6	70-130			

VOCs in Vapor as Hexane - Quality Control

Batch B1C0918 - *** DEFAULT PREP ***

Blank (B1C0918-BLK1) Prepared & Analyzed: 03/09/21

Total VOCs as Hexane	<4.9	4.9	ppmv							
----------------------	------	-----	------	--	--	--	--	--	--	--

Duplicate (B1C0918-DUP1) Source: 1C08016-01 Prepared & Analyzed: 03/09/21

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333946
Date Received: 03/08/21
Date Reported: 03/16/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs in Vapor as Hexane - Quality Control										
<i>Batch B1C0918 - *** DEFAULT PREP ***</i>										
Duplicate (B1C0918-DUP1) Continued Source: 1C08016-01 Prepared & Analyzed: 03/09/21										
Total VOCs as Hexane	4.90	4.9	ppmv		5.10			4.00	30	

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333946
Date Received: 03/08/21
Date Reported: 03/16/21

Special Notes

A handwritten signature in black ink, appearing to read 'VA'.

Viorel Vasile
Operations Manager



AMERICAN ANALYTICS CHAIN-OF-CUSTODY RECORD

9765 ETON AVE., CHATSWORTH, CA 91311
Tel: 818-998-5547 FAX: 818-998-7258

22202

Client: The Source Group, Inc. **Project Name / No.:** DFSP - Norwalk / 091-NOR-001 Task 2 **Sampler's Name:** Glenn Andruska

Project Manager: Neil Irish **Site Address:** 15306 Norwalk Blvd **Sampler's Signature:** Glenn Andruska

Phone: 562-597-1055 **City:** Norwalk **P.O. No.:**

Fax: 569-597-1070 **State & Zip:** CA 90650 **Quote No.:**

TAT Turnaround Codes **

- (1) = Same Day Rush
- (4) = 72 Hour Rush
- (2) = 24 Hour Rush
- (5) = 5 Day Rush
- (3) = 48 Hour Rush
- X = 10 Working Days (Standard TAT)

Client I.D.	Date	Time	Sample Matrix	No. of Cont.	Please enter the TAT Turnaround Codes ** below			Special Instructions
					Total VOCs Gas 8019	Total VOCs Hexane 8015	BTEX/MTBE 8260B	
VES Thermox-Influent	3-8-21	0949	Air	1	✓	✓		VOC's reported as
VES Thermox-Effluent	"	0942	Air	1	✓	✓		GRO (detection limit = 4.9 ppmv) and VOCs as Hexane (detection limit = 4.9 ppmv)
								Benzene (detection limit = 0.15 ppmv)

PRIORITY
RUSH 3/8/21
Date: 3/8/21

Relinquished by	Date	Time	Received by	Time
Glenn Andruska	3-8-21	1115		
	3-8-21	1658		

A5333946/1608014

Note: By relinquishing samples to American Analytics, client agrees to pay for the services requested on this chain of custody form and any additional client-requested analyses performed on this project. Payment for services is due within 30 days from the date of invoice. Sample(s) will be disposed of after 45 days following the submittal of the sample(s) to American Analytics.



9765 Eton Avenue
Chatsworth
California 91311
Tel: (818) 998-5547
Fax: (818) 998-7258

March 03, 2021

Neil Irish

The Source Group, Inc. (SH)
1962 Freeman Ave.
Signal Hill, CA 90755

**Re : DFSP Norwalk VES AQMD / 04-NDLA-013
A5333939 / 1B24008**

Enclosed is an analytical report for the above-referenced project. The samples included in this report were received on 02/24/21 17:38 and analyzed in accordance with the attached chain-of-custody.

Unless otherwise noted, all analytical testing was accomplished in accordance with the guidelines established in our Quality Assurance Program Manual, applicable standard operating procedures, and other related documentation. The results in this analytical report are limited to the samples tested and any reproduction thereof must be made in its entirety.

If you have any questions regarding this report or require additional information please call me at American Analytix.

Sincerely,

A handwritten signature in black ink, appearing to be 'V. Vasile'.

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21

Sample ID	Laboratory ID	Matrix	TAT	Date Sampled	Date Received
-----------	---------------	--------	-----	--------------	---------------

VOCs BTEX/MTBE Vapor GC/MS

Trunkline#1(East)	1B24008-01	Vapor	5	02/24/21 08:55	02/24/21 17:38
Trunkline#2(South)	1B24008-02	Vapor	5	02/24/21 08:50	02/24/21 17:38
Trunkline#3(Central S)	1B24008-03	Vapor	5	02/24/21 09:02	02/24/21 17:38
Trunkline#4(Central E)	1B24008-04	Vapor	5	02/24/21 09:00	02/24/21 17:38
Trunkline#5(Central W)	1B24008-05	Vapor	5	02/24/21 08:58	02/24/21 17:38

VOCs Gasoline Range Organics Vapor

Trunkline#1(East)	1B24008-01	Vapor	5	02/24/21 08:55	02/24/21 17:38
Trunkline#2(South)	1B24008-02	Vapor	5	02/24/21 08:50	02/24/21 17:38
Trunkline#3(Central S)	1B24008-03	Vapor	5	02/24/21 09:02	02/24/21 17:38
Trunkline#4(Central E)	1B24008-04	Vapor	5	02/24/21 09:00	02/24/21 17:38
Trunkline#5(Central W)	1B24008-05	Vapor	5	02/24/21 08:58	02/24/21 17:38

VOCs in Vapor as Hexane

Trunkline#1(East)	1B24008-01	Vapor	5	02/24/21 08:55	02/24/21 17:38
Trunkline#2(South)	1B24008-02	Vapor	5	02/24/21 08:50	02/24/21 17:38
Trunkline#3(Central S)	1B24008-03	Vapor	5	02/24/21 09:02	02/24/21 17:38
Trunkline#4(Central E)	1B24008-04	Vapor	5	02/24/21 09:00	02/24/21 17:38
Trunkline#5(Central W)	1B24008-05	Vapor	5	02/24/21 08:58	02/24/21 17:38

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

Trunkline#1(East)
1B24008-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	1.1	ug/L	0.50	0.34	ppmv	0.16
Ethylbenzene	1.3	ug/L	0.50	0.30	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	1.2	ug/L	0.50	0.32	ppmv	0.13
o-Xylene	1.0	ug/L	0.50	0.23	ppmv	0.12
m,p-Xylenes	3.3	ug/L	1.0	0.76	ppmv	0.23

Surrogates	%REC	%REC Limits
4-Bromofluorobenzene	94.6 %	70-140
Dibromofluoromethane	86.6 %	70-140
Toluene-d8	89.0 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

Trunkline#2(South)
1B24008-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.50	ug/L	0.50	<0.16	ppmv	0.16
Ethylbenzene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	<0.50	ug/L	0.50	<0.13	ppmv	0.13
o-Xylene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
m,p-Xylenes	<1.0	ug/L	1.0	<0.23	ppmv	0.23

Surrogates	%REC	%REC Limits
4-Bromofluorobenzene	97.6 %	70-140
Dibromofluoromethane	86.0 %	70-140
Toluene-d8	88.0 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

Trunkline#3(Central S)
1B24008-03 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	15	ug/L	0.50	4.7	ppmv	0.16
Ethylbenzene	6.1	ug/L	0.50	1.4	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	1.2	ug/L	0.50	0.32	ppmv	0.13
o-Xylene	2.9	ug/L	0.50	0.67	ppmv	0.12
m,p-Xylenes	15	ug/L	1.0	3.5	ppmv	0.23

Surrogates	%REC	%REC Limits
4-Bromofluorobenzene	91.4 %	70-140
Dibromofluoromethane	85.8 %	70-140
Toluene-d8	88.3 %	70-140

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

Trunkline#4(Central E)

1B24008-04 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	14	ug/L	0.50	4.4	ppmv	0.16
Ethylbenzene	5.3	ug/L	0.50	1.2	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	12	ug/L	0.50	3.2	ppmv	0.13
o-Xylene	6.0	ug/L	0.50	1.4	ppmv	0.12
m,p-Xylenes	15	ug/L	1.0	3.5	ppmv	0.23

Surrogates	%REC	%REC Limits
4-Bromofluorobenzene	92.5 %	70-140
Dibromofluoromethane	84.9 %	70-140
Toluene-d8	87.3 %	70-140

Viorel Vasile
 Operations Manager

**LABORATORY ANALYSIS RESULTS****Client:** The Source Group, Inc. (SH)**Project No:** 04-NDLA-013**Project Name:** DFSP Norwalk VES AQMD**Matrix:** Vapor**Dilution:** 1**Method:** VOCs BTEX/MTBE Vapor by GC/MS 8260M**AA Project No:** A5333939**Date Received:** 02/24/21**Date Reported:** 03/03/21**Sampled:** 02/24/21**Prepared:** 02/25/21**Analyzed:** 02/25/21**Trunkline#5(Central W)****1B24008-05 (Vapor)**

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	3.0	ug/L	0.50	0.94	ppmv	0.16
Ethylbenzene	1.2	ug/L	0.50	0.28	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	<0.50	ug/L	0.50	<0.13	ppmv	0.13
o-Xylene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
m,p-Xylenes	<1.0	ug/L	1.0	<0.23	ppmv	0.23

Surrogates**%REC****%REC Limits**

4-Bromofluorobenzene

91.1 %

70-140

Dibromofluoromethane

88.0 %

70-140

Toluene-d8

87.9 %

70-140

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 10
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

Trunkline#1(East)
1B24008-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	1600	ug/L	20	390	ppmv	4.9
Surrogates		%REC				%REC Limits
a,a,a-Trifluorotoluene		95.3 %				70-130

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 2
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

Trunkline#2(South)
1B24008-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	950	ug/L	20	230	ppmv	4.9
Surrogates		%REC			%REC Limits	
a,a,a-Trifluorotoluene		89.3 %			70-130	

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)

Project No: 04-NDLA-013

Project Name: DFSP Norwalk VES AQMD

Matrix: Vapor

Dilution: 100

Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333939

Date Received: 02/24/21

Date Reported: 03/03/21

Sampled: 02/24/21

Prepared: 02/25/21

Analyzed: 02/25/21

Trunkline#3(Central S)

1B24008-03 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	11000	ug/L	20	2700	ppmv	4.9
<u>Surrogates</u>		<u>%REC</u>			<u>%REC Limits</u>	
a,a,a-Trifluorotoluene		85.6 %			70-130	

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 50
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

Trunkline#4(Central E)

1B24008-04 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	7000	ug/L	20	1700	ppmv	4.9
<u>Surrogates</u>		<u>%REC</u>				<u>%REC Limits</u>
a,a,a-Trifluorotoluene		98.8 %				70-130

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 2
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

Trunkline#5(Central W)

1B24008-05 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	3000	ug/L	20	730	ppmv	4.9
<u>Surrogates</u>		<u>%REC</u>				<u>%REC Limits</u>
a,a,a-Trifluorotoluene		112 %				70-130

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Method: VOCs in Vapor as Hexane

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21
Units: ppmv

Date Sampled:	02/24/21	02/24/21	02/24/21	02/24/21	
Date Prepared:	02/25/21	02/25/21	02/25/21	02/25/21	
Date Analyzed:	02/25/21	02/25/21	02/25/21	02/25/21	
AA ID No:	1B24008-01	1B24008-02	1B24008-03	1B24008-04	
Client ID No:	Trunkline#1(East)	Trunkline#2(South)	Trunkline#3(Centr al S)	Trunkline#4(Centr al E)	
Matrix:	Vapor	Vapor	Vapor	Vapor	
Dilution Factor:	1	2	100	50	MRL

VOCs in Vapor as Hexane (EPA 8015M)

Total VOCs as Hexane	30	170	2100	1300	4.9
----------------------	-----------	------------	-------------	-------------	-----

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Method: VOCs in Vapor as Hexane

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21
Units: ppmv

Date Sampled:	02/24/21	
Date Prepared:	02/25/21	
Date Analyzed:	02/25/21	
AA ID No:	1B24008-05	
Client ID No:	Trunkline#5(Centr al W)	
Matrix:	Vapor	
Dilution Factor:	2	MRL

VOCs in Vapor as Hexane (EPA 8015M)

Total VOCs as Hexane	550	4.9
----------------------	------------	-----

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC %REC	Limit	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1B2512 - *** DEFAULT PREP ***</i>										
Blank (B1B2512-BLK1) Prepared & Analyzed: 02/25/21										
Benzene	<0.25	0.25	ug/L							
Ethylbenzene	<0.25	0.25	ug/L							
Methyl-tert-Butyl Ether (MTBE)	<1.0	1.0	ug/L							
Toluene	<0.25	0.25	ug/L							
o-Xylene	<0.25	0.25	ug/L							
m,p-Xylenes	<0.50	0.50	ug/L							
<i>Surrogate: 4-Bromofluorobenzene</i>	49.8		ug/L	50.0		99.6	70-140			
<i>Surrogate: Dibromofluoromethane</i>	43.3		ug/L	50.0		86.5	70-140			
<i>Surrogate: Toluene-d8</i>	43.1		ug/L	50.0		86.2	70-140			
LCS (B1B2512-BS1) Prepared & Analyzed: 02/25/21										
Benzene	17.4	0.50	ug/L	20.0		86.8	75-125			
Ethylbenzene	20.0	0.50	ug/L	20.0		99.8	75-125			
Methyl-tert-Butyl Ether (MTBE)	32.6	2.0	ug/L	40.0		81.5	75-125			
Toluene	19.5	0.50	ug/L	20.0		97.6	75-125			
o-Xylene	19.6	0.50	ug/L	20.0		97.8	75-125			
m,p-Xylenes	40.7	1.0	ug/L	40.0		102	75-125			
<i>Surrogate: 4-Bromofluorobenzene</i>	49.4		ug/L	50.0		98.7	70-140			
<i>Surrogate: Dibromofluoromethane</i>	39.2		ug/L	50.0		78.4	70-140			
<i>Surrogate: Toluene-d8</i>	43.8		ug/L	50.0		87.7	70-140			
LCS Dup (B1B2512-BSD1) Prepared & Analyzed: 02/25/21										
Benzene	17.4	0.50	ug/L	20.0		87.2	75-125	0.345	30	
Ethylbenzene	20.0	0.50	ug/L	20.0		100	75-125	0.250	30	
Methyl-tert-Butyl Ether (MTBE)	32.3	2.0	ug/L	40.0		80.8	75-125	0.955	30	
Toluene	19.6	0.50	ug/L	20.0		98.0	75-125	0.307	30	
o-Xylene	19.4	0.50	ug/L	20.0		97.0	75-125	0.821	30	
m,p-Xylenes	40.9	1.0	ug/L	40.0		102	75-125	0.589	30	
<i>Surrogate: 4-Bromofluorobenzene</i>	48.8		ug/L	50.0		97.6	70-140			
<i>Surrogate: Dibromofluoromethane</i>	38.6		ug/L	50.0		77.2	70-140			
<i>Surrogate: Toluene-d8</i>	44.1		ug/L	50.0		88.2	70-140			
Duplicate (B1B2512-DUP1) Source: 1B24011-04 Prepared & Analyzed: 02/25/21										

Viorel Vasile
Operations Manager

**LABORATORY ANALYSIS RESULTS**

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1B2512 - *** DEFAULT PREP ***</i>										
Duplicate (B1B2512-DUP1) Continued Source: 1B24011-04 Prepared & Analyzed: 02/25/21										
Benzene	<0.50	0.50	ug/L		0.210				30	
Ethylbenzene	<0.50	0.50	ug/L						30	
Methyl-tert-Butyl Ether (MTBE)	<2.0	2.0	ug/L						30	
Toluene	<0.50	0.50	ug/L						30	
o-Xylene	<0.50	0.50	ug/L						30	
m,p-Xylenes	<1.0	1.0	ug/L		0.830			8.81	30	
<i>Surrogate: 4-Bromofluorobenzene</i>	46.8		ug/L	50.0		93.6	70-140			
<i>Surrogate: Dibromofluoromethane</i>	43.0		ug/L	50.0		86.1	70-140			
<i>Surrogate: Toluene-d8</i>	44.6		ug/L	50.0		89.3	70-140			
Gasoline Range Organics in Vapor by GC/FID - Quality Control										
<i>Batch B1B2511 - *** DEFAULT PREP ***</i>										
Blank (B1B2511-BLK1) Prepared & Analyzed: 02/25/21										
Gasoline Range Organics (GRO)	<20	20	ug/L							
<i>Surrogate: a,a,a-Trifluorotoluene</i>	36.2		ug/L	50.0		72.5	70-130			
LCS (B1B2511-BS1) Prepared & Analyzed: 02/25/21										
Gasoline Range Organics (GRO)	488	20	ug/L	500		97.5	75-125			
<i>Surrogate: a,a,a-Trifluorotoluene</i>	51.6		ug/L	50.0		103	70-130			
LCS Dup (B1B2511-BSD1) Prepared & Analyzed: 02/25/21										
Gasoline Range Organics (GRO)	481	20	ug/L	500		96.2	75-125	1.32	30	
<i>Surrogate: a,a,a-Trifluorotoluene</i>	51.7		ug/L	50.0		103	70-130			
Duplicate (B1B2511-DUP1) Source: 1B24009-01 Prepared & Analyzed: 02/25/21										
Gasoline Range Organics (GRO)	4790	40	ug/L		4040			17.0	30	
<i>Surrogate: a,a,a-Trifluorotoluene</i>	44.0		ug/L	50.0		88.0	70-130			

VOCs in Vapor as Hexane - Quality Control*Batch B1B2511 - *** DEFAULT PREP ******Blank (B1B2511-BLK1)**

Prepared & Analyzed: 02/25/21

Total VOCs as Hexane <4.9 4.9 ppmv

Duplicate (B1B2511-DUP1)

Source: 1B24009-01 Prepared & Analyzed: 02/25/21

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs in Vapor as Hexane - Quality Control										
<i>Batch B1B2511 - *** DEFAULT PREP ***</i>										
Duplicate (B1B2511-DUP1) Continued Source: 1B24009-01 Prepared & Analyzed: 02/25/21										
Total VOCs as Hexane	863	9.8	ppmv		736			16.0	30	

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333939
Date Received: 02/24/21
Date Reported: 03/03/21

Special Notes

A handwritten signature in black ink, appearing to be 'VA' or similar, located below the 'Special Notes' section.

Viorel Vasile
Operations Manager



AMERICAN ANALYTICS CHAIN-OF-CUSTODY RECORD

9755 ETON AVE., CHATSWORTH, CA 91311

Tel: 818-998-5547 FAX: 818-998-7258

22131

Page 1 of 1

Client: The Source Group, Inc. **Project Name / No.:** DFSP - Norwalk / 091-NDLA **Sampler's Name:** Glenn Andrusko

Project Manager: Neil Irish **Site Address:** 15306 Norwalk Blvd **Sampler's Signature:** *Glenn Andrusko*

Phone: 562-597-1055 **City:** Norwalk **P.O. No.:**

Fax: 569-597-1070 **State & Zip:** CA 90650 **Quote No.:**

TAT Turnaround Codes **

- ① = Same Day Rush
- ② = 24 Hour Rush
- ③ = 48 Hour Rush
- ④ = 72 Hour Rush
- ⑤ = 5 Day Rush
- X = 10 Working Days (Standard TAT)

ANALYSIS REQUESTED (Test Name)

Client I.D.	Date	Time	Sample Matrix	No. of Cont	Please enter the TAT Turnaround Codes ** below			Special Instructions
					Total VOCs Gas 8019	Total VOCs Hexane 8515	BTEX/MTBE 8260B	
Trunkline#1 (East)	2-24-21	0855	Air	1	✓	✓		VOC's reported as
Trunkline#2 (South)		0850	Air	1	✓	✓		GRO (detection limit
Trunkline#3 (Central S)		0902	Air	1	✓	✓		=4.9 ppmv) and
Trunkline#4 (Central E)		0900	Air	1	✓	✓		VOCs as Hexane
Trunkline#5 (Central W)		0858	Air	1	✓	✓		(detection limit =
								4.9 ppmv)
								Benzene (detection
								limit = 0.15 ppmv)

Relinquished by <i>Glenn Andrusko</i>	Date 2-24-21	Time 1300	Received by <i>[Signature]</i>
Relinquished by <i>[Signature]</i>	Date 2/24/21	Time 1738	Received by <i>[Signature]</i>
Relinquished by	Date	Time	Received by

Note: By relinquishing samples to American Analytics, client agrees to pay for the services requested on this chain of custody form and any additional client-requested analyses performed on this project. Payment for services is due within 30 days from the date of invoice. Sample(s) will be disposed of after 45 days following the submittal of the sample(s) to American Analytics.

AS333939/1524008
 AS333939/1524008

PRIORITY
 2/24/21 10:58 AM
 2/24/21 10:58 AM



9765 Eton Avenue
Chatsworth
California 91311
Tel: (818) 998-5547
Fax: (818) 998-7258

March 04, 2021

Neil Irish

The Source Group, Inc. (SH)
1962 Freeman Ave.
Signal Hill, CA 90755

**Re : DFSP Norwalk VES AQMD / 04-NDLA-013
A5333942 / 1B24011**

Enclosed is an analytical report for the above-referenced project. The samples included in this report were received on 02/24/21 17:38 and analyzed in accordance with the attached chain-of-custody.

Unless otherwise noted, all analytical testing was accomplished in accordance with the guidelines established in our Quality Assurance Program Manual, applicable standard operating procedures, and other related documentation. The results in this analytical report are limited to the samples tested and any reproduction thereof must be made in its entirety.

If you have any questions regarding this report or require additional information please call me at American Analytix.

Sincerely,

A handwritten signature in black ink, appearing to be 'V. Vasile'.

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333942
Date Received: 02/24/21
Date Reported: 03/04/21

Sample ID	Laboratory ID	Matrix	TAT	Date Sampled	Date Received
-----------	---------------	--------	-----	--------------	---------------

VOCs BTEX/MTBE Vapor GC/MS

HW-1	1B24011-01	Vapor	5	02/24/21 09:47	02/24/21 17:38
HW-5	1B24011-02	Vapor	5	02/24/21 09:50	02/24/21 17:38
HW-7	1B24011-03	Vapor	5	02/24/21 09:55	02/24/21 17:38
HW-9	1B24011-04	Vapor	5	02/24/21 10:08	02/24/21 17:38

VOCs Gasoline Range Organics Vapor

HW-1	1B24011-01	Vapor	5	02/24/21 09:47	02/24/21 17:38
HW-5	1B24011-02	Vapor	5	02/24/21 09:50	02/24/21 17:38
HW-7	1B24011-03	Vapor	5	02/24/21 09:55	02/24/21 17:38
HW-9	1B24011-04	Vapor	5	02/24/21 10:08	02/24/21 17:38

VOCs in Vapor as Hexane

HW-1	1B24011-01	Vapor	5	02/24/21 09:47	02/24/21 17:38
HW-5	1B24011-02	Vapor	5	02/24/21 09:50	02/24/21 17:38
HW-7	1B24011-03	Vapor	5	02/24/21 09:55	02/24/21 17:38
HW-9	1B24011-04	Vapor	5	02/24/21 10:08	02/24/21 17:38

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M

AA Project No: A5333942
Date Received: 02/24/21
Date Reported: 03/04/21
Sampled: 02/24/21
Prepared: 02/25/21
Analyzed: 02/25/21

HW-1

1B24011-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.50	ug/L	0.50	<0.16	ppmv	0.16
Ethylbenzene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	<0.50	ug/L	0.50	<0.13	ppmv	0.13
o-Xylene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
m,p-Xylenes	<1.0	ug/L	1.0	<0.23	ppmv	0.23

Surrogates	%REC	%REC Limits
4-Bromofluorobenzene	98.0 %	70-140
Dibromofluoromethane	82.5 %	70-140
Toluene-d8	88.6 %	70-140

Viorel Vasile
 Operations Manager

**LABORATORY ANALYSIS RESULTS****Client:** The Source Group, Inc. (SH)**Project No:** 04-NDLA-013**Project Name:** DFSP Norwalk VES AQMD**Matrix:** Vapor**Dilution:** 1**Method:** VOCs BTEX/MTBE Vapor by GC/MS 8260M**AA Project No:** A5333942**Date Received:** 02/24/21**Date Reported:** 03/04/21**Sampled:** 02/24/21**Prepared:** 02/25/21**Analyzed:** 02/25/21**HW-5****1B24011-02 (Vapor)**

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.50	ug/L	0.50	<0.16	ppmv	0.16
Ethylbenzene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	<0.50	ug/L	0.50	<0.13	ppmv	0.13
o-Xylene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
m,p-Xylenes	<1.0	ug/L	1.0	<0.23	ppmv	0.23

Surrogates**%REC****%REC Limits**

4-Bromofluorobenzene

97.9 %

70-140

Dibromofluoromethane

83.4 %

70-140

Toluene-d8

87.9 %

70-140

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client:	The Source Group, Inc. (SH)	AA Project No:	A5333942
Project No:	04-NDLA-013	Date Received:	02/24/21
Project Name:	DFSP Norwalk VES AQMD	Date Reported:	03/04/21
Matrix:	Vapor	Sampled:	02/24/21
Dilution:	1	Prepared:	02/25/21
Method:	VOCs BTEX/MTBE Vapor by GC/MS 8260M	Analyzed:	02/25/21

HW-7

1B24011-03 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.50	ug/L	0.50	<0.16	ppmv	0.16
Ethylbenzene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	<0.50	ug/L	0.50	<0.13	ppmv	0.13
o-Xylene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
m,p-Xylenes	<1.0	ug/L	1.0	<0.23	ppmv	0.23

<u>Surrogates</u>	<u>%REC</u>	<u>%REC Limits</u>
4-Bromofluorobenzene	100 %	70-140
Dibromofluoromethane	81.7 %	70-140
Toluene-d8	88.5 %	70-140

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH) **AA Project No:** A5333942
Project No: 04-NDLA-013 **Date Received:** 02/24/21
Project Name: DFSP Norwalk VES AQMD **Date Reported:** 03/04/21
Matrix: Vapor **Sampled:** 02/24/21
Dilution: 1 **Prepared:** 02/25/21
Method: VOCs BTEX/MTBE Vapor by GC/MS 8260M **Analyzed:** 02/25/21

HW-9
1B24011-04 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Benzene	<0.50	ug/L	0.50	<0.16	ppmv	0.16
Ethylbenzene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
Methyl-tert-Butyl Ether (MTBE)	<2.0	ug/L	2.0	<0.55	ppmv	0.55
Toluene	<0.50	ug/L	0.50	<0.13	ppmv	0.13
o-Xylene	<0.50	ug/L	0.50	<0.12	ppmv	0.12
m,p-Xylenes	<1.0	ug/L	1.0	<0.23	ppmv	0.23

<u>Surrogates</u>	<u>%REC</u>	<u>%REC Limits</u>
4-Bromofluorobenzene	95.0 %	70-140
Dibromofluoromethane	83.6 %	70-140
Toluene-d8	89.4 %	70-140

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333942
Date Received: 02/24/21
Date Reported: 03/04/21
Sampled: 02/24/21
Prepared: 02/26/21
Analyzed: 02/26/21

HW-1

1B24011-01 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	34	ug/L	20	8.3	ppmv	4.9
Surrogates		%REC			%REC Limits	
a,a,a-Trifluorotoluene		92.9 %			70-130	

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333942
Date Received: 02/24/21
Date Reported: 03/04/21
Sampled: 02/24/21
Prepared: 02/26/21
Analyzed: 02/26/21

HW-5

1B24011-02 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	<20	ug/L	20	<4.9	ppmv	4.9
<u>Surrogates</u>		<u>%REC</u>			<u>%REC Limits</u>	
a,a,a-Trifluorotoluene		90.3 %			70-130	

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333942
Date Received: 02/24/21
Date Reported: 03/04/21
Sampled: 02/24/21
Prepared: 02/26/21
Analyzed: 02/26/21

HW-7

1B24011-03 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	27	ug/L	20	6.6	ppmv	4.9
<u>Surrogates</u>		<u>%REC</u>				<u>%REC Limits</u>
a,a,a-Trifluorotoluene		89.6 %				70-130

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Matrix: Vapor
Dilution: 1
Method: Gasoline Range Organics in Vapor by GC/FID

AA Project No: A5333942
Date Received: 02/24/21
Date Reported: 03/04/21
Sampled: 02/24/21
Prepared: 02/26/21
Analyzed: 02/26/21

HW-9

1B24011-04 (Vapor)

Analyte	Result	(ug/L)	MRL	Result	(ppmv)	MRL
Gasoline Range Organics (GRO)	1300	ug/L	20	320	ppmv	4.9
<u>Surrogates</u>		<u>%REC</u>				<u>%REC Limits</u>
a,a,a-Trifluorotoluene		109 %				70-130

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD
Method: VOCs in Vapor as Hexane

AA Project No: A5333942
Date Received: 02/24/21
Date Reported: 03/04/21
Units: ppmv

Date Sampled:	02/24/21	02/24/21	02/24/21	02/24/21
Date Prepared:	02/26/21	02/26/21	02/26/21	02/26/21
Date Analyzed:	02/26/21	02/26/21	02/26/21	02/26/21
AA ID No:	1B24011-01	1B24011-02	1B24011-03	1B24011-04
Client ID No:	HW-1	HW-5	HW-7	HW-9
Matrix:	Vapor	Vapor	Vapor	Vapor
Dilution Factor:	1	1	1	1
				MRL

VOCs in Vapor as Hexane (EPA 8015M)

Total VOCs as Hexane	6.2	<4.9	5.0	230	4.9
----------------------	------------	------	------------	------------	-----

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333942
Date Received: 02/24/21
Date Reported: 03/04/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC %REC Limits	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control									
<i>Batch B1B2512 - *** DEFAULT PREP ***</i>									
Blank (B1B2512-BLK1)					Prepared & Analyzed: 02/25/21				
Benzene	<0.25	0.25	ug/L						
Ethylbenzene	<0.25	0.25	ug/L						
Methyl-tert-Butyl Ether (MTBE)	<1.0	1.0	ug/L						
Toluene	<0.25	0.25	ug/L						
o-Xylene	<0.25	0.25	ug/L						
m,p-Xylenes	<0.50	0.50	ug/L						
<i>Surrogate: 4-Bromofluorobenzene</i>	49.8		ug/L	50.0		99.6 70-140			
<i>Surrogate: Dibromofluoromethane</i>	43.3		ug/L	50.0		86.5 70-140			
<i>Surrogate: Toluene-d8</i>	43.1		ug/L	50.0		86.2 70-140			
LCS (B1B2512-BS1)					Prepared & Analyzed: 02/25/21				
Benzene	17.4	0.50	ug/L	20.0		86.8 75-125			
Ethylbenzene	20.0	0.50	ug/L	20.0		99.8 75-125			
Methyl-tert-Butyl Ether (MTBE)	32.6	2.0	ug/L	40.0		81.5 75-125			
Toluene	19.5	0.50	ug/L	20.0		97.6 75-125			
o-Xylene	19.6	0.50	ug/L	20.0		97.8 75-125			
m,p-Xylenes	40.7	1.0	ug/L	40.0		102 75-125			
<i>Surrogate: 4-Bromofluorobenzene</i>	49.4		ug/L	50.0		98.7 70-140			
<i>Surrogate: Dibromofluoromethane</i>	39.2		ug/L	50.0		78.4 70-140			
<i>Surrogate: Toluene-d8</i>	43.8		ug/L	50.0		87.7 70-140			
LCS Dup (B1B2512-BSD1)					Prepared & Analyzed: 02/25/21				
Benzene	17.4	0.50	ug/L	20.0		87.2 75-125	0.345	30	
Ethylbenzene	20.0	0.50	ug/L	20.0		100 75-125	0.250	30	
Methyl-tert-Butyl Ether (MTBE)	32.3	2.0	ug/L	40.0		80.8 75-125	0.955	30	
Toluene	19.6	0.50	ug/L	20.0		98.0 75-125	0.307	30	
o-Xylene	19.4	0.50	ug/L	20.0		97.0 75-125	0.821	30	
m,p-Xylenes	40.9	1.0	ug/L	40.0		102 75-125	0.589	30	
<i>Surrogate: 4-Bromofluorobenzene</i>	48.8		ug/L	50.0		97.6 70-140			
<i>Surrogate: Dibromofluoromethane</i>	38.6		ug/L	50.0		77.2 70-140			
<i>Surrogate: Toluene-d8</i>	44.1		ug/L	50.0		88.2 70-140			
Duplicate (B1B2512-DUP1)					Source: 1B24011-04 Prepared & Analyzed: 02/25/21				

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333942
Date Received: 02/24/21
Date Reported: 03/04/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs BTEX/MTBE Vapor by GC/MS 8260M - Quality Control										
<i>Batch B1B2512 - *** DEFAULT PREP ***</i>										
Duplicate (B1B2512-DUP1) Continued Source: 1B24011-04 Prepared & Analyzed: 02/25/21										
Benzene	<0.50	0.50	ug/L		0.210				30	
Ethylbenzene	<0.50	0.50	ug/L		<0.50				30	
Methyl-tert-Butyl Ether (MTBE)	<2.0	2.0	ug/L		<2.0				30	
Toluene	<0.50	0.50	ug/L		<0.50				30	
o-Xylene	<0.50	0.50	ug/L		<0.50				30	
m,p-Xylenes	<1.0	1.0	ug/L		0.830			8.81	30	
<i>Surrogate: 4-Bromofluorobenzene</i>	46.8		ug/L	50.0		93.6	70-140			
<i>Surrogate: Dibromofluoromethane</i>	43.0		ug/L	50.0		86.1	70-140			
<i>Surrogate: Toluene-d8</i>	44.6		ug/L	50.0		89.3	70-140			
Gasoline Range Organics in Vapor by GC/FID - Quality Control										
<i>Batch B1B2601 - *** DEFAULT PREP ***</i>										
Blank (B1B2601-BLK1) Prepared & Analyzed: 02/26/21										
Gasoline Range Organics (GRO)	<20	20	ug/L							
<i>Surrogate: a,a,a-Trifluorotoluene</i>	42.7		ug/L	50.0		85.4	70-130			
LCS (B1B2601-BS1) Prepared & Analyzed: 02/26/21										
Gasoline Range Organics (GRO)	485	20	ug/L	500		97.0	75-125			
<i>Surrogate: a,a,a-Trifluorotoluene</i>	51.6		ug/L	50.0		103	70-130			
LCS Dup (B1B2601-BSD1) Prepared & Analyzed: 02/26/21										
Gasoline Range Organics (GRO)	504	20	ug/L	500		101	75-125	3.87	30	
<i>Surrogate: a,a,a-Trifluorotoluene</i>	52.6		ug/L	50.0		105	70-130			
Duplicate (B1B2601-DUP1) Source: 1B24010-01 Prepared & Analyzed: 02/26/21										
Gasoline Range Organics (GRO)	<20	20	ug/L						30	
<i>Surrogate: a,a,a-Trifluorotoluene</i>	46.7		ug/L	50.0		93.5	70-130			
VOCs in Vapor as Hexane - Quality Control										
<i>Batch B1B2601 - *** DEFAULT PREP ***</i>										
Blank (B1B2601-BLK1) Prepared & Analyzed: 02/26/21										
Total VOCs as Hexane	<4.9	4.9	ppmv							
Duplicate (B1B2601-DUP1) Source: 1B24010-01 Prepared & Analyzed: 02/26/21										

Viorel Vasile
Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333942
Date Received: 02/24/21
Date Reported: 03/04/21

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
VOCs in Vapor as Hexane - Quality Control										
<i>Batch B1B2601 - *** DEFAULT PREP ***</i>										
Duplicate (B1B2601-DUP1) Continued Source: 1B24010-01 Prepared & Analyzed: 02/26/21										
Total VOCs as Hexane	<4.9	4.9	ppmv						30	

Viorel Vasile
 Operations Manager



LABORATORY ANALYSIS RESULTS

Client: The Source Group, Inc. (SH)
Project No: 04-NDLA-013
Project Name: DFSP Norwalk VES AQMD

AA Project No: A5333942
Date Received: 02/24/21
Date Reported: 03/04/21

Special Notes

A handwritten signature in black ink, appearing to be 'VA' or similar, located below the 'Special Notes' section.

Viorel Vasile
Operations Manager



AMERICAN ANALYTICS CHAIN-OF-CUSTODY RECORD

9765 ETON AVE., CHATSWORTH, CA 91311

Tel: 818-998-5547 FAX: 818-998-7258

22134

Page 1 of 1

Client: The Source Group, Inc. **Project Name / No.:** DFSP - Norwalk / 091-NOR-001 Task 2 **Sampler's Name:** Glenn Androsko
Project Manager: Neil Irish **Site Address:** 15306 Norwalk Blvd **Sampler's Signature:** *Glenn Androsko*
Phone: 562-597-1055 **City:** Norwalk **P.O. No.:**
Fax: 569-597-1070 **State & Zip:** CA 90650 **Quote No.:**

TAT Turnaround Codes **

- (1) = Same Day Rush
- (2) = 24 Hour Rush
- (3) = 48 Hour Rush
- (4) = 72 Hour Rush
- (5) = 5 Day Rush
- X = 10 Working Days (Standard TAT)

ANALYSIS REQUESTED (Test Name)

Client I.D.	Date	Time	Sample Matrix	No. of Cont	Please enter the TAT Turnaround Codes ** below		Special Instructions
					Total VOCs Gas 8019	Total VOCs Hexane 8015	
HW-1	2-24-21	0947	Air	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	VOC's reported as GRO (detection limit = 4.9 ppmv) and VOCs as Hexane (detection limit = 4.9 ppmv) Benzene (detection limit = 0.15 ppmv)
HW-5	-	0950	Air	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	
HW-7	-	0955	Air	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	
HW-9	-	1008	Air	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	
Relinquished by <i>Glenn Androsko</i>					Date	Time	Received by
Relinquished by <i>[Signature]</i>					2-24-21	1300	<i>[Signature]</i>
Relinquished by <i>[Signature]</i>					2/24/21	1736	<i>[Signature]</i>
Relinquished by <i>[Signature]</i>							Received by

A5333942/1824011

A5333942/1824011

Note: By relinquishing samples to American Analytics, client agrees to pay for the services requested on this chain of custody form and any additional client-requested analyses performed on this project. Payment for services is due within 30 days from the date of invoice. Sample(s) will be disposed of after 45 days following the submittal of the sample(s) to American Analytics.



ENTHALPY
ANALYTICAL

Enthalpy Analytical
931 West Barkley Ave
Orange, CA 92868
(714) 771-6900

enthalpy.com

Lab Job Number: 439902
Report Level: II
Report Date: 02/11/2021

Analytical Report *prepared for:*

Imedla Morales
APEX - Signal Hill
1962 Freeman Avenue
Signal Hill, CA 90755

Project: PERMIT #22453_WW - WW

Authorized for release by:

Diane Galvan, Project Manager
714-771-9928
diane.galvan@enthalpy.com

This data package has been reviewed for technical correctness and completeness. Release of this data has been authorized by the Laboratory Manager or the Manager's designee, as verified by the above signature which applies to this PDF file as well as any associated electronic data deliverable files. The results contained in this report meet all requirements of NELAP and pertain only to those samples which were submitted for analysis. This report may be reproduced only in its entirety.

CA ELAP# 1338, NELAP# 4038, SCAQMD LAP# 18LA0518, LACSD ID# 10105, CDC ELITE
Member

Sample Summary

Imedia Morales
APEX - Signal Hill
1962 Freeman Avenue
Signal Hill, CA 90755

Lab Job #: 439902
Project No: PERMIT #22453_WW
Location: WW
Date Received: 01/28/21

Sample ID	Lab ID	Collected	Matrix
EFFLUENT_01-28-21	439902-001	01/28/21 14:20	Water

439902

CHAIN OF CUSTODY RECORD		ENTHALPY ANALYTICAL																																																																																																																																								
931 W. Barkley, Orange, CA 92668 Phone: (714) 771-6900 Fax: (714) 771-9933 Billing: Enthalpy Analytical c/o Montrose Environmental Group Inc. P.O. Box 741137, Los Angeles, CA 90074-1137		Lab Number: 15881 Client ID: Page: 1 of 1																																																																																																																																								
CUSTOMER INFORMATION Company: APEX Report To: Imelda Morales imelda.morales@apexco.com imelda.morales@apexco.com Email: Katy.Lvarez@apexco.com Address: 1962 Freeman Ave Signal Hill, CA 90755 Phone: 562-597-1055 Fax:		PROJECT INFORMATION Name: WW Number: Permit #22453 Address: 15909 Norwalk Blvd Norwalk, CA 90850 Global ID: P.O. #: Sampled By:																																																																																																																																								
TEST INFORMATION Matrix: W Container: 1-L Pres.: 4.2.5 Matrix: 2840D TSS Container: 5220-D COD		Turn Around Time Standard X 72 Hours 48 Hours 24 Hours Same Day																																																																																																																																								
Meter Readings 1) Begin: pH End: 2) Begin: Temp. End: 3) Begin: Time End: 4) Begin: Time End:		Analysis <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th>Sample ID</th> <th>Date</th> <th>Time</th> <th>Temp.</th> <th>pH</th> <th>Time</th> <th>Requished By:</th> <th>Received By:</th> <th>Authorized By:</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Effluent 01-28-21</td> <td>1-25-21</td> <td>1420</td> <td></td> <td></td> <td>Kathy</td> <td>Chelle Gail</td> <td></td> </tr> <tr><td>2</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>3</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>4</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>5</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>6</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>7</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>8</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>9</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>10</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>11</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>12</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>13</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>14</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> </tbody> </table>		Sample ID	Date	Time	Temp.	pH	Time	Requished By:	Received By:	Authorized By:	1	Effluent 01-28-21	1-25-21	1420			Kathy	Chelle Gail		2									3									4									5									6									7									8									9									10									11									12									13									14								
Sample ID	Date	Time	Temp.	pH	Time	Requished By:	Received By:	Authorized By:																																																																																																																																		
1	Effluent 01-28-21	1-25-21	1420			Kathy	Chelle Gail																																																																																																																																			
2																																																																																																																																										
3																																																																																																																																										
4																																																																																																																																										
5																																																																																																																																										
6																																																																																																																																										
7																																																																																																																																										
8																																																																																																																																										
9																																																																																																																																										
10																																																																																																																																										
11																																																																																																																																										
12																																																																																																																																										
13																																																																																																																																										
14																																																																																																																																										
Relinquished By: <i>Kathy</i> Print Name: Kathleen Ryan Date: 1-20-21 Time: 1630 Relinquished By: 3 Received By: 3 Print Name: Mustave C. Date: 1/20/21 Time: 1630 Relinquished By: 4 Received By: 4		Relinquished By: <i>Chelle Gail</i> Print Name: Date: Relinquished By: 2 Received By: 2 Print Name: Date: Relinquished By: 4 Received By: 4																																																																																																																																								



ENTHALPY ANALYTICAL

SAMPLE ACCEPTANCE CHECKLIST

Section 1
 Client: Apex Project: _____
 Date Received: 1/20/21 Sampler's Name Present: Yes No

Section 2
 Sample(s) received in a cooler? Yes, How many? 1 No (skip section 2) Sample Temp (°C) (No Cooler): _____
 Sample Temp (°C), One from each cooler: #1: 17.0 #2: _____ #3: _____ #4: _____
(Acceptance range is < 6°C but not frozen (for Microbiology samples, acceptance range is < 10°C but not frozen). It is acceptable for samples collected the same day as sample receipt to have a higher temperature as long as there is evidence that cooling has begun.)
 Shipping Information: _____

Section 3
 Was the cooler packed with: Ice Ice Packs Bubble Wrap Styrofoam
 Paper None Other _____
 Cooler Temp (°C): #1: 4.1 #2: _____ #3: _____ #4: _____

Section 4	YES	NO	N/A
Was a COC received?	<input checked="" type="checkbox"/>		
Are sample IDs present?	<input checked="" type="checkbox"/>		
Are sampling dates & times present?	<input checked="" type="checkbox"/>		
Is a relinquished signature present?	<input checked="" type="checkbox"/>		
Are the tests required clearly indicated on the COC?	<input checked="" type="checkbox"/>		
Are custody seals present?		<input checked="" type="checkbox"/>	
If custody seals are present, were they intact?			<input checked="" type="checkbox"/>
Are all samples sealed in plastic bags? (Recommended for Microbiology samples)			<input checked="" type="checkbox"/>
Did all samples arrive intact? If no, indicate in Section 4 below.	<input checked="" type="checkbox"/>		
Did all bottle labels agree with COC? (ID, dates and times)	<input checked="" type="checkbox"/>		
Were the samples collected in the correct containers for the required tests?	<input checked="" type="checkbox"/>		
Are the containers labeled with the correct preservatives?	<input checked="" type="checkbox"/>		
Is there headspace in the VOA vials greater than 5-6 mm in diameter?			<input checked="" type="checkbox"/>
Was a sufficient amount of sample submitted for the requested tests?	<input checked="" type="checkbox"/>		

Section 5 Explanations/Comments

Section 6
 For discrepancies, how was the Project Manager notified? Verbal PM Initials: _____ Date/Time _____
 Email (email sent to/on): _____ / _____
 Project Manager's response:

Completed By: Chris Cune Date: 1/20/21

Analysis Results for 439902

Imedia Morales
 APEX - Signal Hill
 1962 Freeman Avenue
 Signal Hill, CA 90755

Lab Job #: 439902
 Project No: PERMIT #22453_WW
 Location: WW
 Date Received: 01/28/21

Sample ID: EFFLUENT_01-28-21	Lab ID: 439902-001	Collected: 01/28/21 14:20
Matrix: Water		

439902-001 Analyte	Result	Qual	Units	RL	DF	Batch	Prepared	Analyzed	Chemist
Method: SM2540D Prep Method: METHOD									
Total Suspended Solids	0.7		mg/L	0.6	1.1	260497	01/29/21	01/29/21	NLP
Method: SM5220D Prep Method: METHOD									
Chemical Oxygen Demand	10		mg/L	4.0	1	260570	02/01/21	02/01/21	ATP

Batch QC

Type: Blank	Lab ID: QC906411	Batch: 260497
Matrix: Water	Method: SM2540D	Prep Method: METHOD

QC906411 Analyte	Result	Qual	Units	RL	Prepared	Analyzed
Total Suspended Solids	ND		mg/L	0.5	01/29/21	01/29/21

Type: Sample Duplicate	Lab ID: QC906412	Batch: 260497
Matrix (Source ID): Water (439909-001)	Method: SM2540D	Prep Method: METHOD

QC906412 Analyte	Result	Source Sample Result	Units	Qual	RPD	RPD Lim	DF
Total Suspended Solids	392.0	400.0	mg/L		2	5	20

Type: Blank	Lab ID: QC906624	Batch: 260570
Matrix: Water	Method: SM5220D	Prep Method: METHOD

QC906624 Analyte	Result	Qual	Units	RL	Prepared	Analyzed
Chemical Oxygen Demand	ND		mg/L	4.0	02/01/21	02/01/21

Type: Lab Control Sample	Lab ID: QC906625	Batch: 260570
Matrix: Water	Method: SM5220D	Prep Method: METHOD

QC906625 Analyte	Result	Spiked	Units	Recovery	Qual	Limits
Chemical Oxygen Demand	108.0	100.0	mg/L	108%		80-120

Type: Matrix Spike	Lab ID: QC906626	Batch: 260570
Matrix (Source ID): Water (439961-001)	Method: SM5220D	Prep Method: METHOD

QC906626 Analyte	Result	Source Sample Result	Spiked	Units	Recovery	Qual	Limits	DF
Chemical Oxygen Demand	90.00	ND	100.0	mg/L	88%		75-125	2

Type: Matrix Spike Duplicate	Lab ID: QC906627	Batch: 260570
Matrix (Source ID): Water (439961-001)	Method: SM5220D	Prep Method: METHOD

QC906627 Analyte	Result	Source Sample Result	Spiked	Units	Recovery	Qual	Limits	RPD	RPD Lim	DF
Chemical Oxygen Demand	96.00	ND	100.0	mg/L	94%		75-125	6	20	2

ND Not Detected



ENTHALPY
ANALYTICAL

Enthalpy Analytical
931 West Barkley Ave
Orange, CA 92868
(714) 771-6900

enthalpy.com

Lab Job Number: 439903
Report Level: II
Report Date: 02/11/2021

Analytical Report *prepared for:*

Imedla Morales
APEX - Signal Hill
1962 Freeman Avenue
Signal Hill, CA 90755

Project: PERMIT #22453_WW - WW

Authorized for release by:

Diane Galvan, Project Manager
714-771-9928
diane.galvan@enthalpy.com

This data package has been reviewed for technical correctness and completeness. Release of this data has been authorized by the Laboratory Manager or the Manager's designee, as verified by the above signature which applies to this PDF file as well as any associated electronic data deliverable files. The results contained in this report meet all requirements of NELAP and pertain only to those samples which were submitted for analysis. This report may be reproduced only in its entirety.

CA ELAP# 1338, NELAP# 4038, SCAQMD LAP# 18LA0518, LACSD ID# 10105, CDC ELITE
Member

Sample Summary

Imedia Morales
APEX - Signal Hill
1962 Freeman Avenue
Signal Hill, CA 90755

Lab Job #: 439903
Project No: PERMIT #22453_WW
Location: WW
Date Received: 01/28/21

Sample ID	Lab ID	Collected	Matrix
SURGE TANK_01-28-21	439903-001	01/28/21 14:29	Water

439903

CHAIN OF CUSTODY RECORD		ENTHALPY ANALYTICAL		Lab Number: 15881
931 W. Barkley, Orange, CA 92868		Client ID: 15881		1 of 1
Phone: (714) 771-8900 Fax: (714) 771-9933		Page: 1		
Billing: Enthalpy Analytical c/o Montrose Environmental Group Inc. P.O. Box 741137, Los Angeles, CA 90074-1137		www.enthalpy.com		
CUSTOMER INFORMATION		PROJECT INFORMATION		Turn Around Time
Company: APEX	Name: WW			Standard X
Report To: Inelda Morales	Number: Permit #22453			72 Hours
Email: inelda.morales@apex.com, inelda.morales@montrose.com	Address: 15306 Norwalk Blvd			48 Hours
Address: 1962 Freeman Ave	Address: Norwalk, CA 90650			24 Hours
Signal Hill, CA 90755	Global ID:			Same Day
Phone: 562-597-1055	P.O. #:			
Fax:	Sampled By:			
Sample ID	Matrix	Container	Pres.	
1 Surge Tank_01-28-21	W	1-L, 3-40ml	2	
2				
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
Meter Readings		pH	Temp	Time
1) Begin:				
End:				
2) Begin:				
End:				
3) Begin:				
End:				
4) Begin:				
End:				
		Reinquisitioned By: <i>Pauline</i>	1	Received By: <i>Pauline</i>
		Print Name: <i>Pauline Ryan</i>	Print Name: <i>Pauline Ryan</i>	2
		Date: <i>1-28-20 10:30</i>	Date: <i>1/28/21 10:37</i>	Authorized By: <i>17.0/4.1</i>
		Reinquisitioned By: <i>Pauline Ryan</i>	3	
		Print Name: <i>Pauline Ryan</i>	Print Name: <i>Pauline Ryan</i>	
		Date: <i>1-28-20 10:30</i>	Date: <i>1/28/21 10:37</i>	
		Reinquisitioned By: <i>Pauline Ryan</i>	4	
		Print Name: <i>Pauline Ryan</i>	Print Name: <i>Pauline Ryan</i>	
		Date: <i>1-28-20 10:30</i>	Date: <i>1/28/21 10:37</i>	



ENTHALPY ANALYTICAL

SAMPLE ACCEPTANCE CHECKLIST

Section 1
 Client: Apex Project: _____
 Date Received: 1/28/21 Sampler's Name Present: Yes No

Section 2
 Sample(s) received in a cooler? Yes, How many? 1 No (skip section 2) Sample Temp (°C) (No Cooler) : _____
 Sample Temp (°C), One from each cooler: #1: 17.0 #2: _____ #3: _____ #4: _____
(Acceptance range is < 6°C but not frozen (for Microbiology samples, acceptance range is < 10°C but not frozen). It is acceptable for samples collected the same day as sample receipt to have a higher temperature as long as there is evidence that cooling has begun.)
 Shipping Information: _____

Section 3
 Was the cooler packed with: Ice Ice Packs Bubble Wrap Styrofoam
 Paper None Other _____
 Cooler Temp (°C): #1: 4.1 #2: _____ #3: _____ #4: _____

Section 4	YES	NO	N/A
Was a COC received?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Are sample IDs present?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Are sampling dates & times present?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Is a relinquished signature present?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Are the tests required clearly indicated on the COC?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Are custody seals present?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
If custody seals are present, were they intact?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Are all samples sealed in plastic bags? (Recommended for Microbiology samples)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Did all samples arrive intact? If no, indicate in Section 4 below.	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Did all bottle labels agree with COC? (ID, dates and times)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Were the samples collected in the correct containers for the required tests?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Are the containers labeled with the correct preservatives?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Is there headspace in the VOA vials greater than 5-6 mm in diameter?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Was a sufficient amount of sample submitted for the requested tests?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Section 5 Explanations/Comments

Section 6
 For discrepancies, how was the Project Manager notified? Verbal PM Initials: _____ Date/Time: _____
 Email (email sent to/on): _____ / _____
 Project Manager's response:

Completed By: Mimi Cui Date: 1/28/21

Analysis Results for 439903

Imedia Morales
 APEX - Signal Hill
 1962 Freeman Avenue
 Signal Hill, CA 90755

Lab Job #: 439903
 Project No: PERMIT #22453_WW
 Location: WW
 Date Received: 01/28/21

Sample ID: SURGE TANK_01-28-21	Lab ID: 439903-001	Collected: 01/28/21 14:29
Matrix: Water		

439903-001 Analyte	Result	Qual	Units	RL	DF	Batch	Prepared	Analyzed	Chemist
Method: EPA 624									
Prep Method: EPA 624									
MTBE	ND		ug/L	5.0	1	260525	01/30/21	01/30/21	LYZ
Isopropyl Ether (DIPE)	ND		ug/L	5.0	1	260525	01/30/21	01/30/21	LYZ
Ethyl tert-Butyl Ether (ETBE)	ND		ug/L	1.0	1	260525	01/30/21	01/30/21	LYZ
Methyl tert-Amyl Ether (TAME)	ND		ug/L	1.0	1	260525	01/30/21	01/30/21	LYZ
tert-Butyl Alcohol (TBA)	25		ug/L	10	1	260525	01/30/21	01/30/21	LYZ
m,p-Xylenes	ND		ug/L	10	1	260525	01/30/21	01/30/21	LYZ
o-Xylene	ND		ug/L	5.0	1	260525	01/30/21	01/30/21	LYZ
Benzene	34		ug/L	5.0	1	260525	01/30/21	01/30/21	LYZ
Toluene	ND		ug/L	5.0	1	260525	01/30/21	01/30/21	LYZ
Ethylbenzene	ND		ug/L	5.0	1	260525	01/30/21	01/30/21	LYZ
Xylene (total)	ND		ug/L	5.0	1	260525	01/30/21	01/30/21	LYZ
Surrogates				Limits					
Dibromofluoromethane	95%		%REC	70-140	1	260525	01/30/21	01/30/21	LYZ
1,2-Dichloroethane-d4	104%		%REC	70-140	1	260525	01/30/21	01/30/21	LYZ
Toluene-d8	100%		%REC	70-140	1	260525	01/30/21	01/30/21	LYZ
Bromofluorobenzene	96%		%REC	70-140	1	260525	01/30/21	01/30/21	LYZ
Method: EPA 8015B									
Prep Method: EPA 5030B									
TPH Gasoline	410		ug/L	50	1	260648	02/02/21	02/02/21	EMW
Surrogates				Limits					
Bromofluorobenzene (FID)	100%		%REC	60-140	1	260648	02/02/21	02/02/21	EMW
Method: EPA 8015B									
Prep Method: EPA 3510C									
Diesel C10-C28	0.86		mg/L	0.11	1.1	260427	01/29/21	02/03/21	MES
Surrogates				Limits					
n-Triacontane	91%		%REC	35-130	1.1	260427	01/29/21	02/03/21	MES

ND Not Detected

Batch QC

Type: Blank	Lab ID: QC906195	Batch: 260427
Matrix: Water	Method: EPA 8015B	Prep Method: EPA 3510C

QC906195 Analyte	Result	Qual	Units	RL	Prepared	Analyzed
Diesel C10-C28	ND		mg/L	0.10	01/28/21	02/01/21
Surrogates				Limits		
n-Triacontane	89%		%REC	35-130	01/28/21	02/01/21

Type: Lab Control Sample	Lab ID: QC906196	Batch: 260427
Matrix: Water	Method: EPA 8015B	Prep Method: EPA 3510C

QC906196 Analyte	Result	Spiked	Units	Recovery	Qual	Limits
Diesel C10-C28	0.8059	1.000	mg/L	81%		42-120
Surrogates						
n-Triacontane	0.01853	0.02000	mg/L	93%		35-130

Type: Lab Control Sample Duplicate	Lab ID: QC906197	Batch: 260427
Matrix: Water	Method: EPA 8015B	Prep Method: EPA 3510C

QC906197 Analyte	Result	Spiked	Units	Recovery	Qual	Limits	RPD	RPD Lim
Diesel C10-C28	0.8639	1.000	mg/L	86%		42-120	7	36
Surrogates								
n-Triacontane	0.01919	0.02000	mg/L	96%		35-130		

Type: Blank	Lab ID: QC906484	Batch: 260525
Matrix: Water	Method: EPA 624	Prep Method: EPA 624

QC906484 Analyte	Result	Qual	Units	RL	Prepared	Analyzed
MTBE	ND		ug/L	5.0	01/29/21	01/29/21
Isopropyl Ether (DIPE)	ND		ug/L	5.0	01/29/21	01/29/21
Ethyl tert-Butyl Ether (ETBE)	ND		ug/L	1.0	01/29/21	01/29/21
Methyl tert-Amyl Ether (TAME)	ND		ug/L	1.0	01/29/21	01/29/21
tert-Butyl Alcohol (TBA)	ND		ug/L	10	01/29/21	01/29/21
m,p-Xylenes	ND		ug/L	10	01/29/21	01/29/21
o-Xylene	ND		ug/L	5.0	01/29/21	01/29/21
Benzene	ND		ug/L	5.0	01/29/21	01/29/21
Toluene	ND		ug/L	5.0	01/29/21	01/29/21
Ethylbenzene	ND		ug/L	5.0	01/29/21	01/29/21
Xylene (total)	ND		ug/L	5.0	01/29/21	01/29/21
Surrogates				Limits		
Dibromofluoromethane	95%		%REC	70-140	01/29/21	01/29/21
1,2-Dichloroethane-d4	101%		%REC	70-140	01/29/21	01/29/21
Toluene-d8	101%		%REC	70-140	01/29/21	01/29/21
Bromofluorobenzene	96%		%REC	70-140	01/29/21	01/29/21

Batch QC

Type: Lab Control Sample	Lab ID: QC906485	Batch: 260525
Matrix: Water	Method: EPA 624	Prep Method: EPA 624

QC906485 Analyte	Result	Spiked	Units	Recovery	Qual	Limits
MTBE	52.88	50.00	ug/L	106%		70-130
1,1-Dichloroethene	49.32	50.00	ug/L	99%		70-135
Benzene	50.12	50.00	ug/L	100%		70-130
Trichloroethene	50.64	50.00	ug/L	101%		70-130
Toluene	49.10	50.00	ug/L	98%		70-130
Chlorobenzene	49.60	50.00	ug/L	99%		70-130
Surrogates						
Dibromofluoromethane	50.80	50.00	ug/L	102%		70-140
1,2-Dichloroethane-d4	51.37	50.00	ug/L	103%		70-140
Toluene-d8	50.50	50.00	ug/L	101%		70-140
Bromofluorobenzene	49.08	50.00	ug/L	98%		70-140

Type: Lab Control Sample Duplicate	Lab ID: QC906486	Batch: 260525
Matrix: Water	Method: EPA 624	Prep Method: EPA 624

QC906486 Analyte	Result	Spiked	Units	Recovery	Qual	Limits	RPD	RPD Lim
MTBE	52.74	50.00	ug/L	105%		70-130	0	30
1,1-Dichloroethene	48.81	50.00	ug/L	98%		70-135	1	30
Benzene	50.23	50.00	ug/L	100%		70-130	0	30
Trichloroethene	50.65	50.00	ug/L	101%		70-130	0	30
Toluene	48.88	50.00	ug/L	98%		70-130	0	30
Chlorobenzene	49.52	50.00	ug/L	99%		70-130	0	30
Surrogates								
Dibromofluoromethane	50.94	50.00	ug/L	102%		70-140		
1,2-Dichloroethane-d4	50.95	50.00	ug/L	102%		70-140		
Toluene-d8	50.08	50.00	ug/L	100%		70-140		
Bromofluorobenzene	48.89	50.00	ug/L	98%		70-140		

Type: Lab Control Sample	Lab ID: QC906839	Batch: 260648
Matrix: Water	Method: EPA 8015B	Prep Method: EPA 5030B

QC906839 Analyte	Result	Spiked	Units	Recovery	Qual	Limits
TPH Gasoline	512.3	500.0	ug/L	102%		70-130
Surrogates						
Bromofluorobenzene (FID)	197.0	200.0	ug/L	99%		60-140

Batch QC

Type: Matrix Spike	Lab ID: QC906840	Batch: 260648
Matrix (Source ID): Water (439761-002)	Method: EPA 8015B	Prep Method: EPA 5030B

QC906840 Analyte	Result	Source Sample Result	Spiked	Units	Recovery	Qual	Limits	DF
TPH Gasoline	506.4	ND	500.0	ug/L	101%		70-130	1
Surrogates								
Bromofluorobenzene (FID)	193.0		200.0	ug/L	97%		60-140	1

Type: Matrix Spike Duplicate	Lab ID: QC906841	Batch: 260648
Matrix (Source ID): Water (439761-002)	Method: EPA 8015B	Prep Method: EPA 5030B

QC906841 Analyte	Result	Source Sample Result	Spiked	Units	Recovery	Qual	Limits	RPD	RPD Lim	DF
TPH Gasoline	506.1	ND	500.0	ug/L	101%		70-130	0	30	1
Surrogates										
Bromofluorobenzene (FID)	192.0		200.0	ug/L	96%		60-140			1

Type: Blank	Lab ID: QC906842	Batch: 260648
Matrix: Water	Method: EPA 8015B	Prep Method: EPA 5030B

QC906842 Analyte	Result	Qual	Units	RL	Prepared	Analyzed
TPH Gasoline	ND		ug/L	50	02/02/21	02/02/21
Surrogates						
Bromofluorobenzene (FID)	91%		%REC	60-140	02/02/21	02/02/21

ND Not Detected



ENTHALPY
ANALYTICAL

Enthalpy Analytical
931 West Barkley Ave
Orange, CA 92868
(714) 771-6900

enthalpy.com

Lab Job Number: 440748
Report Level: II
Report Date: 02/19/2021

Analytical Report *prepared for:*

Imedla Morales
APEX - Signal Hill
1962 Freeman Avenue
Signal Hill, CA 90755

Project: PERMIT #22453_WW - WW

Authorized for release by:

Diane Galvan, Project Manager
714-771-9928
diane.galvan@enthalpy.com

This data package has been reviewed for technical correctness and completeness. Release of this data has been authorized by the Laboratory Manager or the Manager's designee, as verified by the above signature which applies to this PDF file as well as any associated electronic data deliverable files. The results contained in this report meet all requirements of NELAP and pertain only to those samples which were submitted for analysis. This report may be reproduced only in its entirety.

CA ELAP# 1338, NELAP# 4038, SCAQMD LAP# 18LA0518, LACSD ID# 10105, CDC ELITE
Member

Sample Summary

Imedia Morales	Lab Job #:	440748
APEX - Signal Hill	Project No:	PERMIT #22453_WW
1962 Freeman Avenue	Location:	WW
Signal Hill, CA 90755	Date Received:	02/10/21

Sample ID	Lab ID	Collected	Matrix
SURGE TANK_02-10-21	440748-001	02/10/21 10:14	Water
EFFLUENT_02-10-21	440748-002	02/10/21 10:07	Water

4467496

CHAIN OF CUSTODY RECORD		Lab Number: 15881	
931 W. Barkley, Orange, CA 92868		Client ID: 15881	
Phone: (714) 771-6900 Fax: (714) 771-9933		Page: 1 of 1	
Billing: Enthality Analytical 20 Monroese Environmental Group Inc. P.O. Box 74137, Los Angeles, CA 90074-1377		www.enthalpy.com	
CUSTOMER INFORMATION		PROJECT INFORMATION	
Company: APEX	Name: WW	Turn Around Time	Standard X
Report To: Imelda Morales	Number: Permit #22453	72 Hours	
Email: imelda.morales@apexcos.com, glenn.androska@apexcos.com, kevin.van@apexcos.com	Address: 15306 Norwalk Blvd	48 Hours	
Address: 1962 Freeman Ave	Address: Norwalk, CA 90660	24 Hours	
Signal Hill, CA 90755	Global ID:	Same Day	
Phone: 562-597-1055	P.O. #:		
Fax:	Sampled By:		
Sample ID	Matrix	Container	Pres.
1 Surge Tank_02-10-21	W	*	*
2 Effluent_02-10-21			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
Meter Readings		pH	Time
1) Begin:			
End:			
2) Begin:			
End:			
3) Begin:			
End:			
4) Begin:			
End:			
Analysis		Test Instruction & Comments	
8015-TPHD (DRO)	X		
8015-TPHG (GRO)	X		
624 VOCs (BTEX & nP)	X		
Xylenes & Oxygenates	X		
EP 200, 7-Tolyl As Cd	X		
Cd, Pb, Ni, Ag, Zn	X		
Enthalpy Quote No.: APEX_012120			
*TPHD - 1L amber, unreserved			
*TPHG - 3x 40ml VOA vials w/HCl			
*VOCs - 3x 40ml VOA vials w/HCl			
*Metals (Total As, Cd, Cr, Cu, Pb, Ni, Ag, Zn) - 250ml poly w/HNO3			

Relinquished By: **Glenn Androska** Date: **2-10-21 1600** Received By: **Lucy Eick Meff** Date: **2/10/2021 1600 HRS**

Relinquished By: **Glenn Androska** Date: **2-10-21 1600** Received By: **Lucy Eick Meff** Date: **2/10/2021 1600 HRS**

103/2.5



ENTHALPY ANALYTICAL

SAMPLE ACCEPTANCE CHECKLIST

Section 1
 Client: Apex Project: WW
 Date Received: 2/10/2021 Sampler's Name Present: Yes No

Section 2
 Sample(s) received in a cooler? Yes, How many? 1 No (skip section 2) Sample Temp (°C) (No Cooler) : _____
 Sample Temp (°C), One from each cooler: #1: 10.3 #2: _____ #3: _____ #4: _____
(Acceptance range is < 6°C but not frozen (for Microbiology samples, acceptance range is < 10°C but not frozen). It is acceptable for samples collected the same day as sample receipt to have a higher temperature as long as there is evidence that cooling has begun.)
 Shipping Information: _____

Section 3
 Was the cooler packed with: Ice Ice Packs Bubble Wrap Styrofoam
 Paper None Other _____
 Cooler Temp (°C): #1: 2.5 #2: _____ #3: _____ #4: _____

Section 4	YES	NO	N/A
Was a COC received?	✓		
Are sample IDs present?	✓		
Are sampling dates & times present?	✓		
Is a relinquished signature present?	✓		
Are the tests required clearly indicated on the COC?	✓		
Are custody seals present?		✓	
If custody seals are present, were they intact?			✓
Are all samples sealed in plastic bags? (Recommended for Microbiology samples)			✓
Did all samples arrive intact? If no, indicate in Section 4 below.	✓		
Did all bottle labels agree with COC? (ID, dates and times)	✓		
Were the samples collected in the correct containers for the required tests?	✓		
Are the containers labeled with the correct preservatives?	✓		
Is there headspace in the VOA vials greater than 5-6 mm in diameter?			✓
Was a sufficient amount of sample submitted for the requested tests?	✓		

Section 5 Explanations/Comments

Section 6
 For discrepancies, how was the Project Manager notified? Verbal PM Initials: _____ Date/Time _____
 Email (email sent to/on): _____ / _____
 Project Manager's response:

Completed By: [Signature] Date: 2/10/21

Analysis Results for 440748

Imedia Morales
 APEX - Signal Hill
 1962 Freeman Avenue
 Signal Hill, CA 90755

Lab Job #: 440748
 Project No: PERMIT #22453_WW
 Location: WW
 Date Received: 02/10/21

Sample ID: SURGE TANK_02-10-21 Lab ID: 440748-001 Collected: 02/10/21 10:14
Matrix: Water

440748-001 Analyte	Result	Qual	Units	RL	DF	Batch	Prepared	Analyzed	Chemist
Method: EPA 200.7 Prep Method: EPA 3010A									
Cadmium	ND		mg/L	0.0050	1	261292	02/11/21	02/12/21	SBW
Chromium	ND		mg/L	0.010	1	261292	02/11/21	02/12/21	SBW
Copper	ND		mg/L	0.010	1	261292	02/11/21	02/12/21	SBW
Lead	ND		mg/L	0.010	1	261292	02/11/21	02/12/21	SBW
Nickel	ND		mg/L	0.010	1	261292	02/11/21	02/12/21	SBW
Silver	ND		mg/L	0.0050	1	261292	02/11/21	02/12/21	SBW
Zinc	ND		mg/L	0.050	1	261292	02/11/21	02/12/21	SBW
Arsenic	0.30		mg/L	0.010	1	261292	02/11/21	02/17/21	SBW
Method: EPA 624 Prep Method: EPA 624									
MTBE	5.2		ug/L	5.0	1	261325	02/12/21	02/12/21	LYZ
Isopropyl Ether (DIPE)	ND		ug/L	5.0	1	261325	02/12/21	02/12/21	LYZ
Ethyl tert-Butyl Ether (ETBE)	ND		ug/L	1.0	1	261325	02/12/21	02/12/21	LYZ
Methyl tert-Amyl Ether (TAME)	ND		ug/L	1.0	1	261325	02/12/21	02/12/21	LYZ
tert-Butyl Alcohol (TBA)	30		ug/L	10	1	261325	02/12/21	02/12/21	LYZ
m,p-Xylenes	ND		ug/L	10	1	261325	02/12/21	02/12/21	LYZ
o-Xylene	ND		ug/L	5.0	1	261325	02/12/21	02/12/21	LYZ
Benzene	48		ug/L	5.0	1	261325	02/12/21	02/12/21	LYZ
Toluene	ND		ug/L	5.0	1	261325	02/12/21	02/12/21	LYZ
Ethylbenzene	ND		ug/L	5.0	1	261325	02/12/21	02/12/21	LYZ
Xylene (total)	ND		ug/L	5.0	1	261325	02/12/21	02/12/21	LYZ
Surrogates				Limits					
Dibromofluoromethane	94%		%REC	70-140	1	261325	02/12/21	02/12/21	LYZ
1,2-Dichloroethane-d4	104%		%REC	70-140	1	261325	02/12/21	02/12/21	LYZ
Toluene-d8	102%		%REC	70-140	1	261325	02/12/21	02/12/21	LYZ
Bromofluorobenzene	96%		%REC	70-140	1	261325	02/12/21	02/12/21	LYZ
Method: EPA 8015B Prep Method: EPA 5030B									
TPH Gasoline	740		ug/L	50	1	261438	02/17/21	02/18/21	EMW
Surrogates				Limits					
Bromofluorobenzene (FID)	100%		%REC	60-140	1	261438	02/17/21	02/18/21	EMW
Method: EPA 8015B Prep Method: EPA 3510C									
Diesel C10-C28	1.5		mg/L	0.094	0.94	261272	02/11/21	02/11/21	MES
Surrogates				Limits					

Analysis Results for 440748

440748-001 Analyte	Result	Qual	Units	RL	DF	Batch	Prepared	Analyzed	Chemist
n-Triacontane	81%		%REC	35-130	0.94	261272	02/11/21	02/11/21	MES

Sample ID: EFFLUENT_02-10-21

Lab ID: 440748-002

Collected: 02/10/21 10:07

Matrix: Water

440748-002 Analyte	Result	Qual	Units	RL	DF	Batch	Prepared	Analyzed	Chemist
Method: EPA 200.7									
Prep Method: EPA 3010A									
Cadmium	ND		mg/L	0.0050	1	261292	02/11/21	02/12/21	SBW
Chromium	ND		mg/L	0.010	1	261292	02/11/21	02/12/21	SBW
Copper	ND		mg/L	0.010	1	261292	02/11/21	02/12/21	SBW
Lead	ND		mg/L	0.010	1	261292	02/11/21	02/12/21	SBW
Nickel	ND		mg/L	0.010	1	261292	02/11/21	02/12/21	SBW
Silver	ND		mg/L	0.0050	1	261292	02/11/21	02/12/21	SBW
Zinc	ND		mg/L	0.050	1	261292	02/11/21	02/12/21	SBW
Arsenic	ND		mg/L	0.010	1	261292	02/11/21	02/12/21	SBW

ND Not Detected

Batch QC

Type: Blank	Lab ID: QC908537	Batch: 261272
Matrix: Water	Method: EPA 8015B	Prep Method: EPA 3510C

QC908537 Analyte	Result	Qual	Units	RL	Prepared	Analyzed
Diesel C10-C28	ND		mg/L	0.10	02/11/21	02/11/21
Surrogates				Limits		
n-Triacontane	77%		%REC	35-130	02/11/21	02/11/21

Type: Lab Control Sample	Lab ID: QC908538	Batch: 261272
Matrix: Water	Method: EPA 8015B	Prep Method: EPA 3510C

QC908538 Analyte	Result	Spiked	Units	Recovery	Qual	Limits
Diesel C10-C28	0.7317	1.000	mg/L	73%		42-120
Surrogates						
n-Triacontane	0.01464	0.02000	mg/L	73%		35-130

Type: Lab Control Sample Duplicate	Lab ID: QC908539	Batch: 261272
Matrix: Water	Method: EPA 8015B	Prep Method: EPA 3510C

QC908539 Analyte	Result	Spiked	Units	Recovery	Qual	Limits	RPD	RPD Lim
Diesel C10-C28	0.8071	1.000	mg/L	81%		42-120	10	36
Surrogates								
n-Triacontane	0.01499	0.02000	mg/L	75%		35-130		

Type: Blank	Lab ID: QC908585	Batch: 261292
Matrix: Water	Method: EPA 200.7	Prep Method: EPA 3010A

QC908585 Analyte	Result	Qual	Units	RL	Prepared	Analyzed
Cadmium	ND		mg/L	0.0050	02/11/21	02/12/21
Chromium	ND		mg/L	0.010	02/11/21	02/12/21
Copper	ND		mg/L	0.010	02/11/21	02/12/21
Lead	ND		mg/L	0.010	02/11/21	02/12/21
Nickel	ND		mg/L	0.010	02/11/21	02/12/21
Silver	ND		mg/L	0.0050	02/11/21	02/12/21
Zinc	ND		mg/L	0.050	02/11/21	02/12/21
Arsenic	ND		mg/L	0.010	02/11/21	02/12/21

Batch QC

Type: Lab Control Sample	Lab ID: QC908586	Batch: 261292
Matrix: Water	Method: EPA 200.7	Prep Method: EPA 3010A

QC908586 Analyte	Result	Spiked	Units	Recovery	Qual	Limits
Cadmium	1.897	2.000	mg/L	95%		85-115
Chromium	1.879	2.000	mg/L	94%		85-115
Copper	1.802	2.000	mg/L	90%		85-115
Lead	1.915	2.000	mg/L	96%		85-115
Nickel	1.891	2.000	mg/L	95%		85-115
Silver	1.889	2.000	mg/L	94%		85-115
Zinc	1.949	2.000	mg/L	97%		85-115
Arsenic	1.847	2.000	mg/L	92%		85-115

Type: Matrix Spike	Lab ID: QC908587	Batch: 261292
Matrix (Source ID): Water (440768-002)	Method: EPA 200.7	Prep Method: EPA 3010A

QC908587 Analyte	Result	Source Sample Result	Spiked	Units	Recovery	Qual	Limits	DF
Cadmium	0.9476	ND	1.000	mg/L	95%		75-125	1
Chromium	0.9449	0.001211	1.000	mg/L	94%		75-125	1
Copper	0.9344	ND	1.000	mg/L	93%		75-125	1
Lead	0.9615	0.001222	1.000	mg/L	96%		75-125	1
Nickel	0.9491	0.002245	1.000	mg/L	95%		75-125	1
Silver	0.9629	0.0007353	1.000	mg/L	96%		75-125	1
Zinc	0.9549	0.003965	1.000	mg/L	95%		75-125	1
Arsenic	0.9907	0.04065	1.000	mg/L	95%		75-125	1

Type: Matrix Spike Duplicate	Lab ID: QC908588	Batch: 261292
Matrix (Source ID): Water (440768-002)	Method: EPA 200.7	Prep Method: EPA 3010A

QC908588 Analyte	Result	Source Sample Result	Spiked	Units	Recovery	Qual	Limits	RPD	RPD Lim	DF
Cadmium	0.9526	ND	1.000	mg/L	95%		75-125	1	20	1
Chromium	0.9483	0.001211	1.000	mg/L	95%		75-125	0	20	1
Copper	0.9493	ND	1.000	mg/L	95%		75-125	2	20	1
Lead	0.9668	0.001222	1.000	mg/L	97%		75-125	1	20	1
Nickel	0.9495	0.002245	1.000	mg/L	95%		75-125	0	20	1
Silver	0.9729	0.0007353	1.000	mg/L	97%		75-125	1	20	1
Zinc	0.9586	0.003965	1.000	mg/L	95%		75-125	0	20	1
Arsenic	1.002	0.04065	1.000	mg/L	96%		75-125	1	20	1

Batch QC

Type: Matrix Spike	Lab ID: QC908589	Batch: 261292
Matrix (Source ID): Water (440768-006)	Method: EPA 200.7	Prep Method: EPA 3010A

QC908589 Analyte	Result	Source Sample Result	Spiked	Units	Recovery	Qual	Limits	DF
Cadmium	0.9321	0.0004566	1.000	mg/L	93%		75-125	1
Chromium	0.9411	0.007419	1.000	mg/L	93%		75-125	1
Copper	0.9071	0.005884	1.000	mg/L	90%		75-125	1
Lead	0.9616	ND	1.000	mg/L	96%		75-125	1
Nickel	0.9491	0.009708	1.000	mg/L	94%		75-125	1
Silver	0.9445	ND	1.000	mg/L	94%		75-125	1
Zinc	0.9793	0.01399	1.000	mg/L	97%		75-125	1
Arsenic	0.9354	ND	1.000	mg/L	94%		75-125	1

Type: Matrix Spike Duplicate	Lab ID: QC908590	Batch: 261292
Matrix (Source ID): Water (440768-006)	Method: EPA 200.7	Prep Method: EPA 3010A

QC908590 Analyte	Result	Source Sample Result	Spiked	Units	Recovery	Qual	Limits	RPD		DF
								RPD	Lim	
Cadmium	0.9386	0.0004566	1.000	mg/L	94%		75-125	1	20	1
Chromium	0.9509	0.007419	1.000	mg/L	94%		75-125	1	20	1
Copper	0.9206	0.005884	1.000	mg/L	91%		75-125	1	20	1
Lead	0.9658	ND	1.000	mg/L	97%		75-125	0	20	1
Nickel	0.9574	0.009708	1.000	mg/L	95%		75-125	1	20	1
Silver	0.9515	ND	1.000	mg/L	95%		75-125	1	20	1
Zinc	0.9827	0.01399	1.000	mg/L	97%		75-125	0	20	1
Arsenic	0.9404	ND	1.000	mg/L	94%		75-125	1	20	1

Batch QC

Type: Blank	Lab ID: QC908671	Batch: 261325
Matrix: Water	Method: EPA 624	Prep Method: EPA 624

QC908671 Analyte	Result	Qual	Units	RL	Prepared	Analyzed
MTBE	ND		ug/L	5.0	02/12/21	02/12/21
Isopropyl Ether (DIPE)	ND		ug/L	5.0	02/12/21	02/12/21
Ethyl tert-Butyl Ether (ETBE)	ND		ug/L	1.0	02/12/21	02/12/21
Methyl tert-Amyl Ether (TAME)	ND		ug/L	1.0	02/12/21	02/12/21
tert-Butyl Alcohol (TBA)	ND		ug/L	10	02/12/21	02/12/21
m,p-Xylenes	ND		ug/L	10	02/12/21	02/12/21
o-Xylene	ND		ug/L	5.0	02/12/21	02/12/21
Benzene	ND		ug/L	5.0	02/12/21	02/12/21
Toluene	ND		ug/L	5.0	02/12/21	02/12/21
Ethylbenzene	ND		ug/L	5.0	02/12/21	02/12/21
Xylene (total)	ND		ug/L	5.0	02/12/21	02/12/21
Surrogates				Limits		
Dibromofluoromethane	95%		%REC	70-140	02/12/21	02/12/21
1,2-Dichloroethane-d4	102%		%REC	70-140	02/12/21	02/12/21
Toluene-d8	102%		%REC	70-140	02/12/21	02/12/21
Bromofluorobenzene	94%		%REC	70-140	02/12/21	02/12/21

Type: Lab Control Sample	Lab ID: QC908672	Batch: 261325
Matrix: Water	Method: EPA 624	Prep Method: EPA 624

QC908672 Analyte	Result	Spiked	Units	Recovery	Qual	Limits
MTBE	52.43	50.00	ug/L	105%		70-130
1,1-Dichloroethene	54.56	50.00	ug/L	109%		70-135
Benzene	54.27	50.00	ug/L	109%		70-130
Trichloroethene	51.58	50.00	ug/L	103%		70-130
Toluene	51.04	50.00	ug/L	102%		70-130
Chlorobenzene	51.43	50.00	ug/L	103%		70-130
Surrogates						
Dibromofluoromethane	51.46	50.00	ug/L	103%		70-140
1,2-Dichloroethane-d4	51.42	50.00	ug/L	103%		70-140
Toluene-d8	50.55	50.00	ug/L	101%		70-140
Bromofluorobenzene	48.16	50.00	ug/L	96%		70-140

Batch QC

Type: Lab Control Sample Duplicate	Lab ID: QC908673	Batch: 261325
Matrix: Water	Method: EPA 624	Prep Method: EPA 624

QC908673 Analyte	Result	Spiked	Units	Recovery	Qual	Limits	RPD	RPD Lim
MTBE	53.03	50.00	ug/L	106%		70-130	1	30
1,1-Dichloroethene	52.73	50.00	ug/L	105%		70-135	3	30
Benzene	54.16	50.00	ug/L	108%		70-130	0	30
Trichloroethene	50.81	50.00	ug/L	102%		70-130	1	30
Toluene	50.52	50.00	ug/L	101%		70-130	1	30
Chlorobenzene	51.10	50.00	ug/L	102%		70-130	1	30
Surrogates								
Dibromofluoromethane	51.64	50.00	ug/L	103%		70-140		
1,2-Dichloroethane-d4	51.17	50.00	ug/L	102%		70-140		
Toluene-d8	50.53	50.00	ug/L	101%		70-140		
Bromofluorobenzene	48.44	50.00	ug/L	97%		70-140		

Type: Lab Control Sample	Lab ID: QC909394	Batch: 261438
Matrix: Water	Method: EPA 8015B	Prep Method: EPA 5030B

QC909394 Analyte	Result	Spiked	Units	Recovery	Qual	Limits
TPH Gasoline	539.6	500.0	ug/L	108%		70-130
Surrogates						
Bromofluorobenzene (FID)	217.0	200.0	ug/L	109%		60-140

Type: Matrix Spike	Lab ID: QC909395	Batch: 261438
Matrix (Source ID): Water (440845-002)	Method: EPA 8015B	Prep Method: EPA 5030B

QC909395 Analyte	Result	Source Sample Result	Spiked	Units	Recovery	Qual	Limits	DF
TPH Gasoline	503.0	ND	500.0	ug/L	101%		70-130	1
Surrogates								
Bromofluorobenzene (FID)	222.0		200.0	ug/L	111%		60-140	1

Type: Matrix Spike Duplicate	Lab ID: QC909396	Batch: 261438
Matrix (Source ID): Water (440845-002)	Method: EPA 8015B	Prep Method: EPA 5030B

QC909396 Analyte	Result	Source Sample Result	Spiked	Units	Recovery	Qual	Limits	RPD	RPD Lim	DF
TPH Gasoline	507.4	ND	500.0	ug/L	101%		70-130	1	30	1
Surrogates										
Bromofluorobenzene (FID)	221.0		200.0	ug/L	111%		60-140			1

Batch QC

Type: Blank	Lab ID: QC909397	Batch: 261438
Matrix: Water	Method: EPA 8015B	Prep Method: EPA 5030B

QC909397 Analyte	Result	Qual	Units	RL	Prepared	Analyzed
TPH Gasoline	ND		ug/L	50	02/17/21	02/17/21
Surrogates				Limits		
Bromofluorobenzene (FID)	105%		%REC	60-140	02/17/21	02/17/21

ND Not Detected




APPENDIX B

LNAPL HAZARDOUS WASTE MANIFEST

466863-1 C-1 BRW-APH.A 15.5

Please print or type.

Form Approved. OMB No. 2050-0039

UNIFORM HAZARDOUS WASTE MANIFEST		1. Generator ID Number CA8971524360	2. Page 1 of 1	3. Emergency Response Phone 424-347-3088	4. Manifest Tracking Number 015011988 FLE		
5. Generator's Name and Mailing Address Defense Logistics Agency - Energy Attn: Todd Williams 3171 North Gaffey St. San Pedro, CA 90731				Generator's Site Address (if different than mailing address) DFSP Norwalk 15305 Norwalk Blvd. Norwalk, CA 90650			
Generator's Phone: (424) 347-3088							
6. Transporter 1 Company Name NIETO & SONS TRUCKING, INC.					U.S. EPA ID Number CAT080016116		
7. Transporter 2 Company Name					U.S. EPA ID Number		
8. Designated Facility Name and Site Address World Oil Recycling 2000 N. Alameda St. Compton, CA 90222					U.S. EPA ID Number CAT080013352		
Facility's Phone: (310) 597-7100							
9a. HM	9b. U.S. DOT Description (including Proper Shipping Name, Hazard Class, ID Number, and Packing Group (if any))	10. Containers		11. Total Quantity	12. Unit Wt./Vol.	13. Waste Codes	
		No.	Type				
X	1. UN1993, Flammable Liquid, n.o.s., 3, PG II (contains jet fuel)	001	TT	152	G	133	
	2.						
	3.	THIS WASTE STREAM HAS BEEN QUALIFIED FOR RECYCLING/TREATMENT AT THE DEMENNO KERDOON DBA WORLD OIL RECYCLING FACILITY IN COMPTON, CALIFORNIA. THIS FACILITY HAS THE NECESSARY PERMITS TO RECEIVE YOUR WASTE STREAM AS QUALIFIED. OUR EPA NUMBER IS CAT080013352					
	4.						
14. Special Handling Instructions and Additional Information ERG# 128 / Jet Fuel & Groundwater SGI/APEX Contact: Glenn Androsko (714) 608-1089							
WEAR ALL APPROPRIATE PROTECTIVE CLOTHING							
BESI: 326444							
15. GENERATOR'S/OFFEROR'S CERTIFICATION: I hereby declare that the contents of this consignment are fully and accurately described above by the proper shipping name, and are classified, packaged, marked and labeled/placarded, and are in all respects in proper condition for transport according to applicable international and national governmental regulations. If export shipment and I am the Primary Exporter, I certify that the contents of this consignment conform to the terms of the attached EPA Acknowledgment of Consent. I certify that the waste minimization statement identified in 40 CFR 262.27(a) (if I am a large quantity generator) or (b) (if I am a small quantity generator) is true.							
Generator's/Offoror's Printed/Typed Name TODD E.H. WILLIAMS				Signature 		Month/Day/Year 01/19/21	
16. International Shipments <input type="checkbox"/> Import to U.S. <input type="checkbox"/> Export from U.S. Port of entry/exit: _____ Date leaving U.S.: _____							
17. Transporter Acknowledgment of Receipt of Materials							
Transporter 1 Printed/Typed Name Jim Jeanal				Signature 		Month/Day/Year 01/19/21	
Transporter 2 Printed/Typed Name				Signature		Month/Day/Year	
18. Discrepancy							
18a. Discrepancy Indication Space <input type="checkbox"/> Quantity <input type="checkbox"/> Type <input type="checkbox"/> Residue <input type="checkbox"/> Partial Rejection <input type="checkbox"/> Full Rejection							
Manifest Reference Number: _____							
18b. Alternate Facility (or Generator)					U.S. EPA ID Number		
Facility's Phone: _____							
18c. Signature of Alternate Facility (or Generator)						Month/Day/Year	
19. Hazardous Waste Report Management Method Codes (i.e., codes for hazardous waste treatment, disposal, and recycling systems)							
1. H039		2.		3.		4.	
20. Designated Facility Owner or Operator: Certification of receipt of hazardous materials covered by the manifest except as noted in Item 18a							
Printed/Typed Name Aaron Benny #				Signature 		Month/Day/Year 01/19/21	

GENERATOR

INT'L

TRANSPORTER

DESIGNATED FACILITY